

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

GENERAL NOTES

- ALL WORK SHOWN IS NEW UNLESS OTHERWISE INDICATED.
- CONTRACTOR SHALL MAINTAIN FREE AND UNOBSTRUCTED ACCESS TO AND EGRESS FROM THE AREA OF WORK.
- SITE OBSERVATION IS REQUIRED PRIOR TO FINAL PRICE TO ENSURE A COMPLETE UNDERSTANDING OF THE WORK TO BE ACCOMPLISHED. THIS INCLUDES WORK NOT SPECIFICALLY INDICATED BUT REQUIRED FOR PROPER CONSTRUCTION AND INSTALLATION OF THE WORK.
- ALL WORK SHALL CONFORM TO ALL LOCAL, STATE AND FEDERAL CODES.
- CONTRACTORS AND SUB-CONTRACTORS SHALL BE LICENSED IN SANTA ROSA COUNTY TO PERFORM THEIR TRADES.
- CONTRACTOR AND SUB-CONTRACTOR SHALL HAVE WORKERS COMPENSATION INSURANCE AND HOLD THE OWNER HARMLESS FOR ALL INJURIES.
- ALL WORK SHALL BE GUARANTEED FOR ONE YEAR FROM SUBSTANTIAL COMPLETION.
- WORK SHALL NOT DEVIATE FROM THE PLANS WITHOUT WRITTEN PERMISSION FROM THE ARCHITECT.
- THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL FEES, PERMITS, STAMPS, INSPECTIONS, ETC., AS REQUIRED.
- SEE SHEET L101 FOR CODE INFORMATION, CODE ANALYSIS AND LIFE SAFETY PLAN

FLORIDA PRODUCT APPROVALS

CATEGORY	MANUFACTURER	APPROVAL #
HOLLOW METAL DOORS AND FRAMES	INGERSOLL RAND	FL 12400 -- IMPACT-RESISTANT
OVERHEAD COILING DOORS	COOKSON -- SST	FL 2211
GLAZING	CORAL ARCHITECTURAL PRODUCTS	N.O.A. 03-1117.05
METAL ROOFING	FABRAL, INC	FL 15722.8
ALUMINUM LOUVERS	GREENHECK	N.O.A. 17-0919.05

PROJECT TEAM

ARCHITECTURAL
TOWNES + ARCHITECTS, P.A.
2421 NORTH 12TH AVENUE
PENSACOLA, FLORIDA 32503
PHONE: 850.433.0203
EMAIL: ben@townesplus.com

LANDSCAPING
MICHAEL WOLF CONSULTANTS
4539 OAK ORCHARD CIRCLE
PACE, FLORIDA 32571
PHONE: 850-698-0056
EMAIL: mike.wolfriddleassociates@gmail.com


PLUMBING | MECHANICAL | ELECTRICAL
H.M. YONGE & ASSOCIATES CONSULTING ENGINEERS, INC.
51 EAST GREGORY STREET
PENSACOLA, FLORIDA 32502
PHONE: 850.434.2661
EMAIL: tmtitchell@hmyace.com
avarghese@hmyace.com

CIVIL
MUNICIPAL ENGINEERING SERVICES, INC.
8574 TURKEY BLUFF ROAD
NAVARRE, FLORIDA 32566
PHONE: 850.939.5732
EMAIL: dlong@mes-i.com

STRUCTURAL
BERUBE LEONARD, LLC
3101 NORTH 12TH AVE
PENSACOLA, FLORIDA 32503
PHONE: 850.473.9955
EMAIL: nate@blse.net

TELECOM & DATA
PREMIER ENGINEERING
410 WEST 9 MILE ROAD #A
PENSACOLA, FLORIDA 32534
PHONE: 850.469.0405
EMAIL: gcook@premeg.com

PROJECT LOCATION

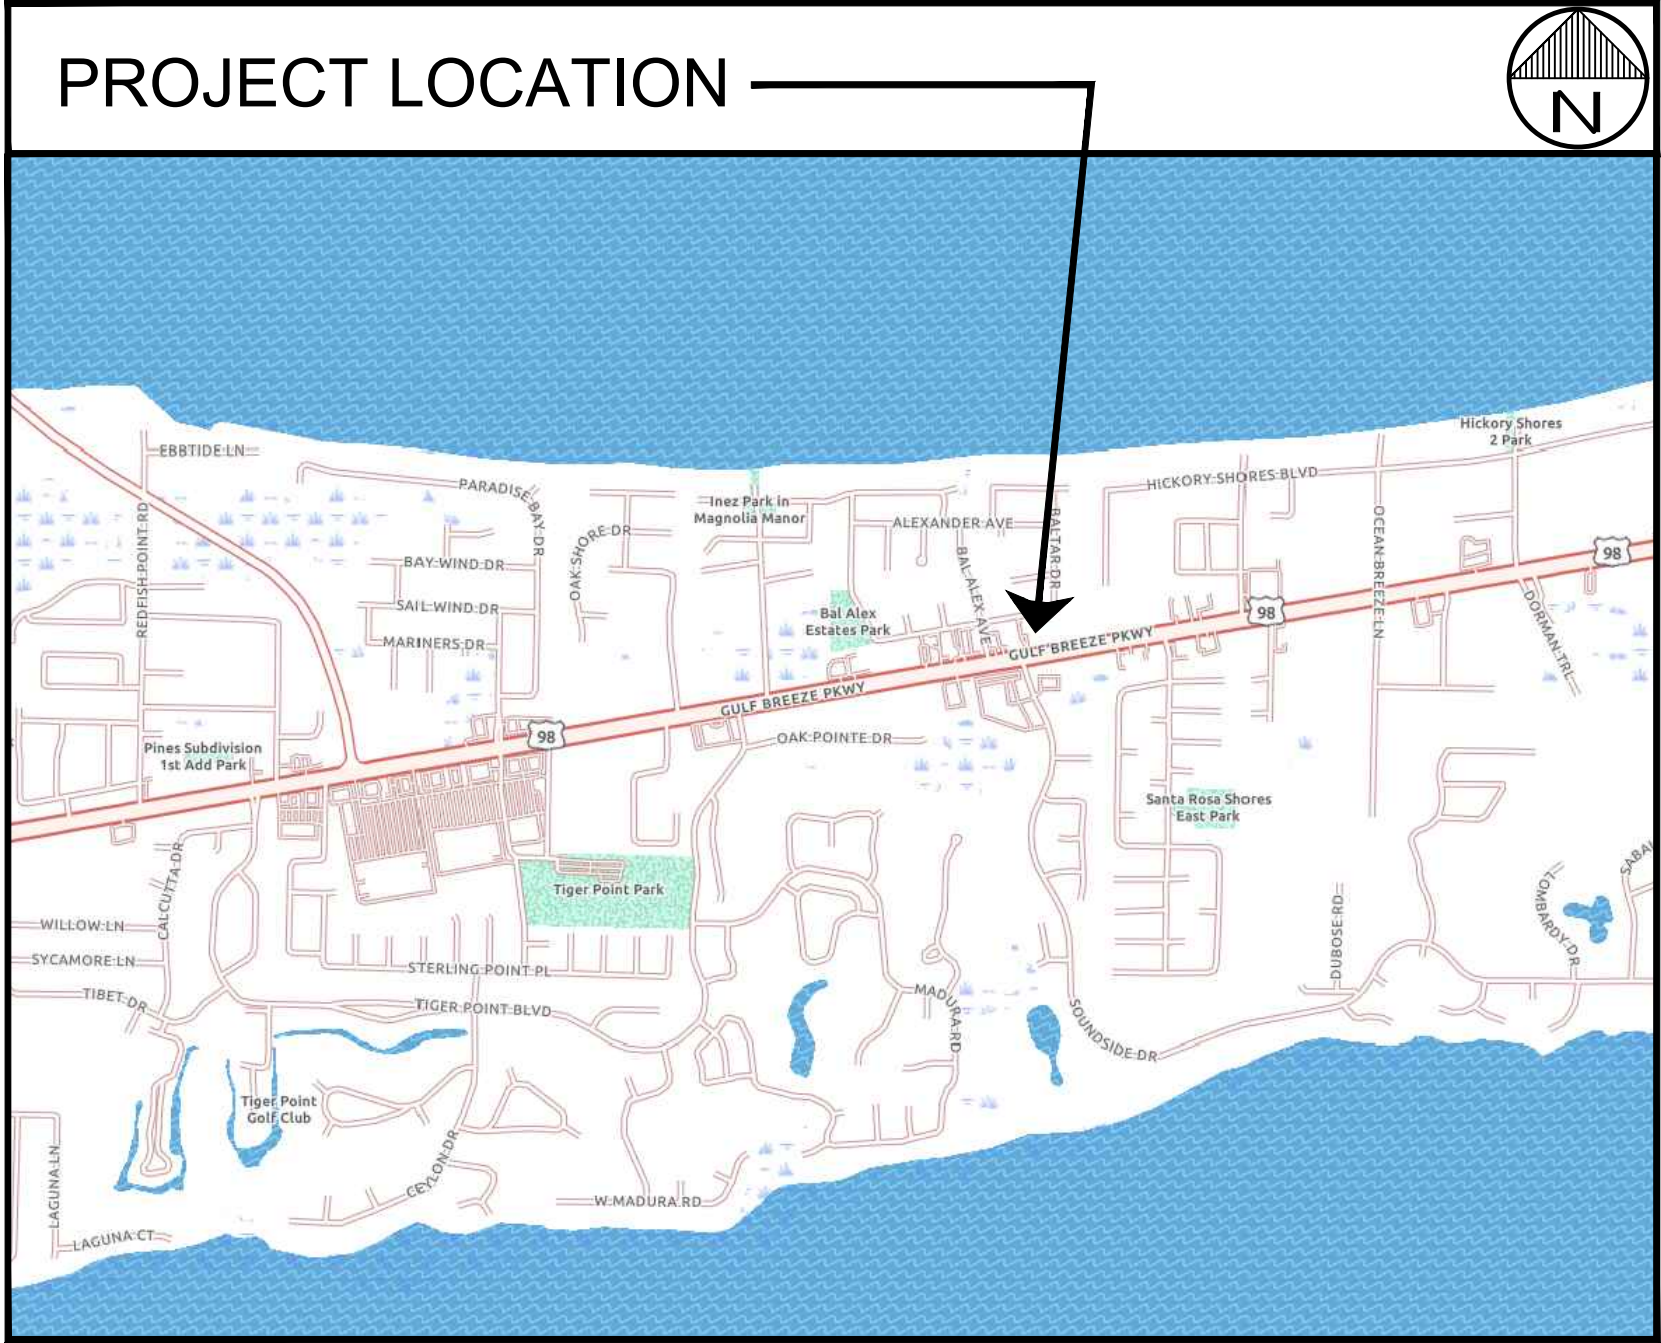

DRAWING INDEX

G001	TITLE SHEET, DRAWING INDEX, NOTES		
LS101	LIFE SAFETY PLAN	P101	SANITARY WASTE PLAN
		P201	WATER AND GAS PIPING PLAN
		P301	PLUMBING DETAILS
		P501	PLUMBING SCHEDULES & LEGEND
C000	CIVIL COVER SHEET, SHEET INDEX & LOCATION MAP		
C001	GENERAL NOTES & LEGEND		
C002	EROSION & SEDIMENT CONTROL NOTES & DETAILS		
C003	STORMWATER POLLUTION PREVENTION PLAN	M101	HVAC PLAN
C100	F.D.O.T. 660 SURVEY	M201	HVAC DETAILS
C101	EXISTING CONDITIONS	M301	HVAC SCHEDULES & LEGEND
C102	DEMOLITION AND EROSION CONTROL PLAN		
C201	SITE PLAN	F101	FIRE PROTECTION PLAN
C301	CONCRETE JOINT PLAN	F201	FIRE PROTECTION LEGEND & DETAILS
C401	GRADING AND DRAINAGE PLAN		
C402	STORMWATER POND SECTIONS, DETAILS & NOTES	E000	ELECTRICAL LEGEND
C501	UTILITIES PLAN	E001	ELECTRICAL SITE PLAN
C601	GEOMETRY AND STRIPING PLAN	E101	LIGHTING PLAN
C701	US HWY 98/SR10 F.D.O.T. WORK PLAN	E201	POWER PLAN
C801	CIVIL DETAILS	E301	SYSTEMS PLAN
C802	CIVIL DETAILS	E401	LIGHTNING PROTECTION PLAN
C803	CIVIL DETAILS	E501	ELECTRICAL DIAGRAMS
C804	CIVIL DETAILS		
C805	CIVIL DETAILS	T101	COMMUNICATIONS SITE PLAN
C806	CIVIL DETAILS	T201	COMMUNICATIONS FLOOR PLAN
L101	LANDSCAPING PLAN	T301	COMMUNICATIONS TYPICAL DETAILS
L102	IRRIGATION PLAN	T302	COMMUNICATIONS TYPICAL DETAILS
L103	LANDSCAPING DETAILS	T303	COMMUNICATIONS TYPICAL FACEPLATE & LABELING DETAILS
		T401	VOICE SYSTEM SINGLE LINE CONFIGURATION DIAGRAM
		T402	DATA SYSTEM SINGLE LINE CONFIGURATION DIAGRAM
		T403	TV SYSTEM CABLE DISTRIBUTION SINGLE LINE CONFIGURATION DIAGRAM
S001	GENERAL NOTES & TYPICAL DETAILS		
S002	TYPICAL DETAILS		
S101	FOUNDATION PLAN	T501	COMMUNICATIONS EQUIPMENT ROOM (CER) ENLARGED FLOOR PLAN
S102	LOW ROOF FRAMING PLAN		
S103	HIGH ROOF FRAMING PLAN	T502	COMMUNICATION RACK ELEVATIONS
S200	SECTIONS & DETAILS		
S201	SECTIONS & DETAILS		
S202	SECTIONS & DETAILS	SEC101	SECURITY SYSTEMS DETAILS
S203	SECTIONS & DETAILS	SEC102	SECURITY SYSTEMS DETAILS
S301	TRUSS ELEVATION & DETAILS		
S302	ENTRY TOWER ELEVATIONS & DETAILS		
A001	ARCHITECTURAL SITE PLAN		
A101	FLOOR PLAN		
A111	REFLECTED CEILING PLAN		
A121	ROOF PLAN		
A201	EXTERIOR ELEVATIONS		
A202	ENLARGED TOWER ELEVATIONS		
A301	WALL SECTIONS		
A302	WALL SECTIONS		
A303	WALL SECTIONS		
A311	WALL DETAILS		
A312	WALL DETAILS		
A313	DETAILS		
A321	MASONRY ELEVATIONS		
A322	CAST STONE ELEVATIONS		
A401	FINISH SCHEDULES		
A501	ENLARGED FLOOR PLANS		
A511	CASEWORK ELEVATIONS		
A521	CASEWORK SECTIONS		
A601	DOOR SCHEDULES & DETAILS		
A602	DOOR DETAILS		
A701	WINDOW SCHEDULES & DETAILS		
A711	LOUVER ELEVATIONS & DETAILS		
A801	TYPICAL PENETRATION DETAILS		
A802	TYPICAL PENETRATION DETAILS		


TITLE SHEET
DRAWINGS INDEX, NOTES

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL


Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:


G001
SHEET #

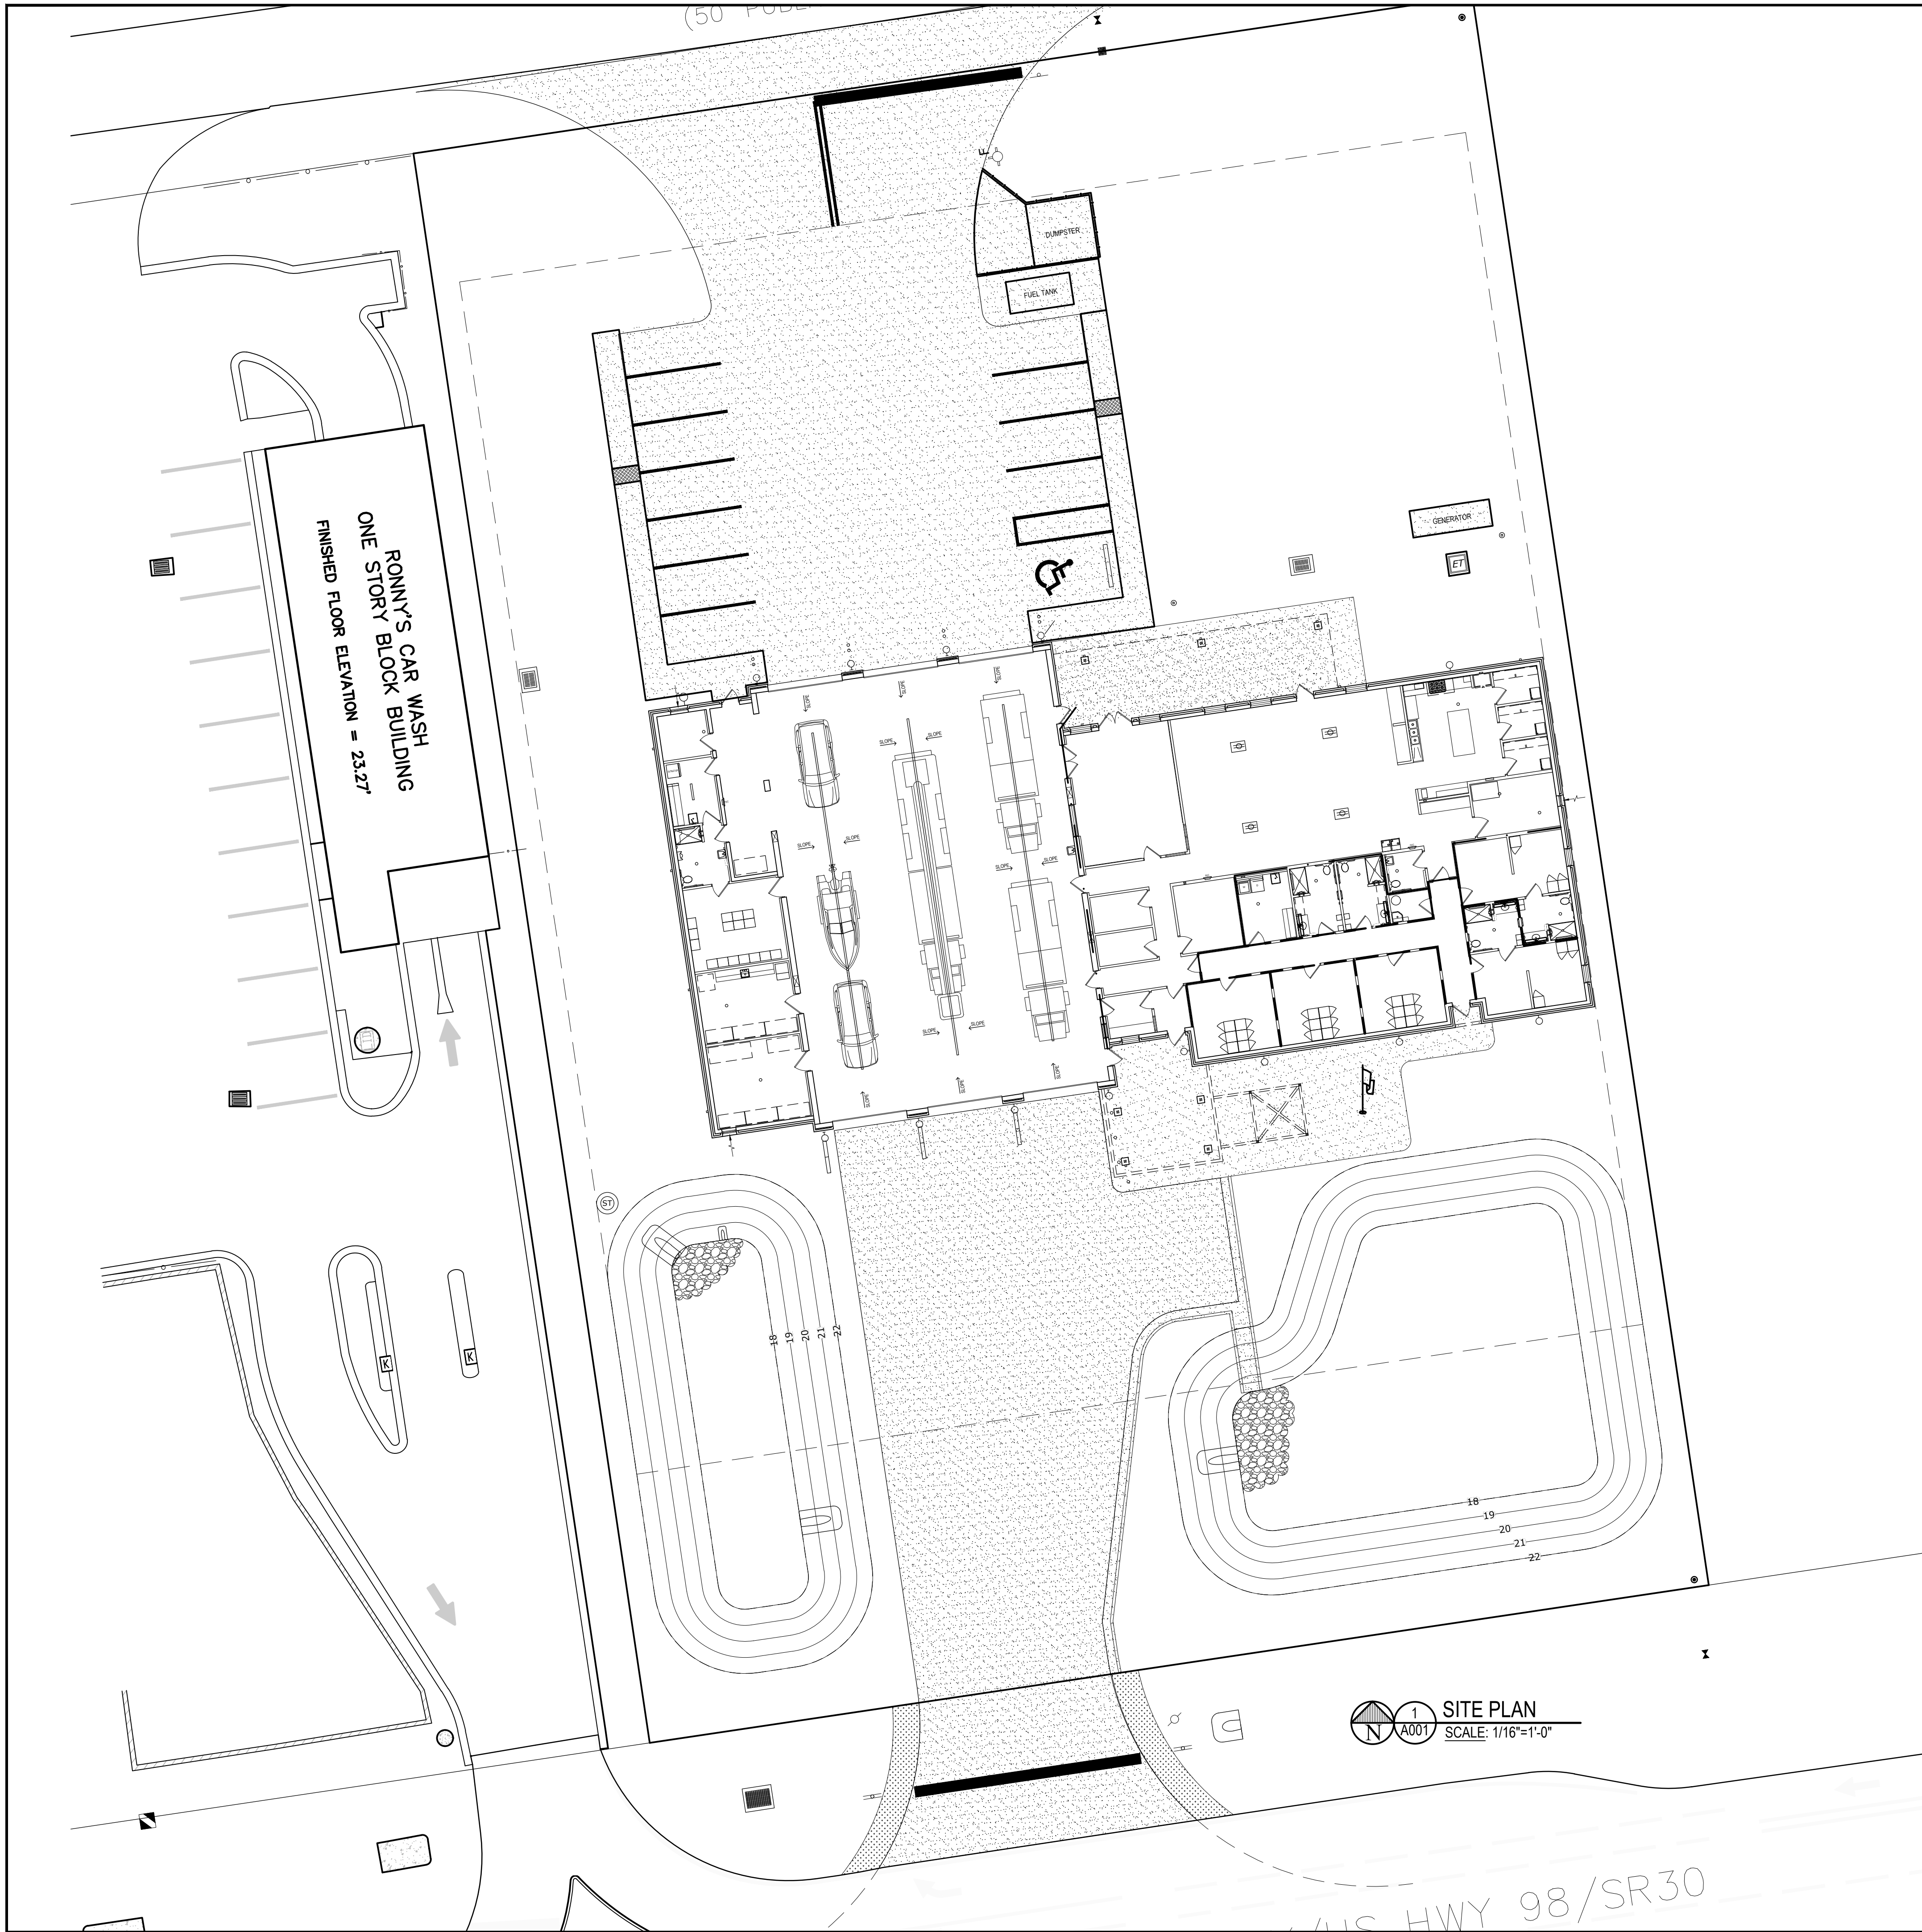


SITE PLAN
SCALE: 1/16"=1'-0"

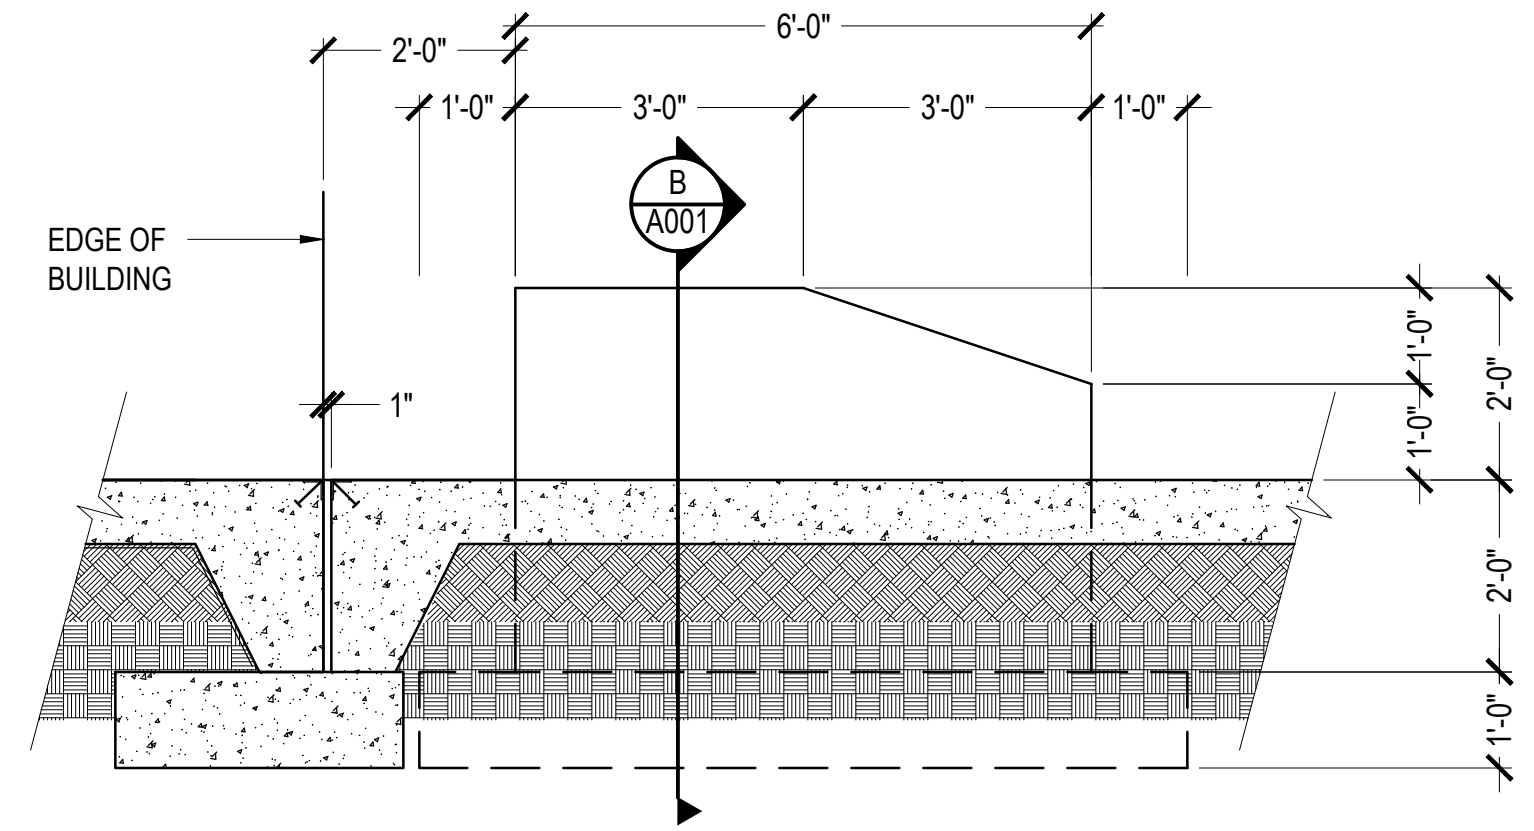


BOLLARD DETAIL
SCALE: 1/2"=1'-0"

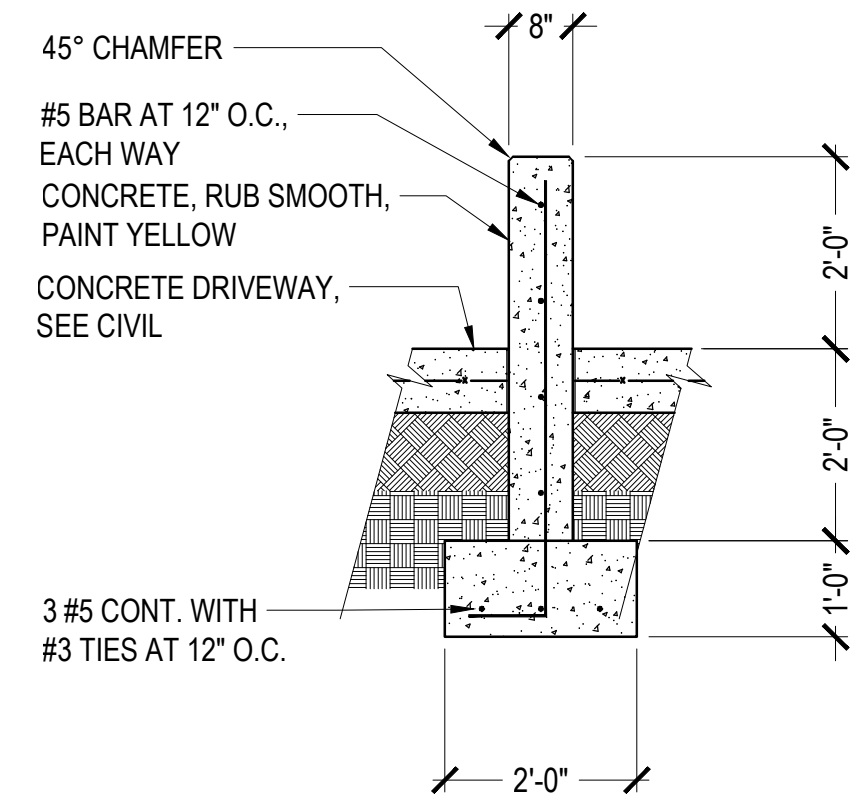

BOLLARD DETAIL
SCALE: 1/2"=1'-0"

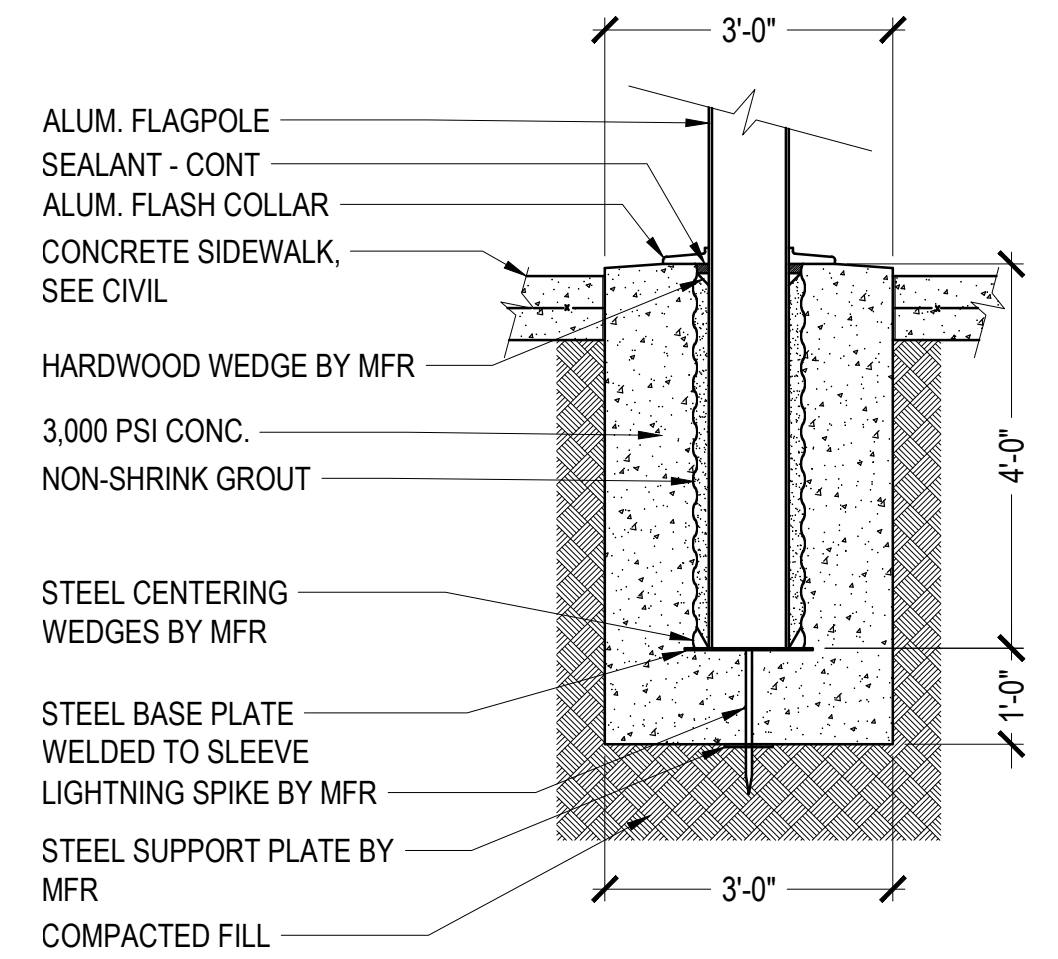

FLAGPOLE BASE DETAIL
SCALE: 1/2"=1'-0"

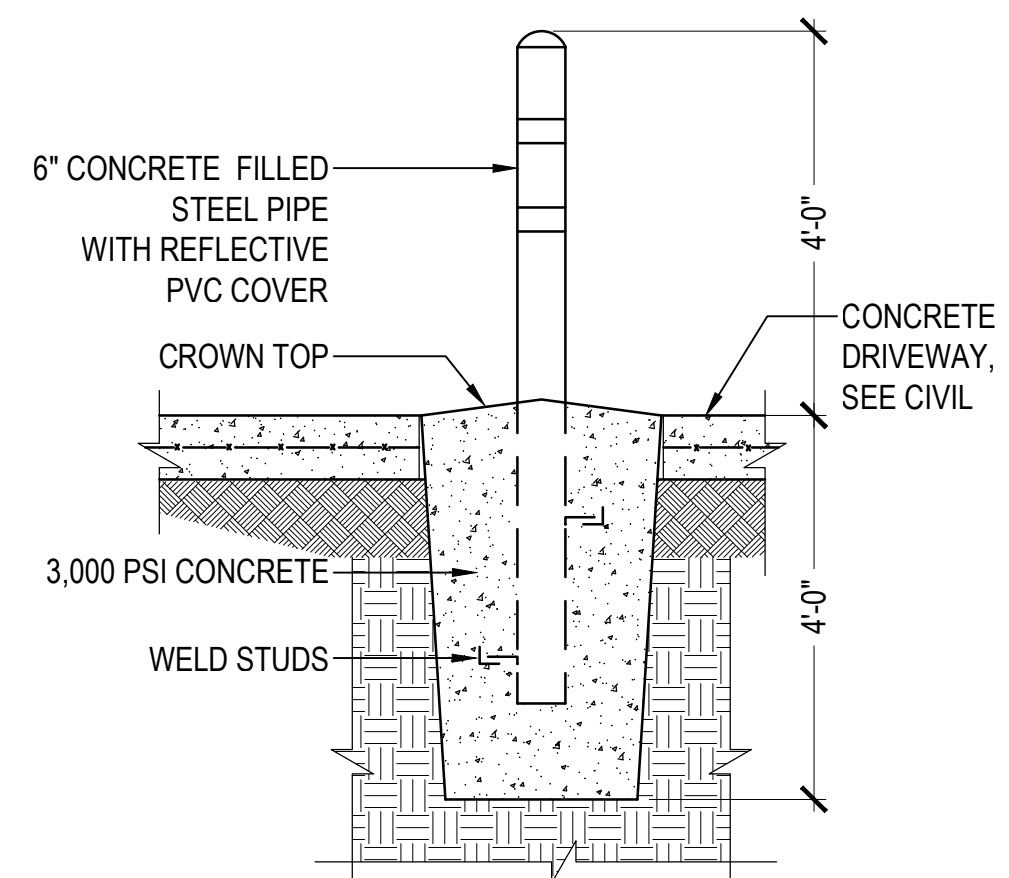

PIPE BOLLARD DETAIL
SCALE: 1/2"=1'-0"


ARCHITECTURAL
SITE PLAN

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

A001
SHEET #

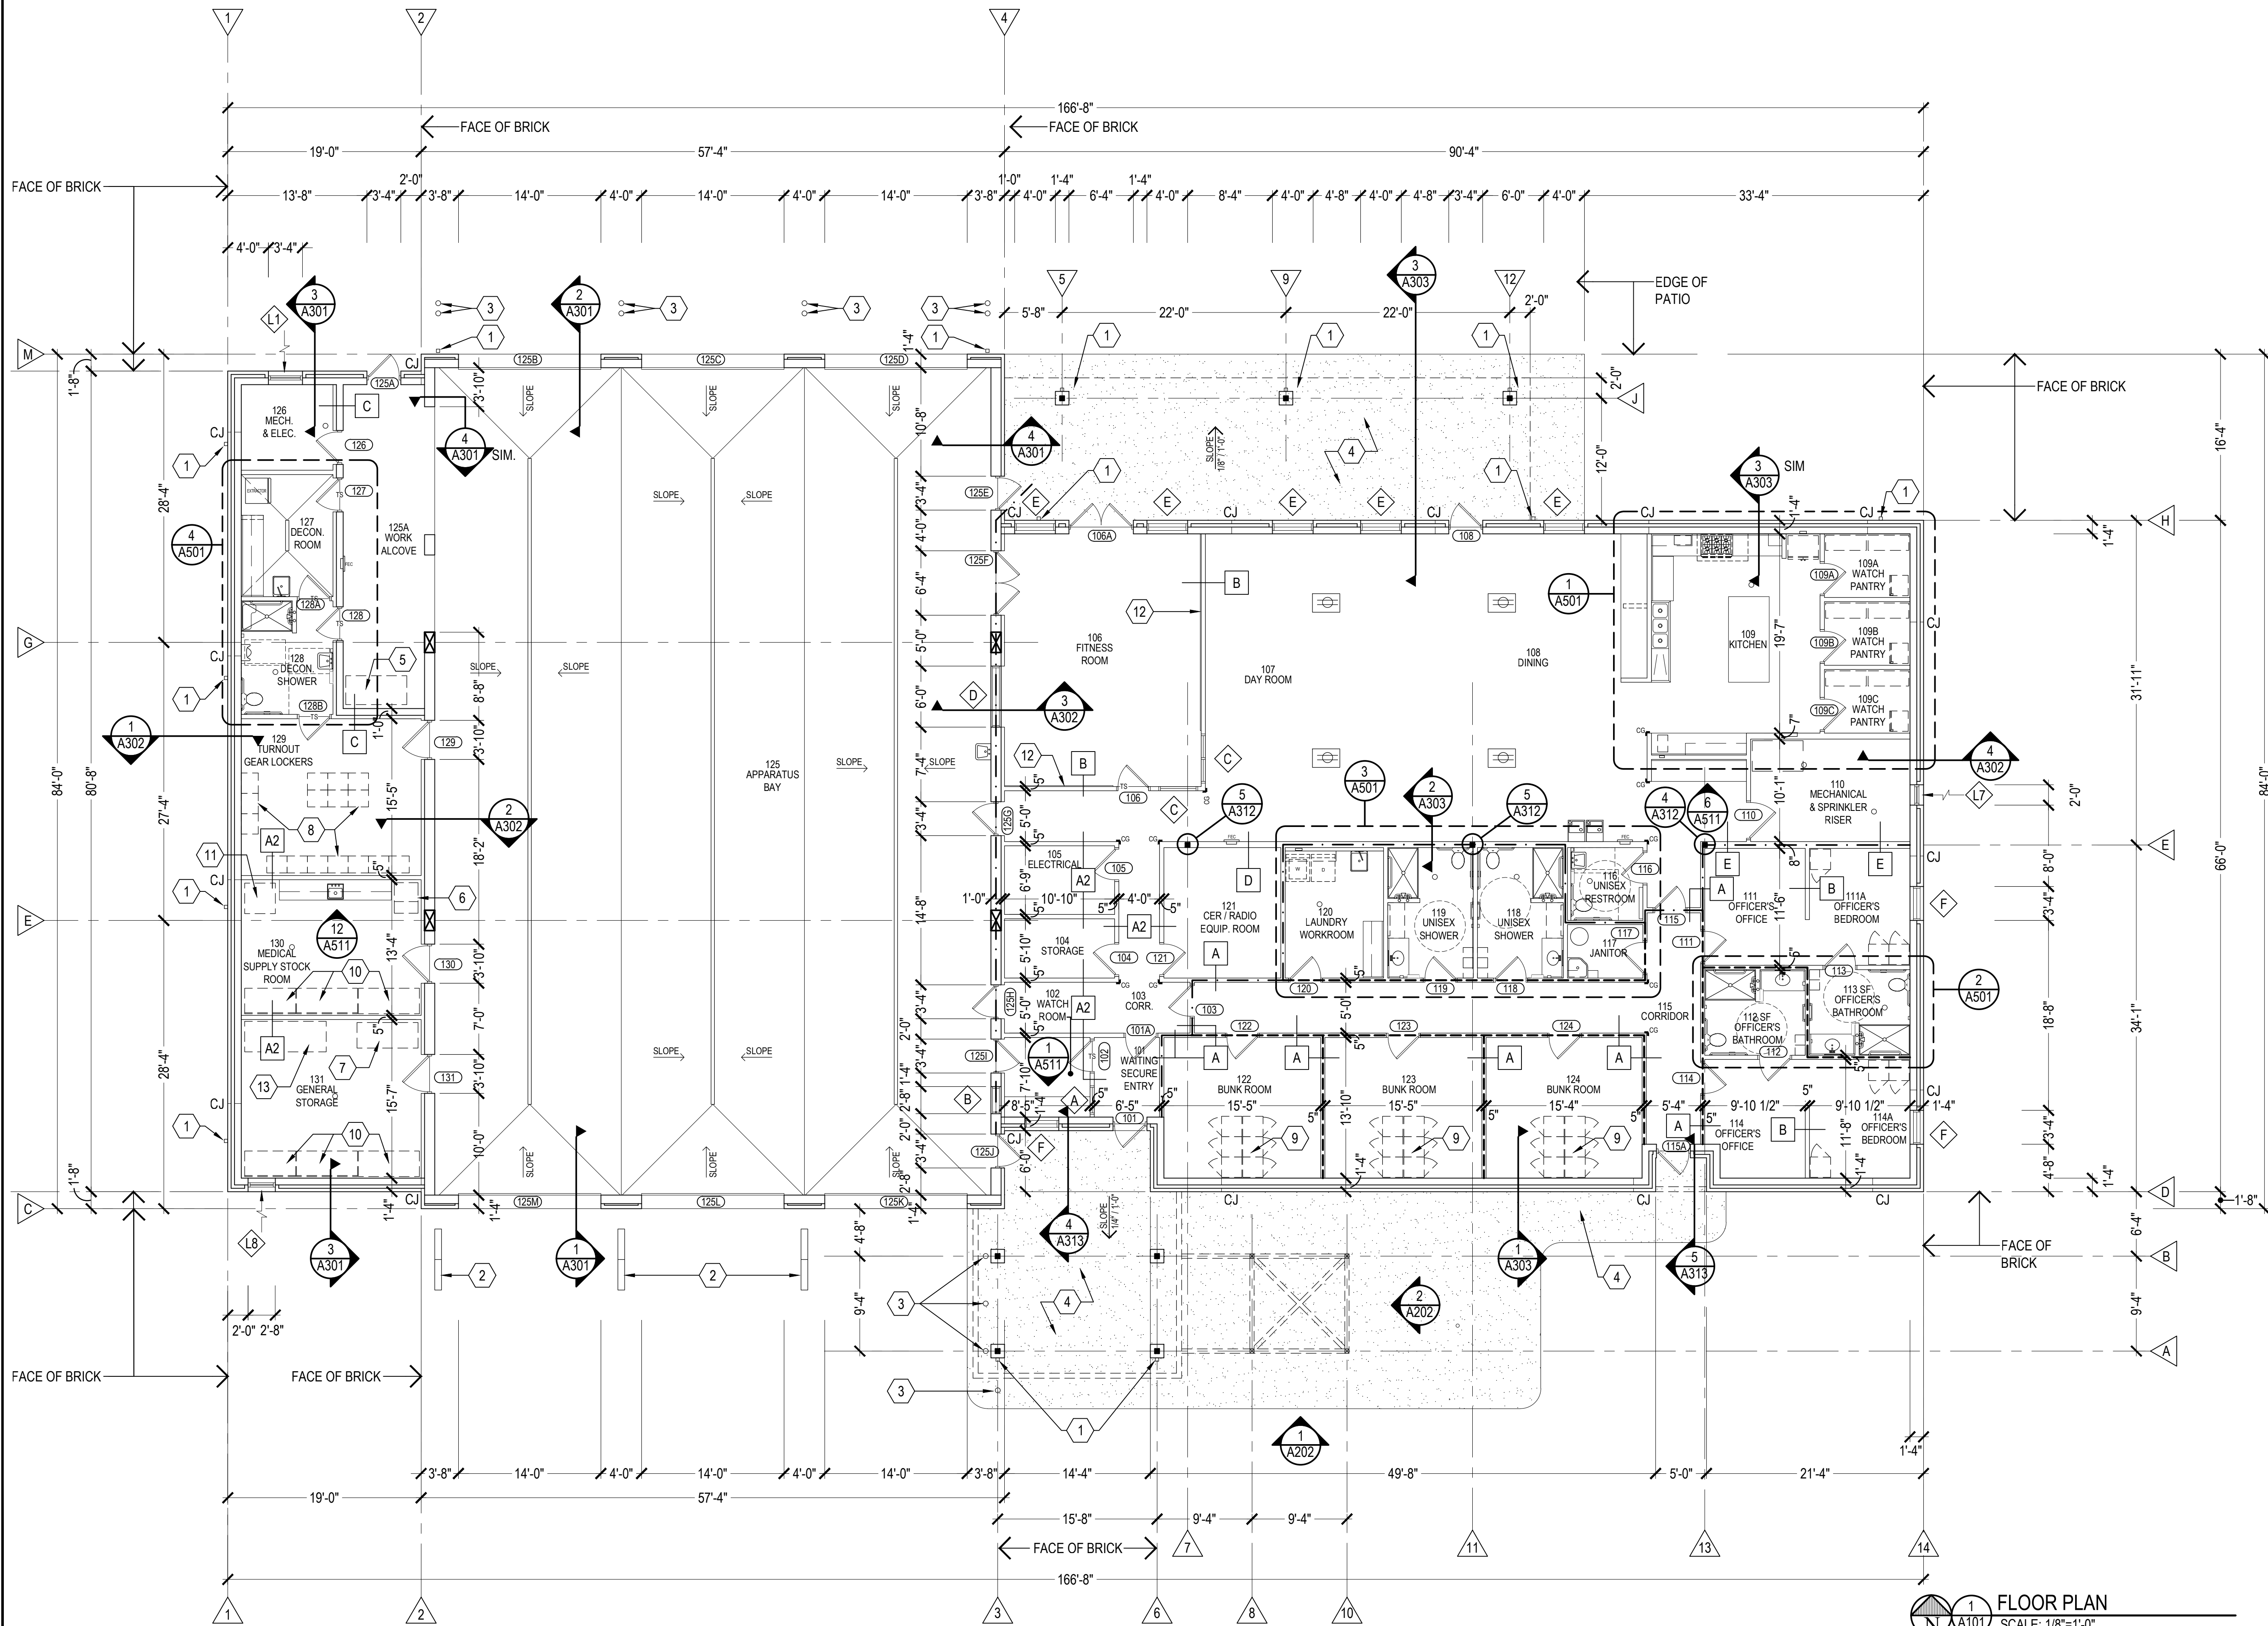

- GENERAL NOTES
- SEE ELEVATIONS AND MECHANICAL PLANS FOR LOUVERS NOT INDICATED ON ARCHITECTURAL FLOOR PLANS.

- LEGEND
- ONE HOUR RATED FIRE PARTITION
 - ONE HALF HOUR RATED FIRE PARTITION
 - INTERIOR PARTITION
 - WALL TYPE, SEE SHEET A401
 - DOOR & FRAME
 - DOOR MARK. SEE DOOR SCHEDULE
 - WINDOW
 - WINDOW MARK, SEE WINDOW SCHEDULE
 - RECESSED FIRE EXTINGUISHER CABINET WITH 1-10 LB. ABC DRY CHEMICAL FIRE EXTINGUISHER.
 - CONCRETE COLUMN - SEE STRUCTURAL
 - VINYL TRANSITION STRIP
 - VINYL CORNER GUARD (CS SPECIALTIES MODEL TFC/TFCH 0.040 SOLID COLOR, FULL HEIGHT, OR APPROVED EQUAL, COMPLETE)
 - MASONRY CONTROL JOINT, SEE DETAIL 8/A312.
 - RECESSED FLOOR POWER OUTLET, SEE ELECTRICAL.
 - FLOOR DRAIN, SEE PLUMBING.


- KEYNOTES
- 4" x 6" PRE-FINISHED 0.032 ALUMINUM DOWNSPOUT. TERMINATE AT CAST ALUMINUM SQUARE-TO-ROUND DOWNSPOUT BOOT. CONNECT TO UNDERGROUND STORM DRAINAGE SYSTEM. PROVIDE A MINIMUM OF 3 BRACKETS, EACH.
 - CONCRETE BOLLARD, SEE DETAIL A/A001.
 - 6" DIAMETER CONCRETE-FILLED, STEEL PIPE BOLLARDS, PVC REFLECTIVE COVER, SEE DETAIL D/A001.
 - 4" THICK 3000 PSI CONCRETE ON 10 MIL VAPOR BARRIER, WITH 10/10 6x6 WWF, LIGHT BROOM FINISH, SEE A001 FOR CONTROL JOINTS. SEE SECTION 3/A303 FOR TYPICAL EDGE DETAIL.
 - OFOI PPE DRYER.
 - OFOI ICE MACHINE.
 - OFOI SCUBA AIR BOTTLE FILLER.
 - OFOI TURN OUT GEAR LOCKERS ON CASTERS, TYPICAL OF 16.
 - OFOI CLOTHING CABINET.
 - OFOI WIRE SHELVING UNITS ON CASTERS.
 - OFOI NARCOTICS SAFE.
 - SAFETY MIRROR ADHERED TO WALL, SEE FINISH SCHEDULE.
 - OFOI WORK BENCH


FLOOR PLAN
SCALE: 1/8"=1'-0"

FLOOR PLAN
MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:




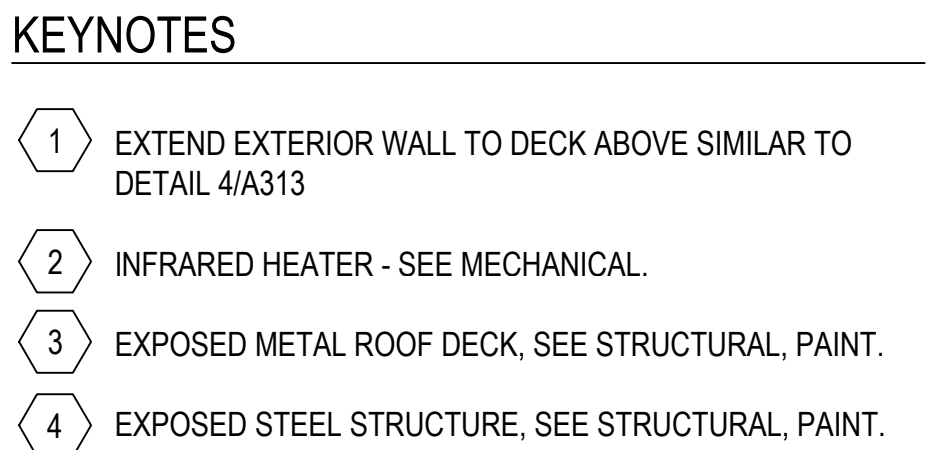


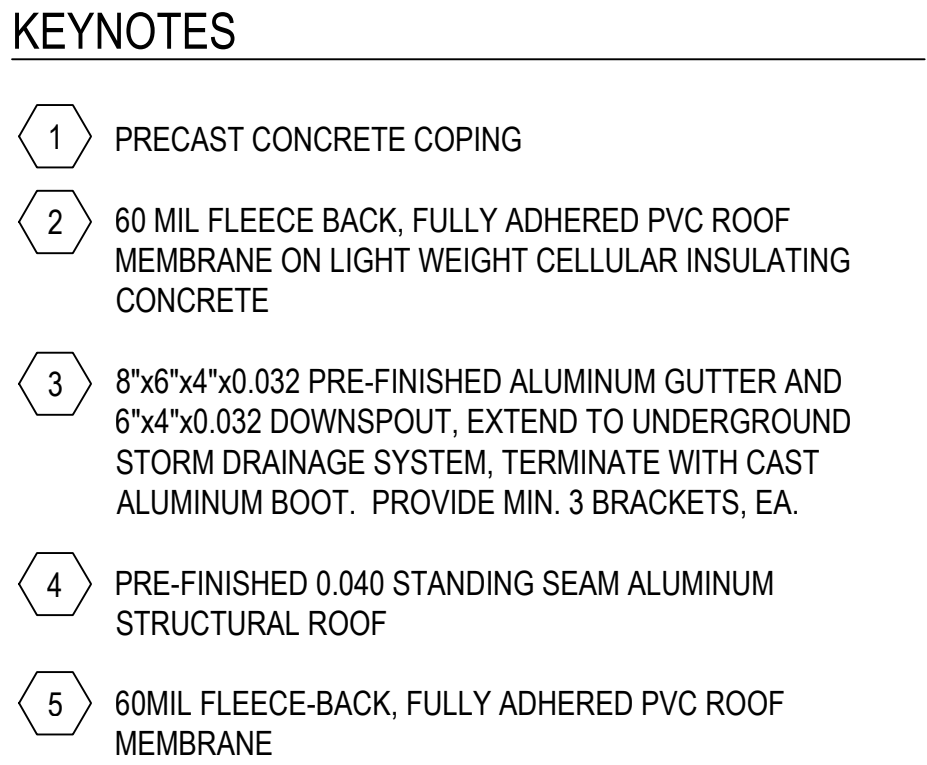

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale: AS NOTED	
Date: 04-03-2024	
Drawn:	Checked:
A121 SHEET #	

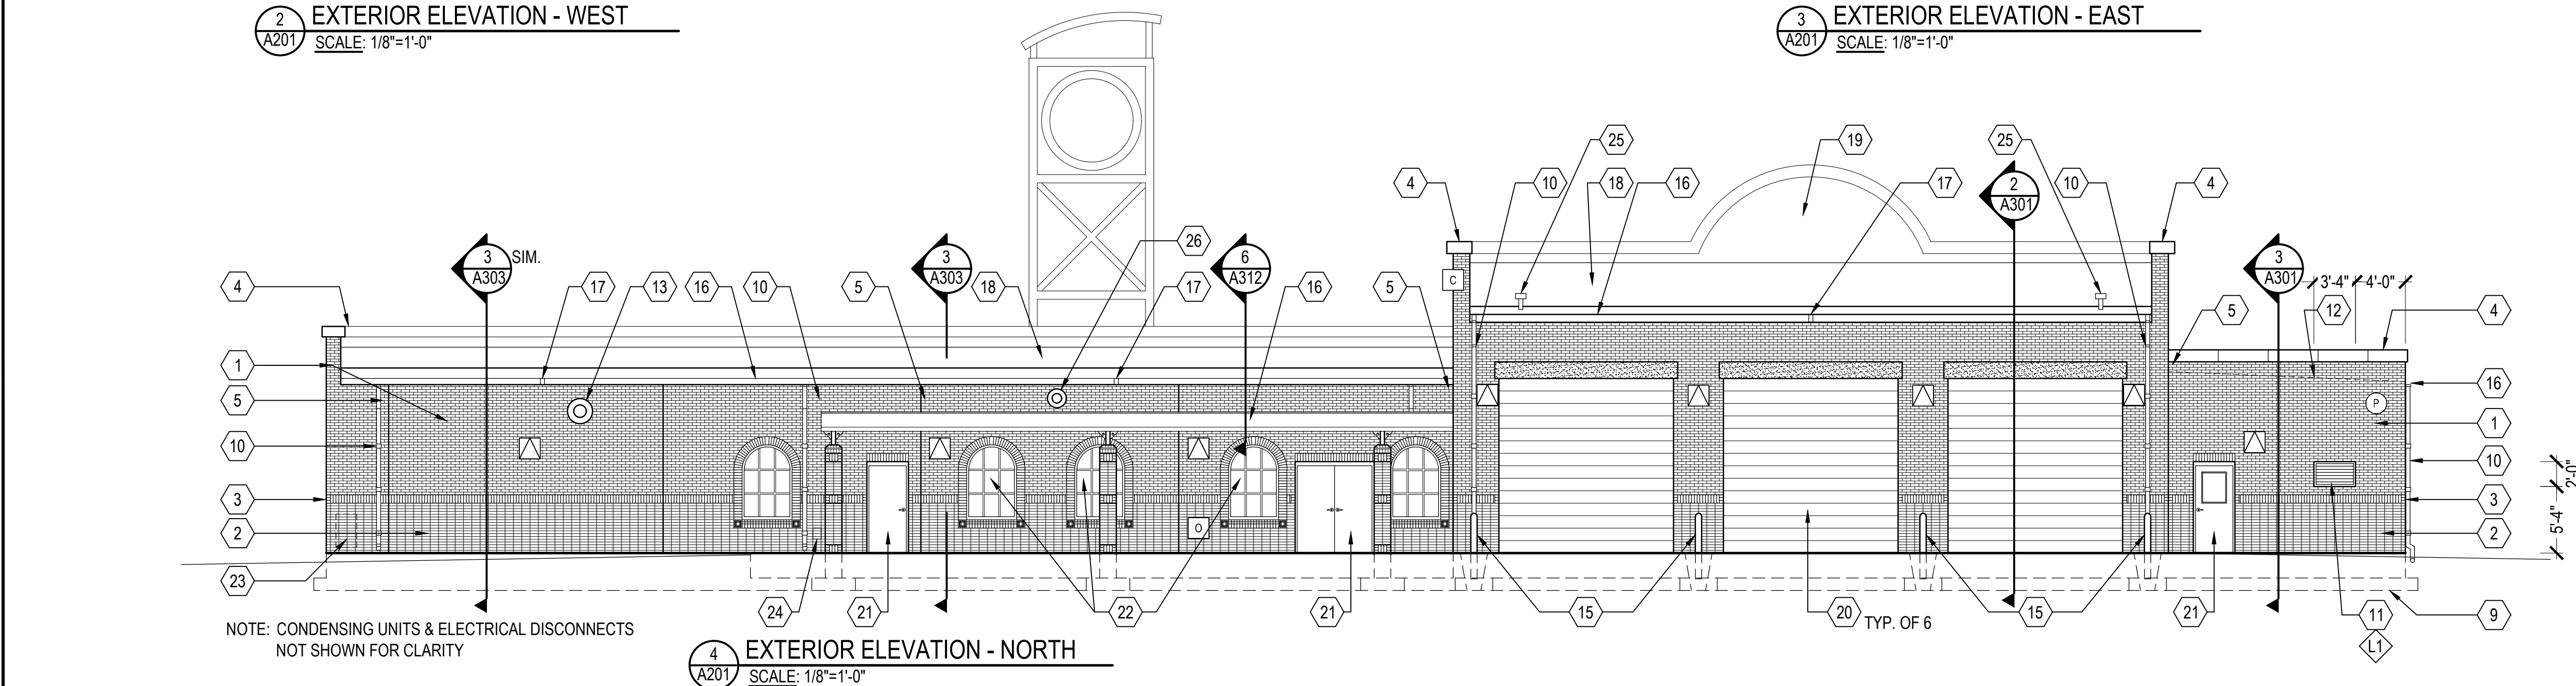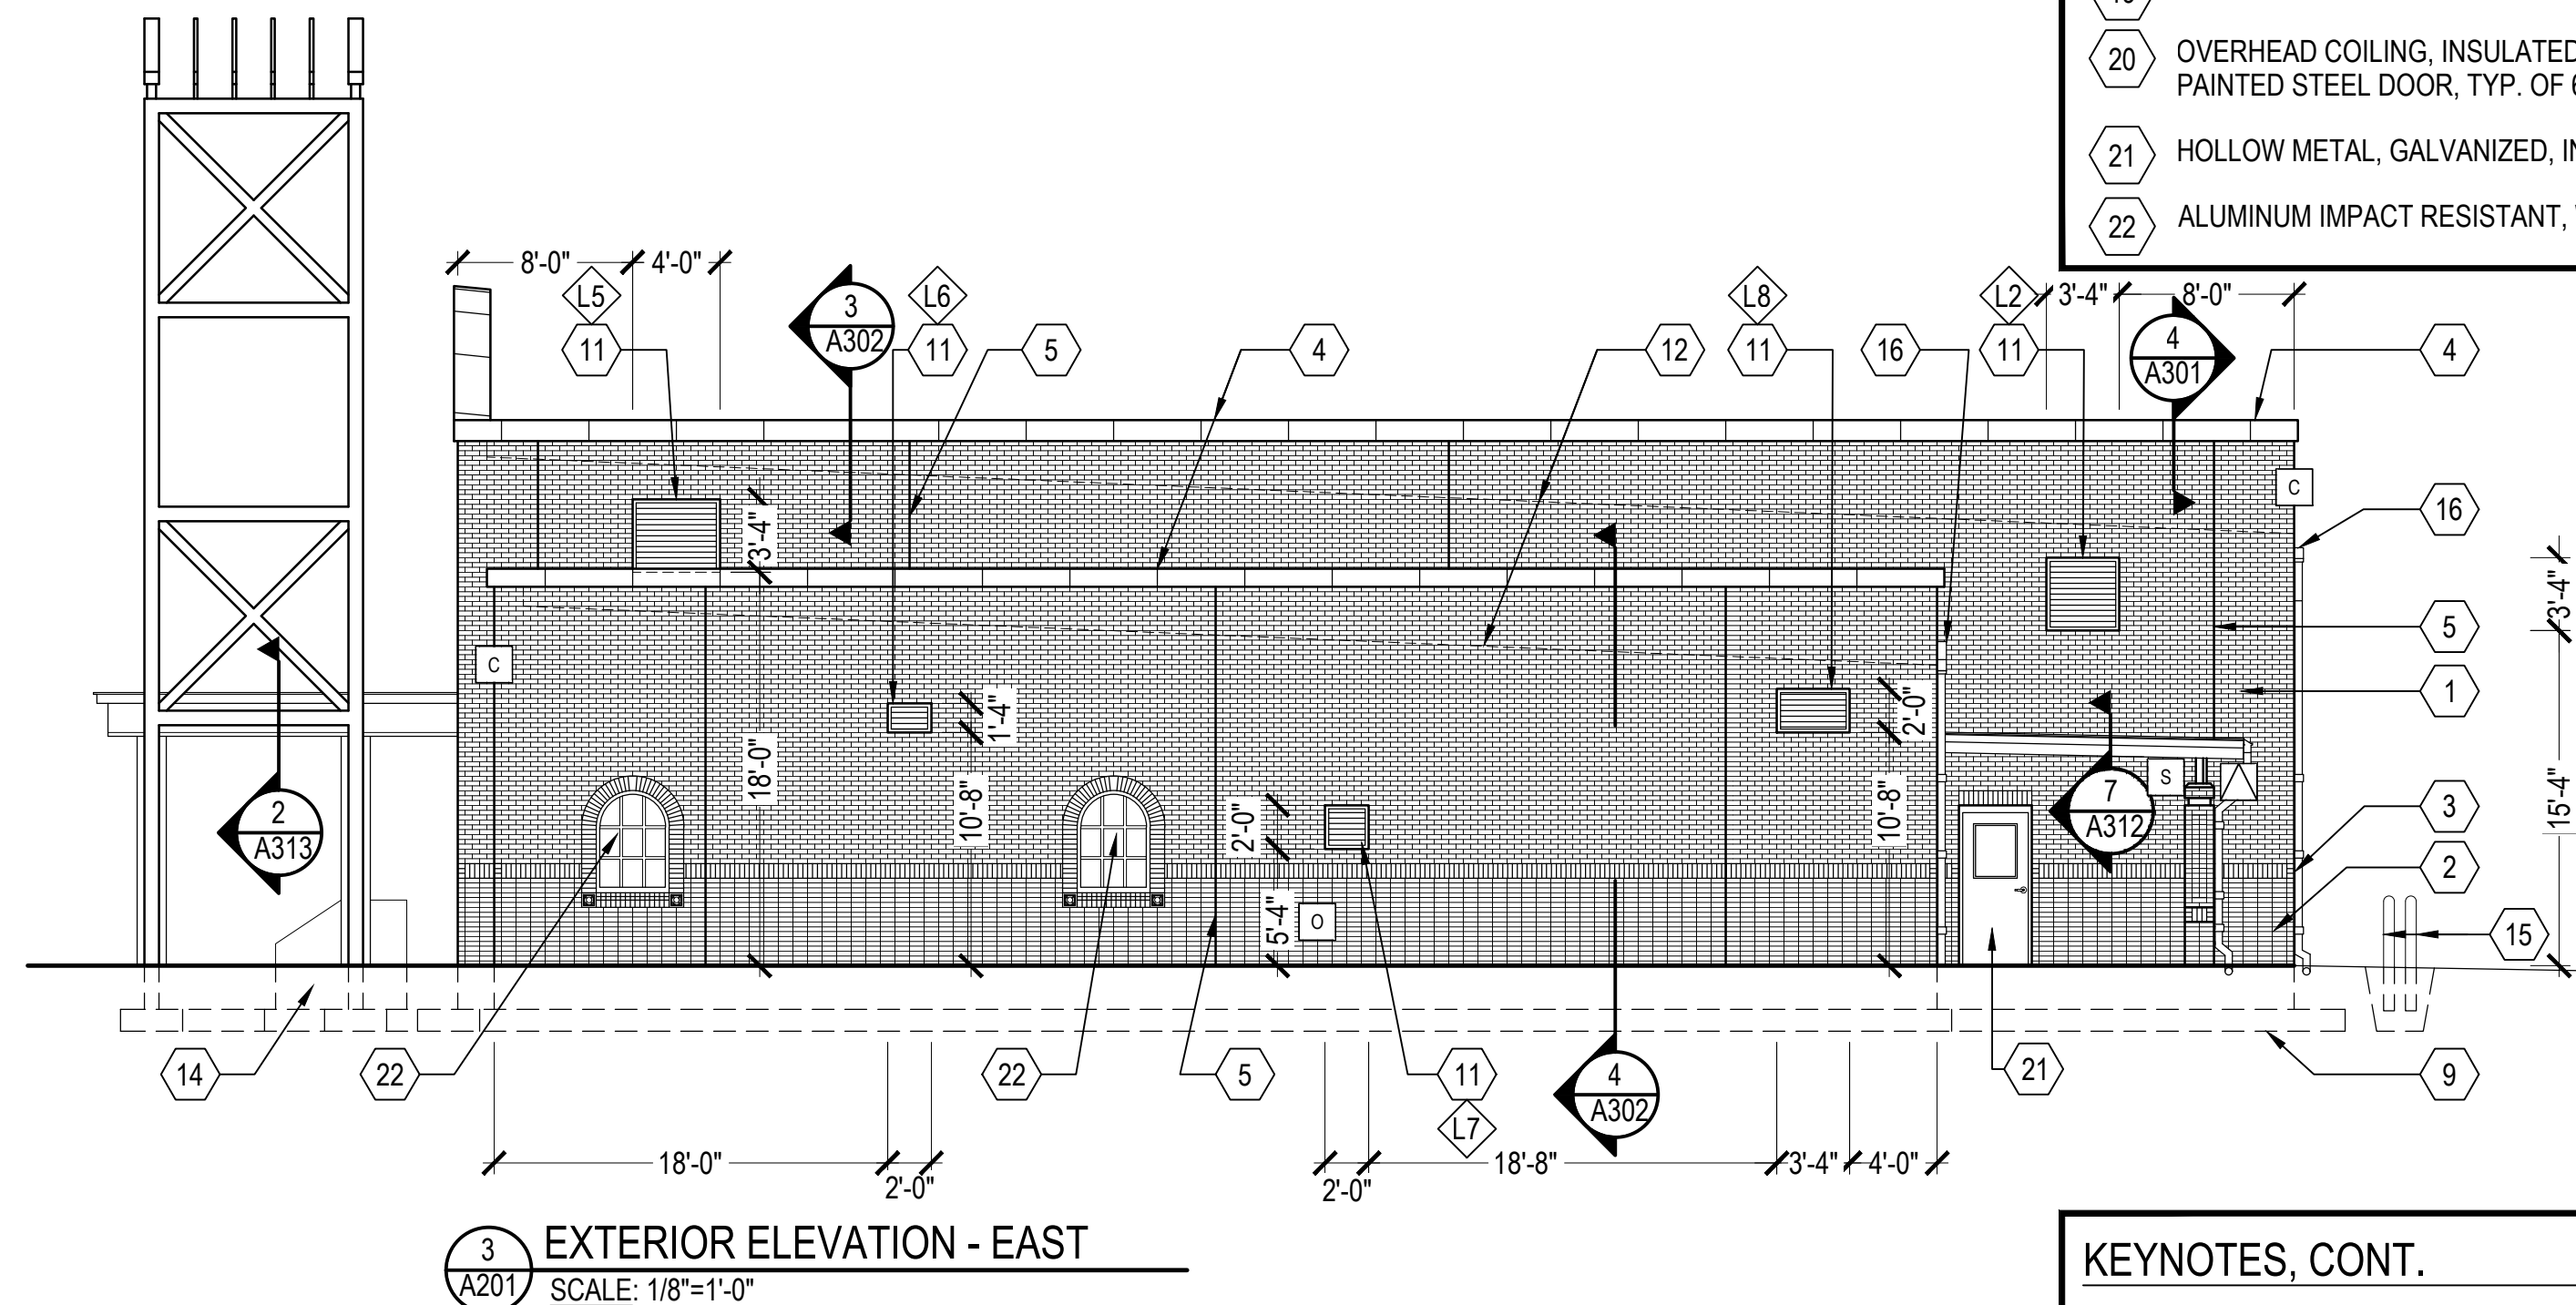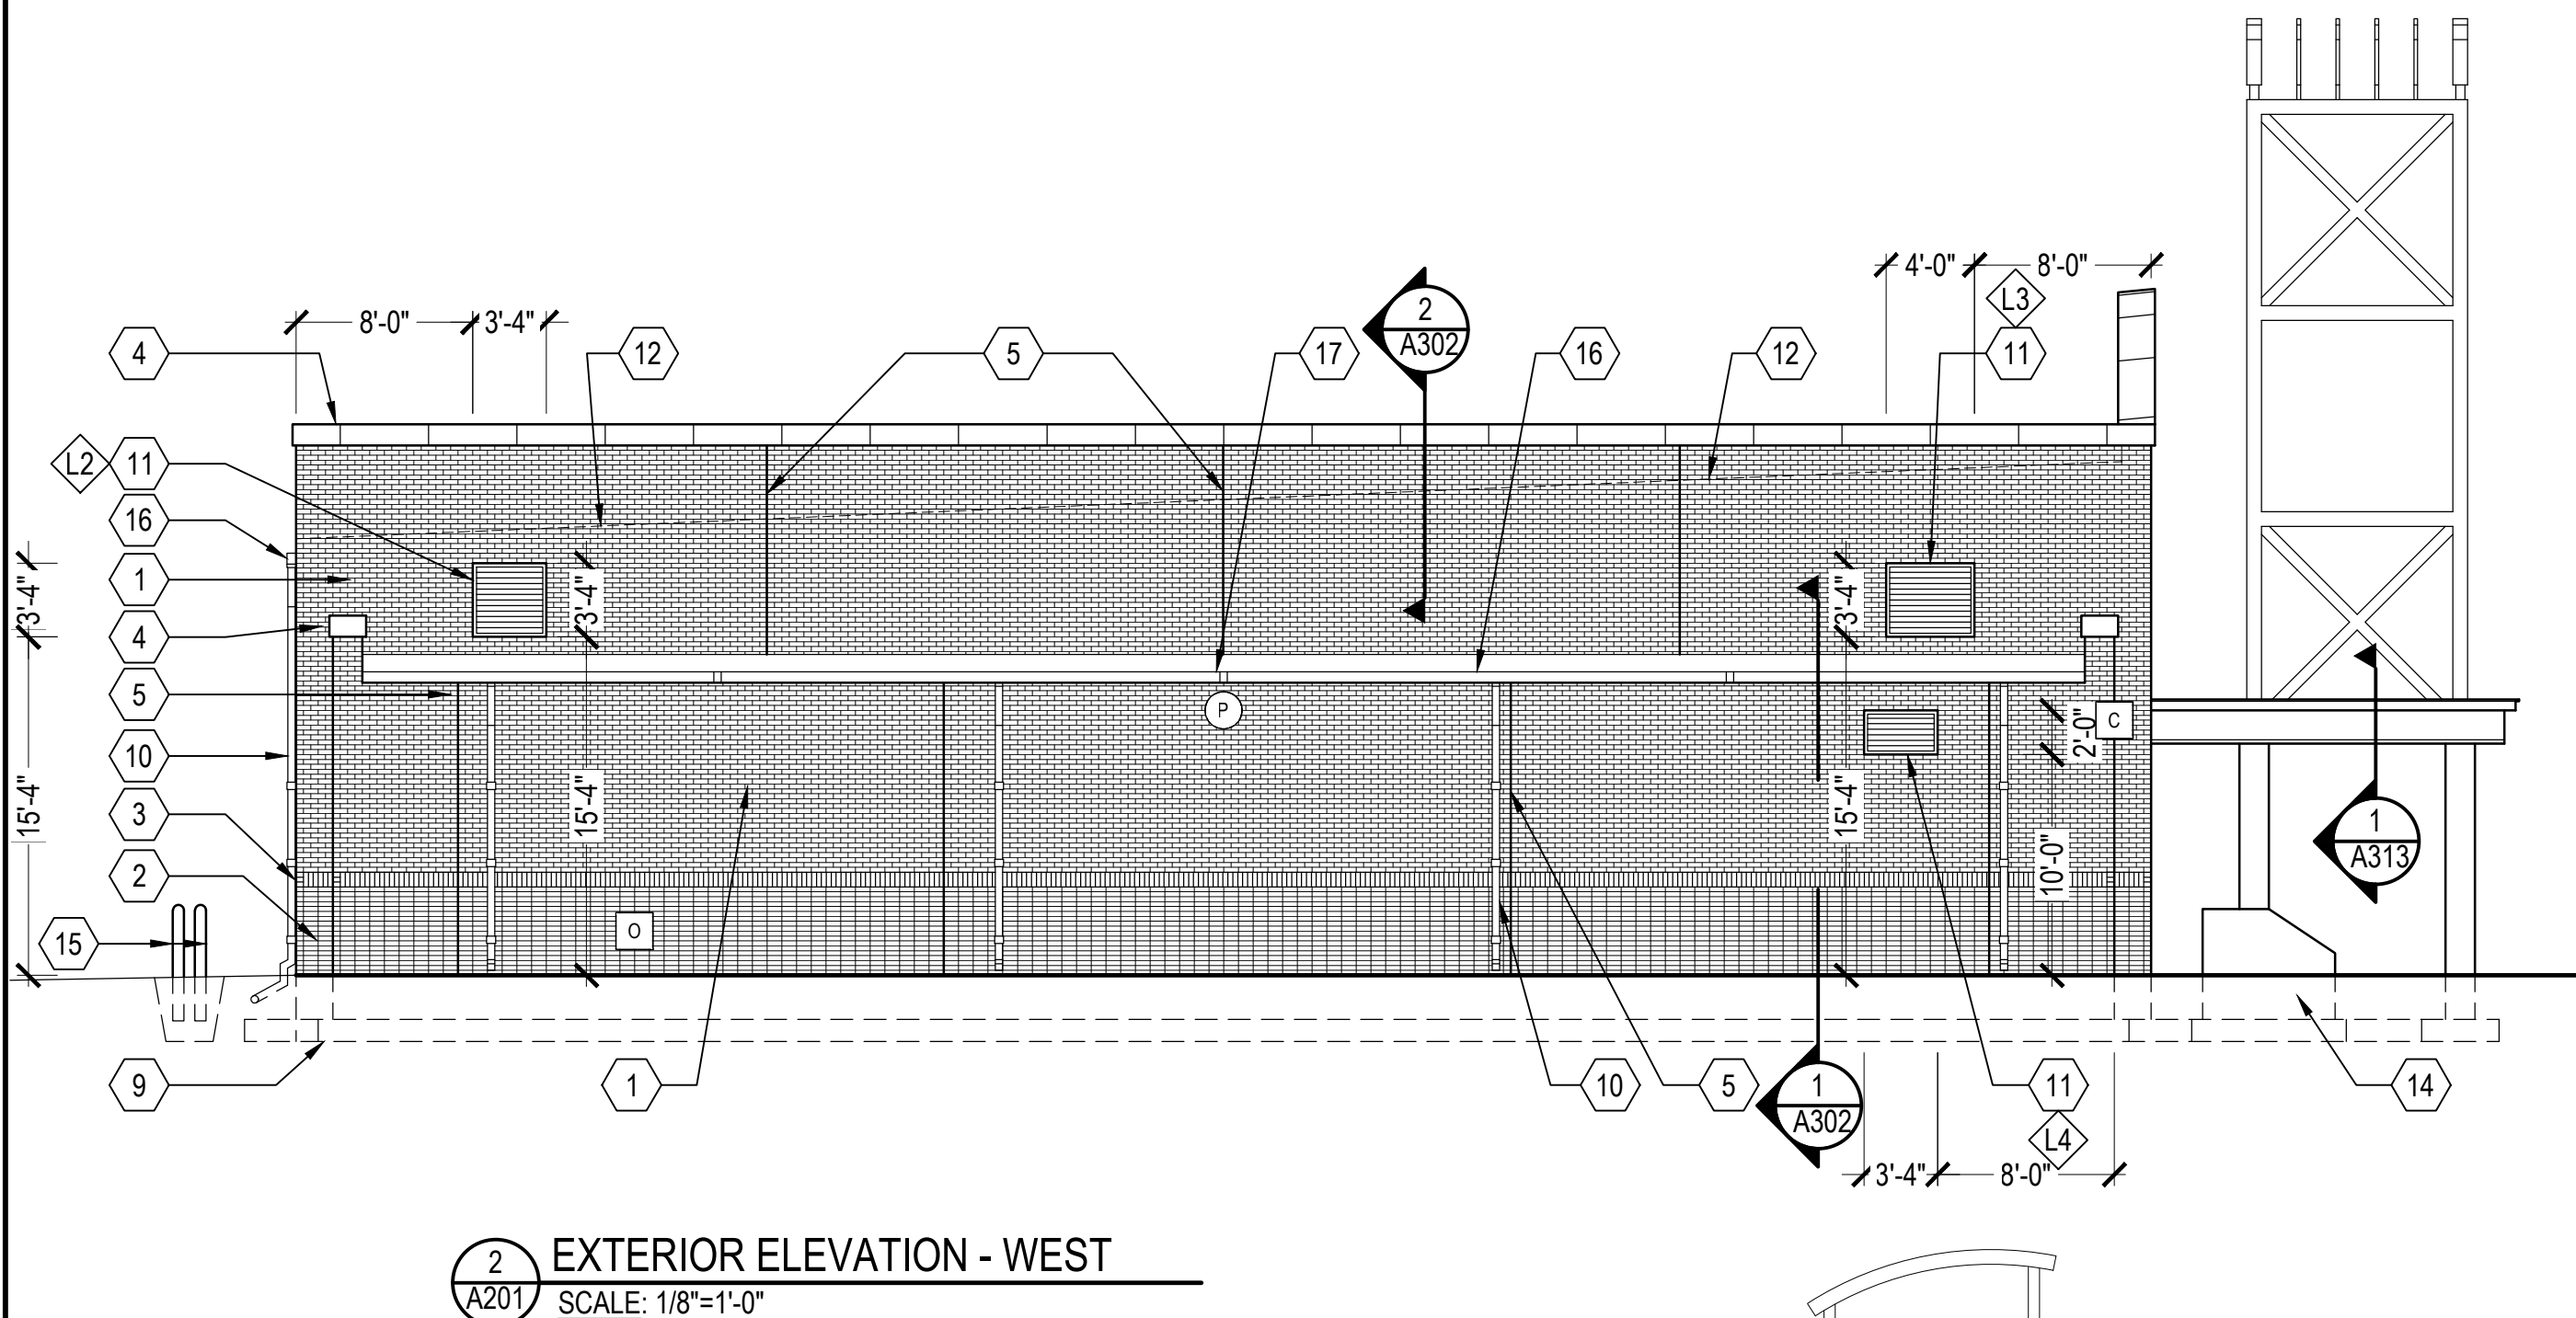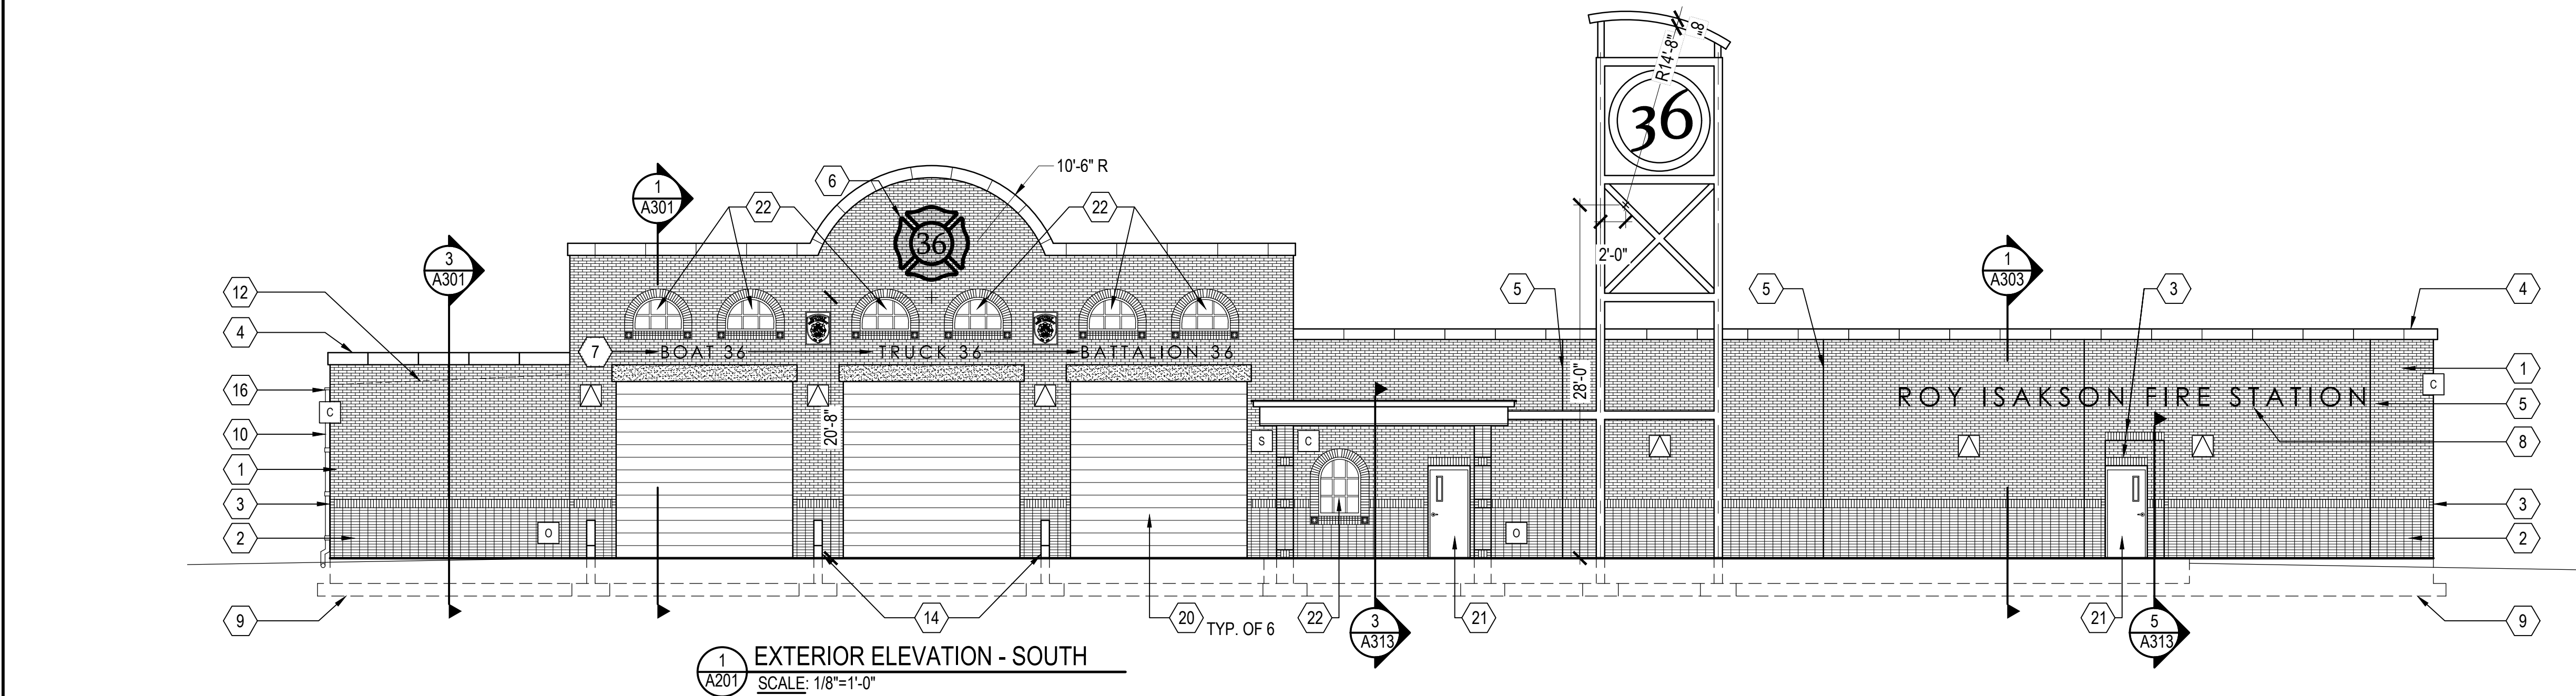


- KEYNOTES**
- FACE BRICK, RUNNING BOND.
 - FACE BRICK, STACK BOND.
 - FACE BRICK, SOLDIER COURSE.
 - PRECAST CONCRETE COPING.
 - WALL CONTROL JOINT, SEE DETAIL 8/A312.
 - POLISHED STAINLESS STEEL MEDALLION, SEE DETAIL 8/A313.
 - PREFINISHED, DIE CUT, ALUMINUM SURFACE-MOUNTED LETTERS, 12" HIGH.
 - PREFINISHED, DIE CUT, ALUMINUM SURFACE-MOUNTED LETTERS, 18" HIGH.
 - LINE OF FOUNDATION BELOW GRADE.
 - 4"x6" PREFINISHED 0.032 ALUMINUM DOWNSPOUT, TERMINATE AT CAST ALUMINUM SQUARE ROUND DOWNSPOUT BOOT, CONNECT TO UNDERGROUND STORM WATER DRAINAGE SYSTEM. PROVIDE MIN. 3 WALL BRACKET EACH
 - LOUVER, SEE MECHANICAL.
 - LINE OF ROOF BEYOND.
 - KITCHEN EXHAUST FAN.
 - CONCRETE BOLLARD, SEE DETAILS A/A001 & B/A001.
 - 6" DIA. CONCRETE FILLED, STEEL PIPE BOLLARDS, WITH PVC REFLECTIVE COVER, SEE DETAIL D/A001.
 - 8"x6"x4" PREFINISHED 0.032 ALUMINUM GUTTER WITH SUPPORT BRACKETS AT 4'-0" O.C.
 - GUTTER EXPANSION JOINT.
 - 60 MIL FLEECE FULLY ADHERED PVC ROOF MEMBRANE.
 - 48 MIL FULLY ADHERED PVC PARAPET MEMBRANE.
 - OVERHEAD COILING, INSULATED, WIND & IMPACT RATED, GALVANIZED, PAINTED STEEL DOOR, TYP. OF 6.
 - HOLLOW METAL, GALVANIZED, INSULATED, DOOR & FRAME, PAINT.
 - ALUMINUM IMPACT RESISTANT, WIND RATED, INSULATED FIXED WINDOWS.

- KEYNOTES, CONT.**
- GAS METER & REGULATOR, SEE PLUMBING.
 - GAS QUICK DISCONNECT, SEE PLUMBING.
 - ROOF VENT CAP, SEE MECHANICAL.
 - WALL VENT CAP, SEE MECHANICAL.


- LEGEND**
- FROST PROOF KEYED HOSE BIBB, SEE MECHANICAL.
 - EXTERIOR SPEAKER, SEE ELECTRICAL.
 - EXTERIOR WALL PACK LIGHTING FIXTURE, SEE ELECTRICAL.
 - PHOTOCELL, SEE ELECTRICAL.
 - EXTERIOR WALL MOUNTED CAMERA, SEE TELECOM/DATA

ELEVATIONS


**MIDWAY FIRE DISTRICT
FIRE STATION # 36**
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

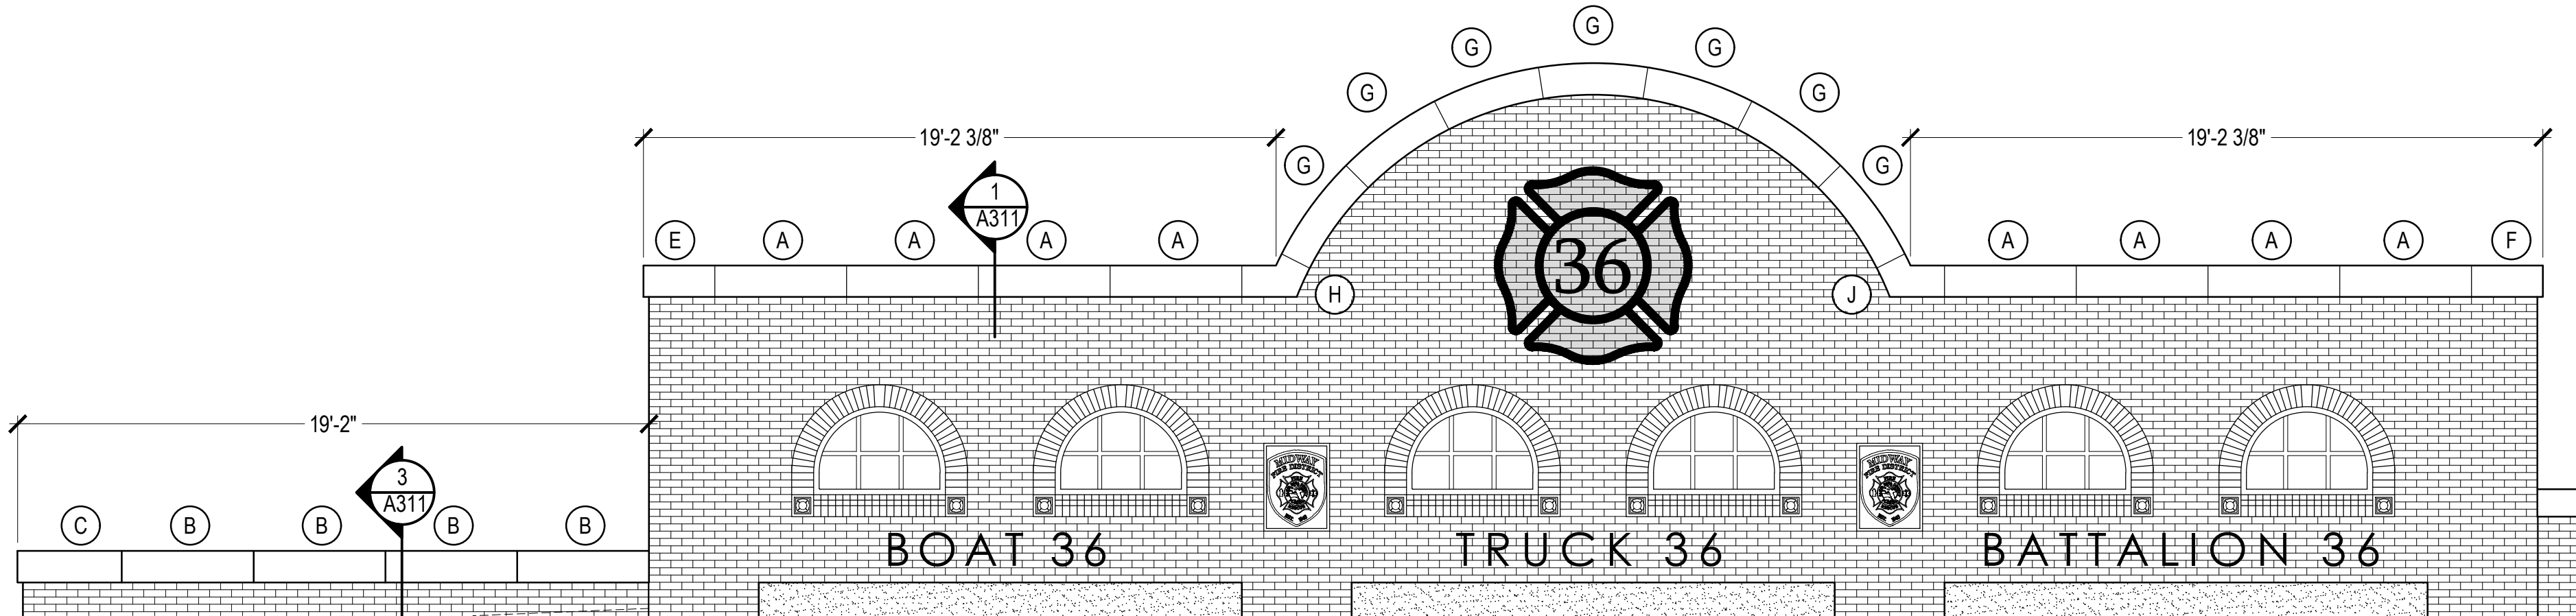


1 CAST STONE ELEVATION
SCALE: 1/4"=1'-0"

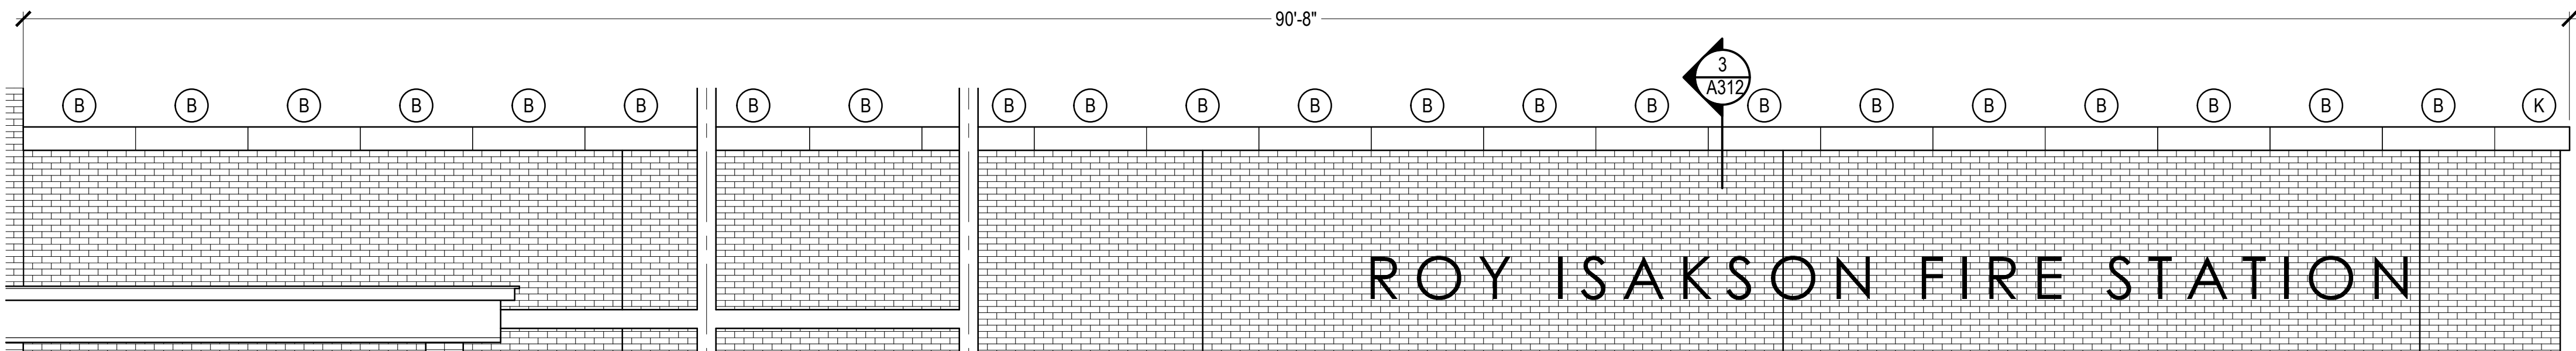


2 CAST STONE ELEVATION
SCALE: 1/4"=1'-0"

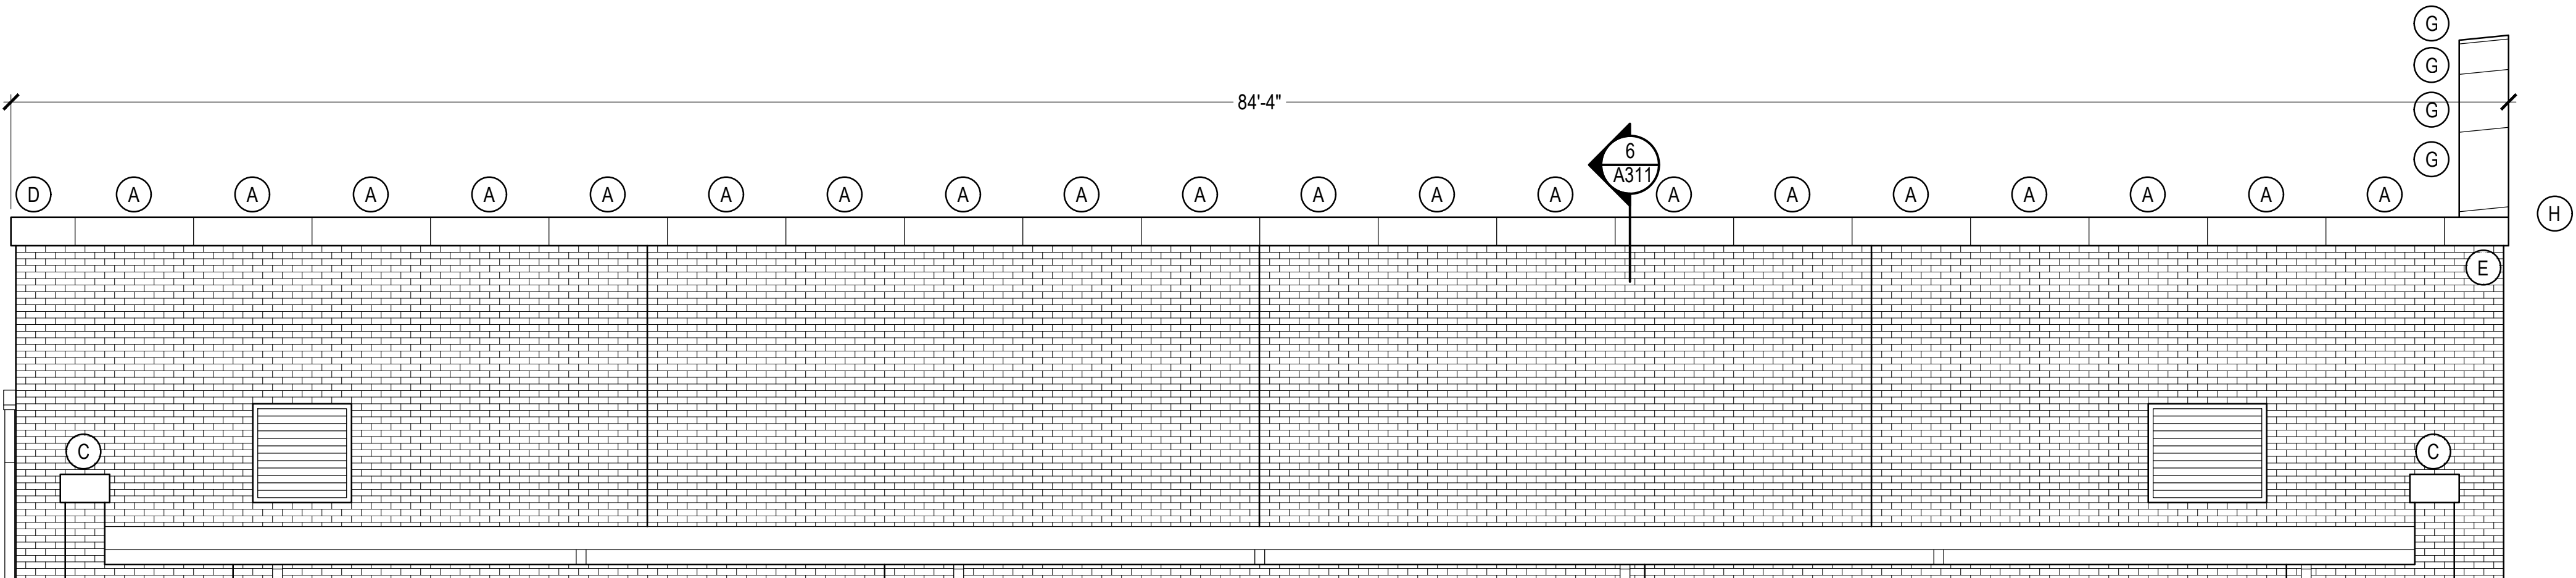

3 CAST STONE ELEVATION
SCALE: 1/4"=1'-0"

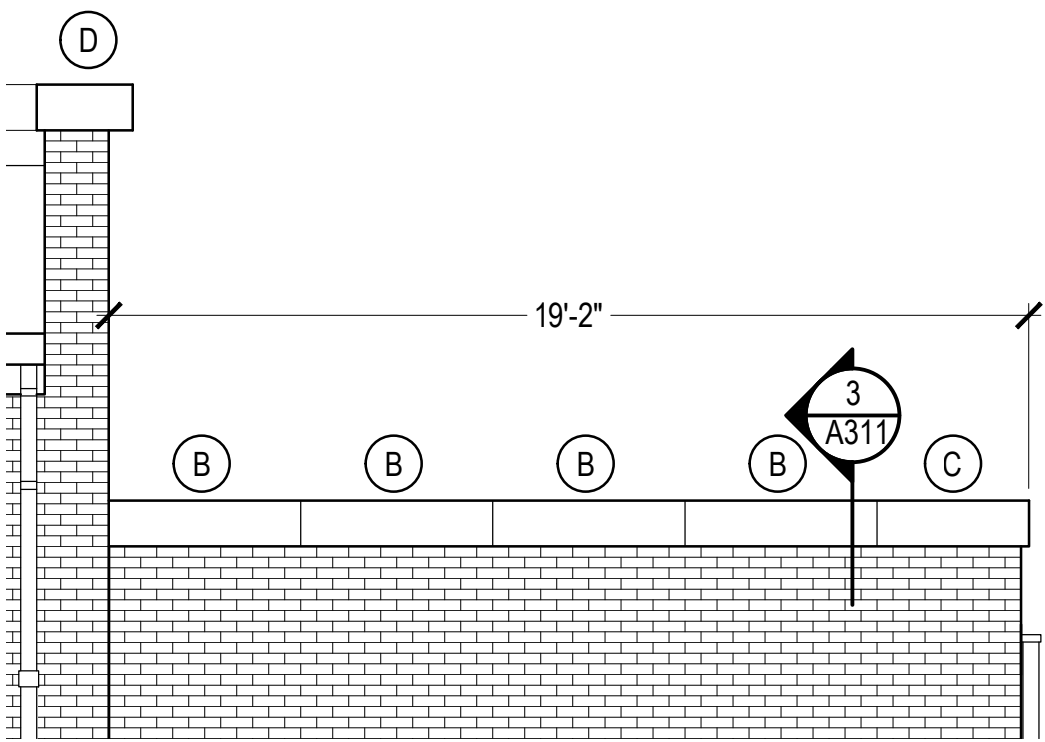

4 CAST STONE ELEVATION
SCALE: 1/4"=1'-0"

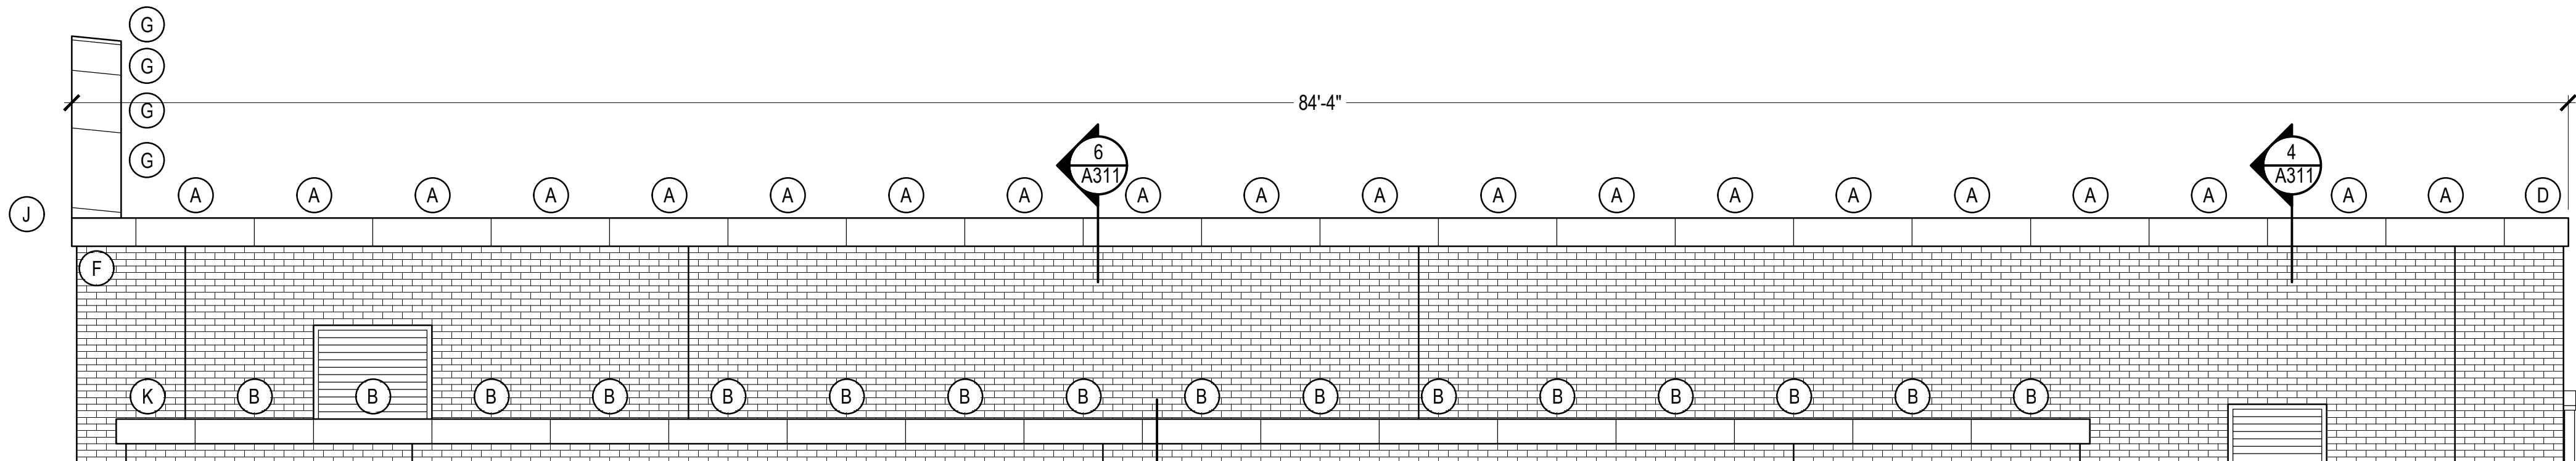

5 CAST STONE ELEVATION
SCALE: 1/4"=1'-0"


MASONRY
ELEVATIONS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:


A321
SHEET #

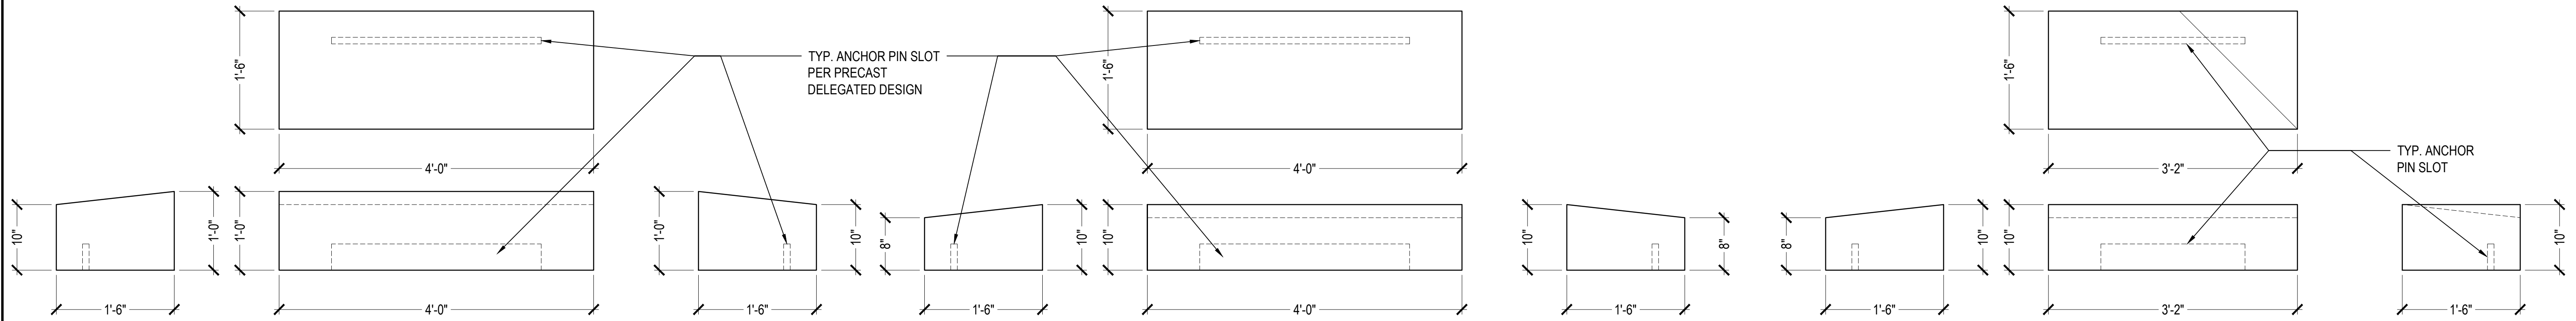


A CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

B CAST STONE ELEVATIONS
SCALE: 1"=1'-0"


C CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

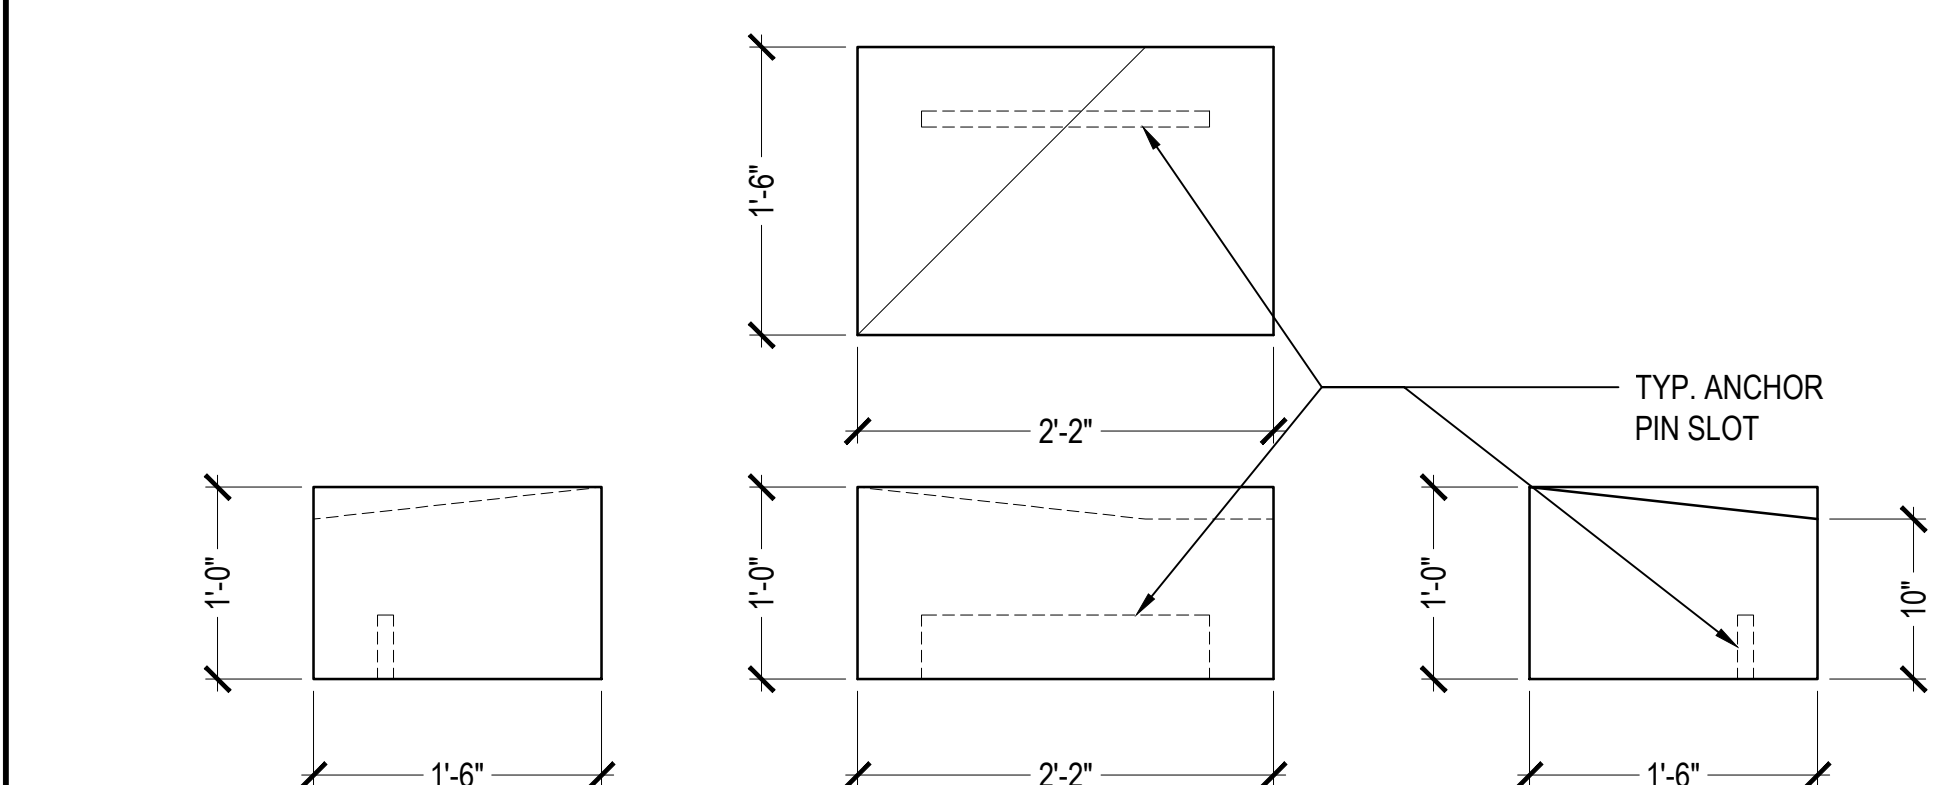


D CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

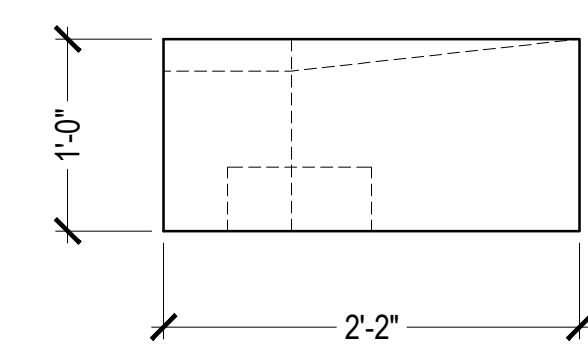


E CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

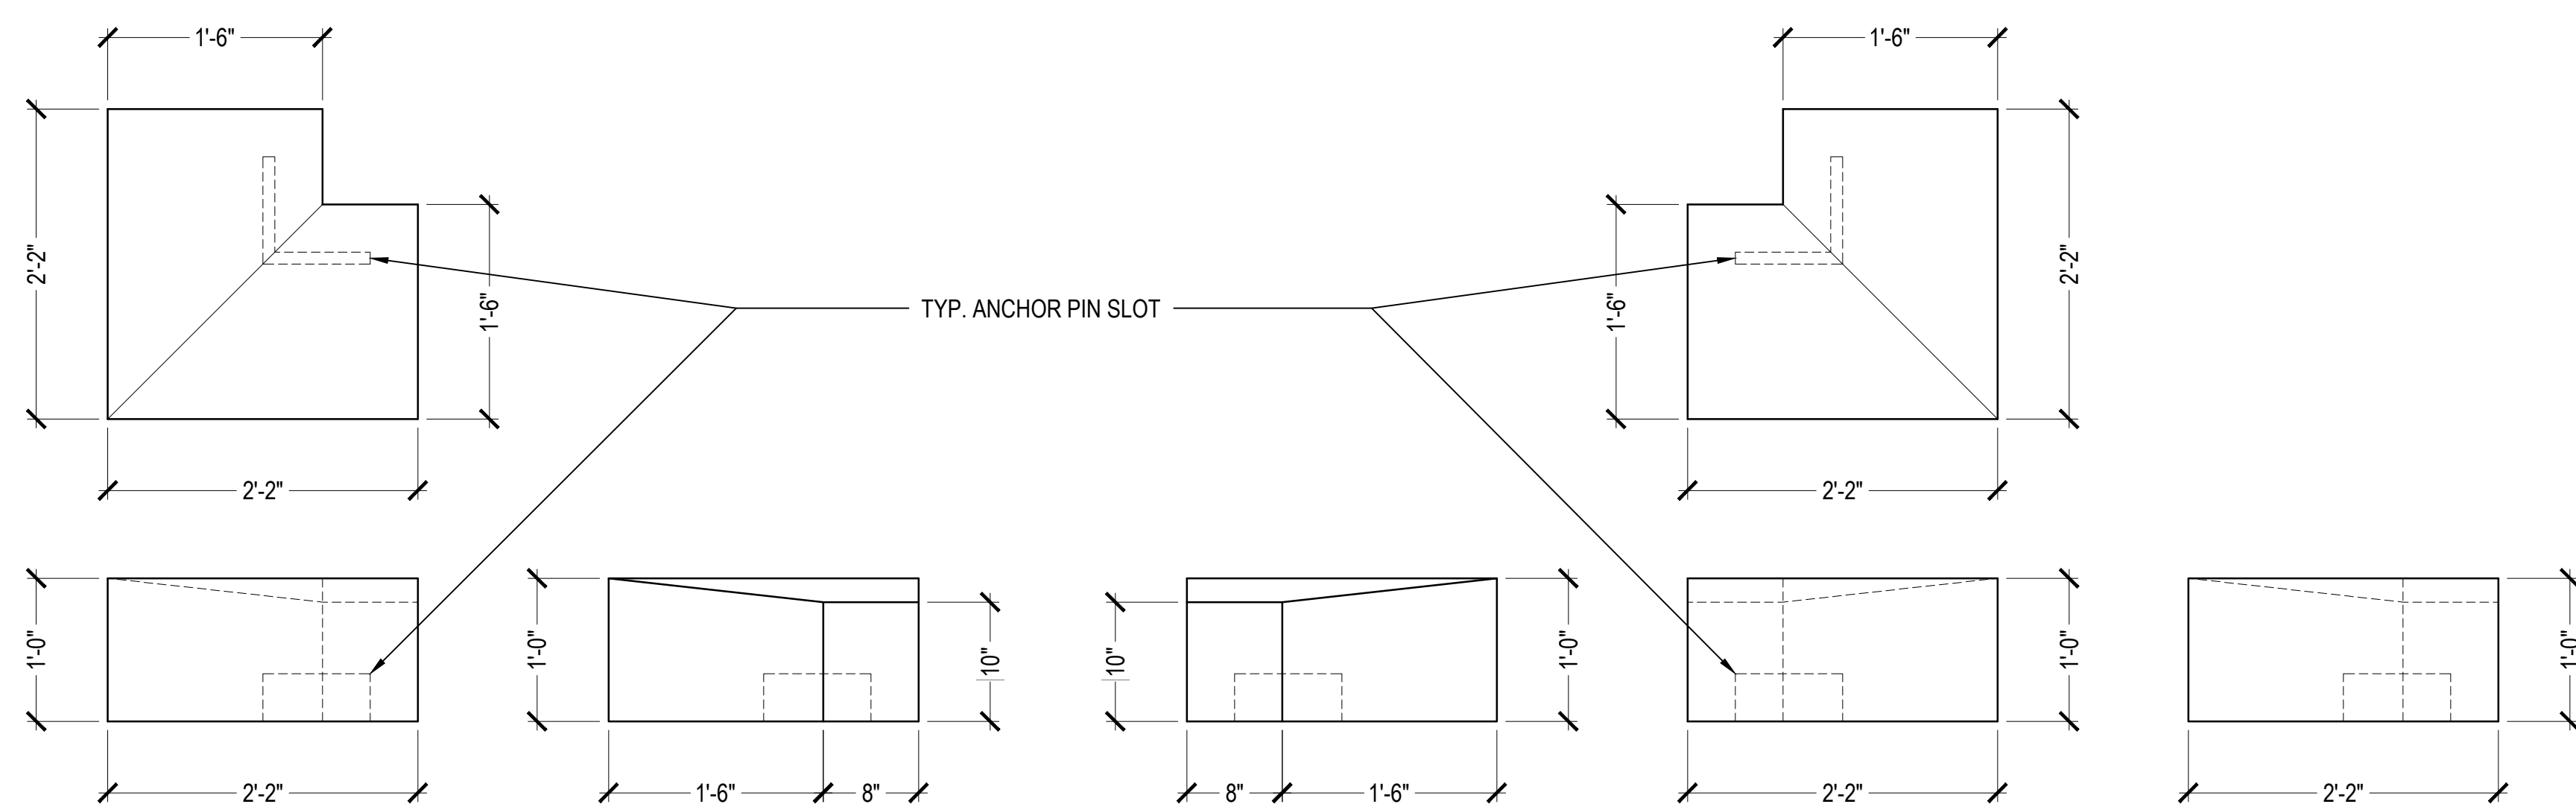


F CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

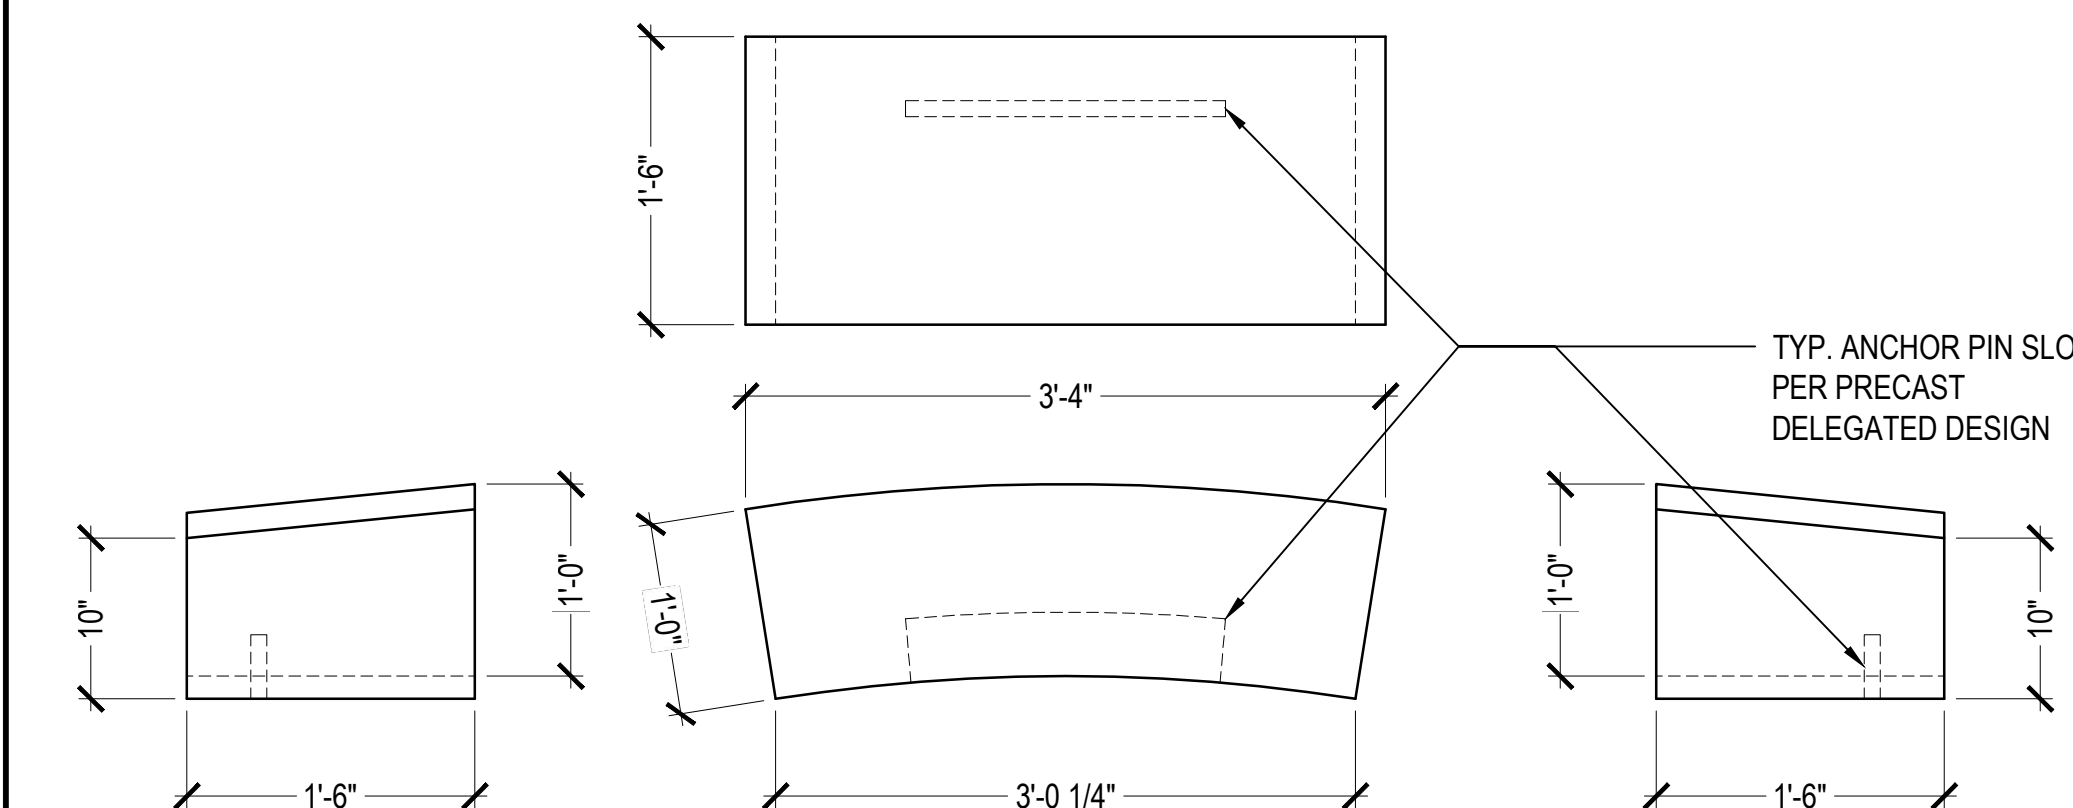


G CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

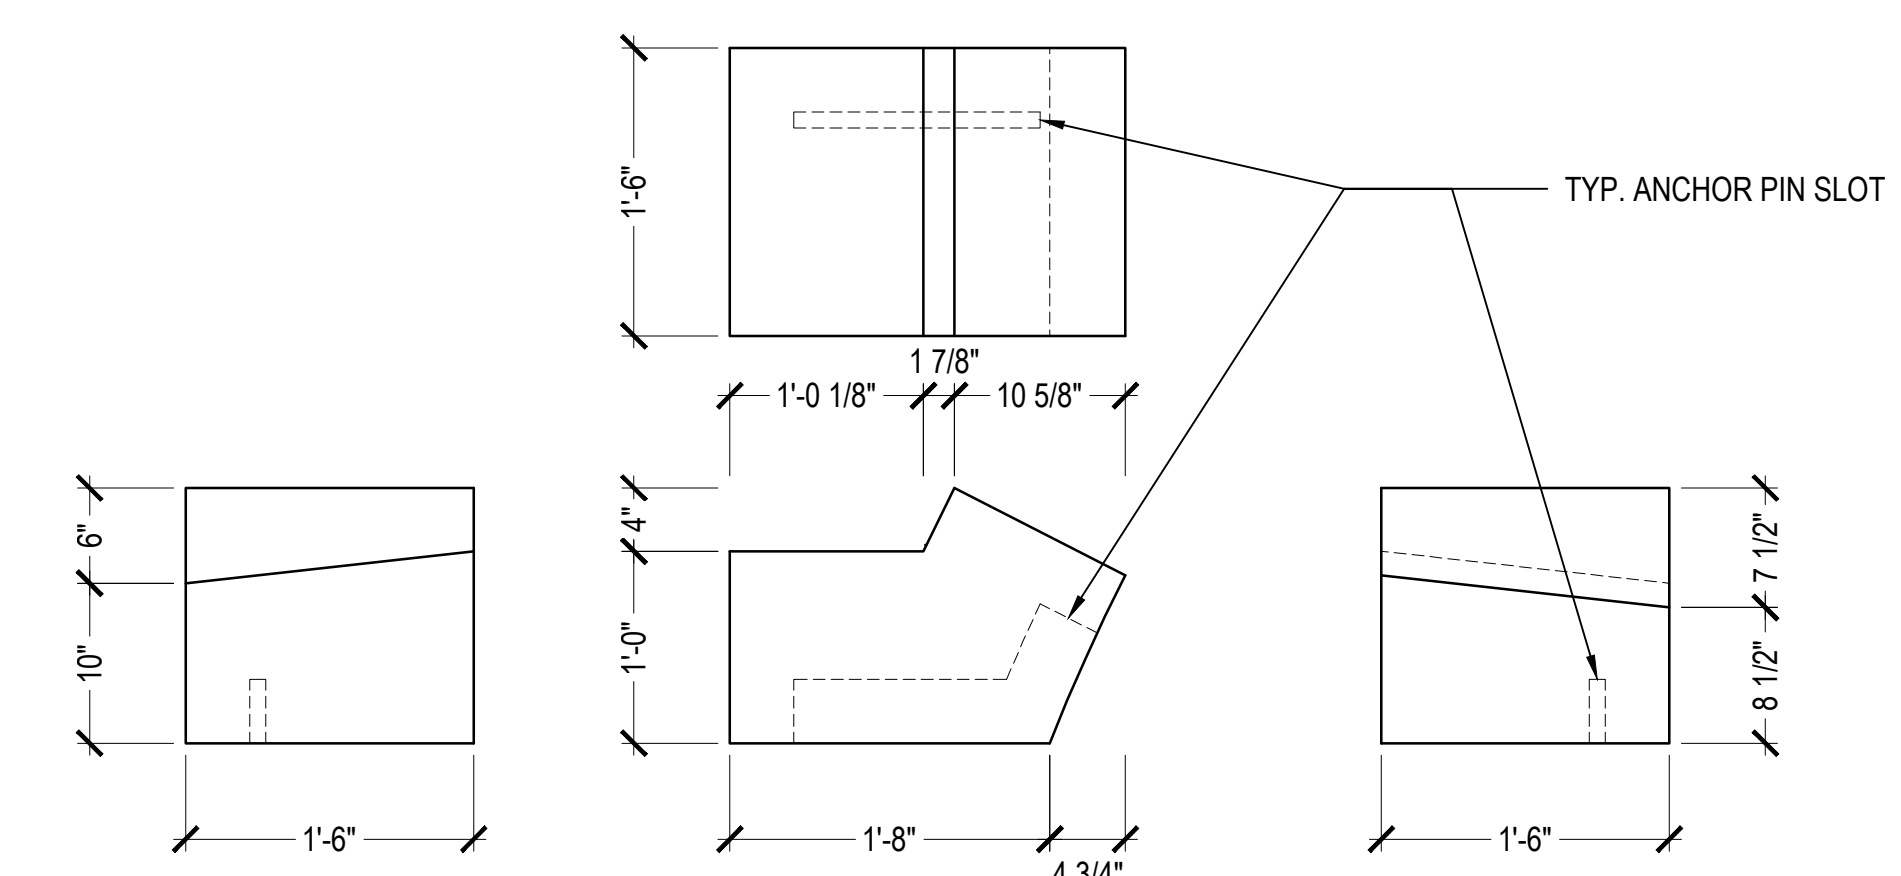

H CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

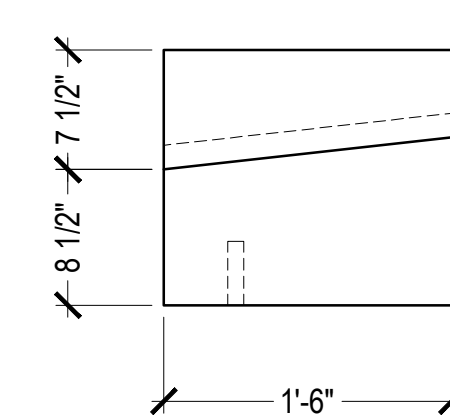

J CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

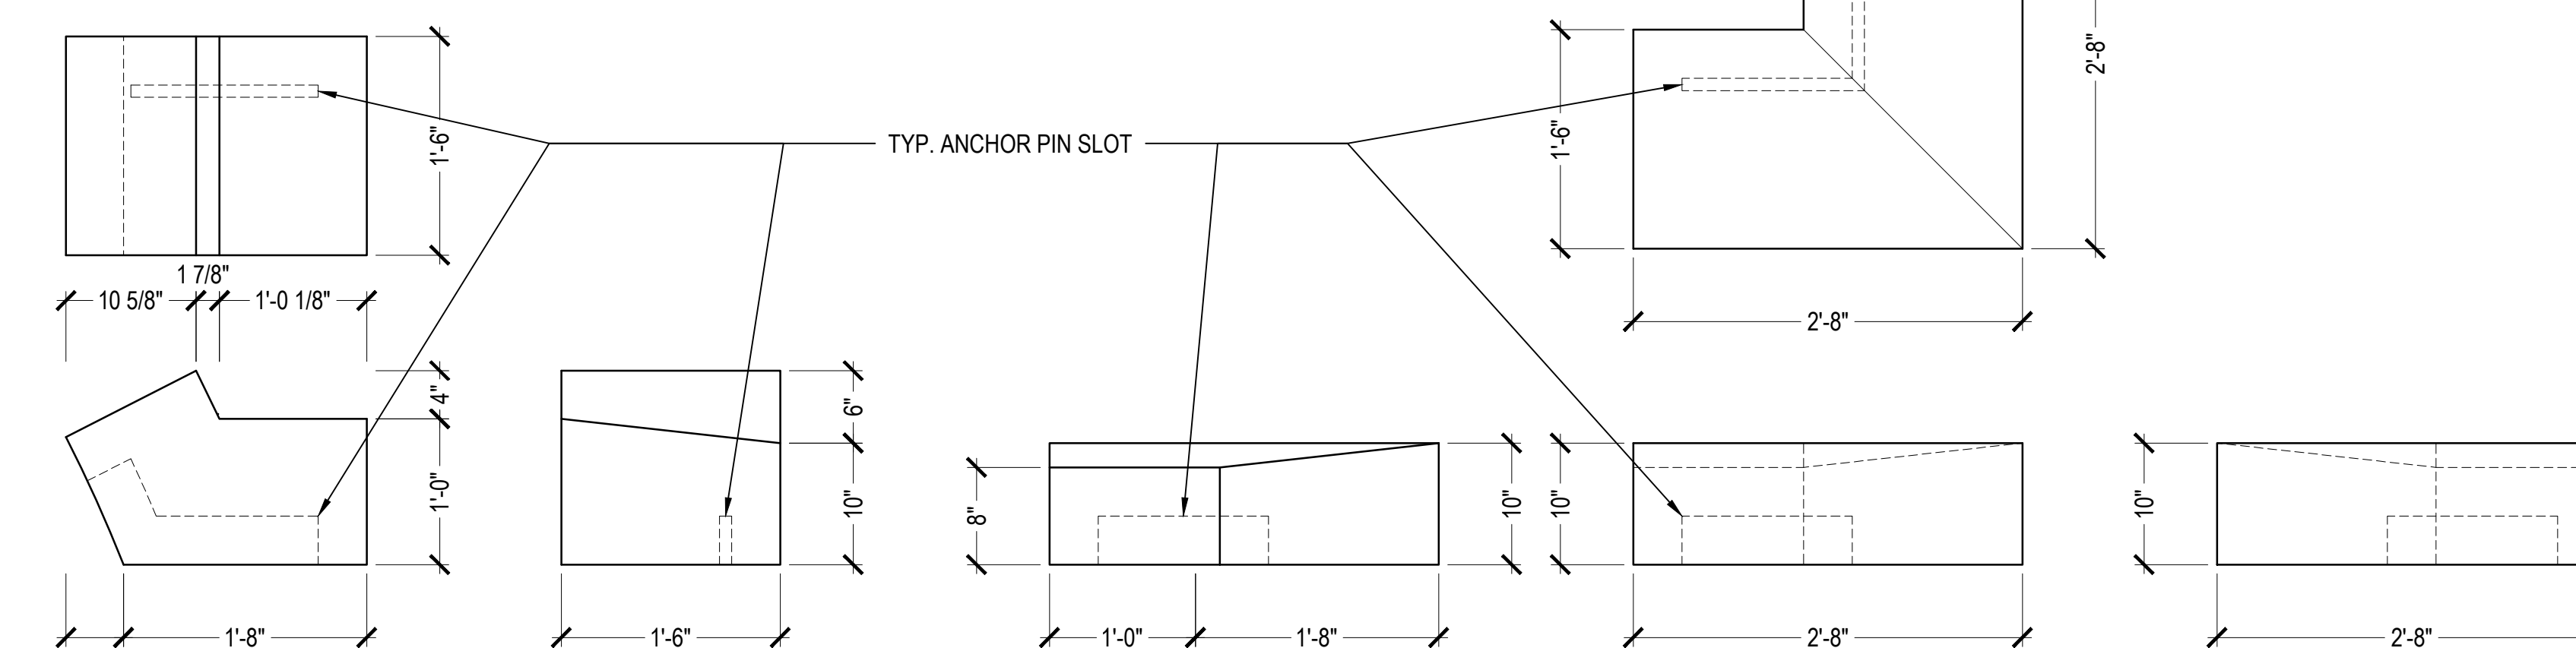


K CAST STONE ELEVATIONS
SCALE: 1"=1'-0"

CAST STONE ELEVATIONS


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	


Scale: AS NOTED
Date: 04-03-2024
Drawn: Checked:

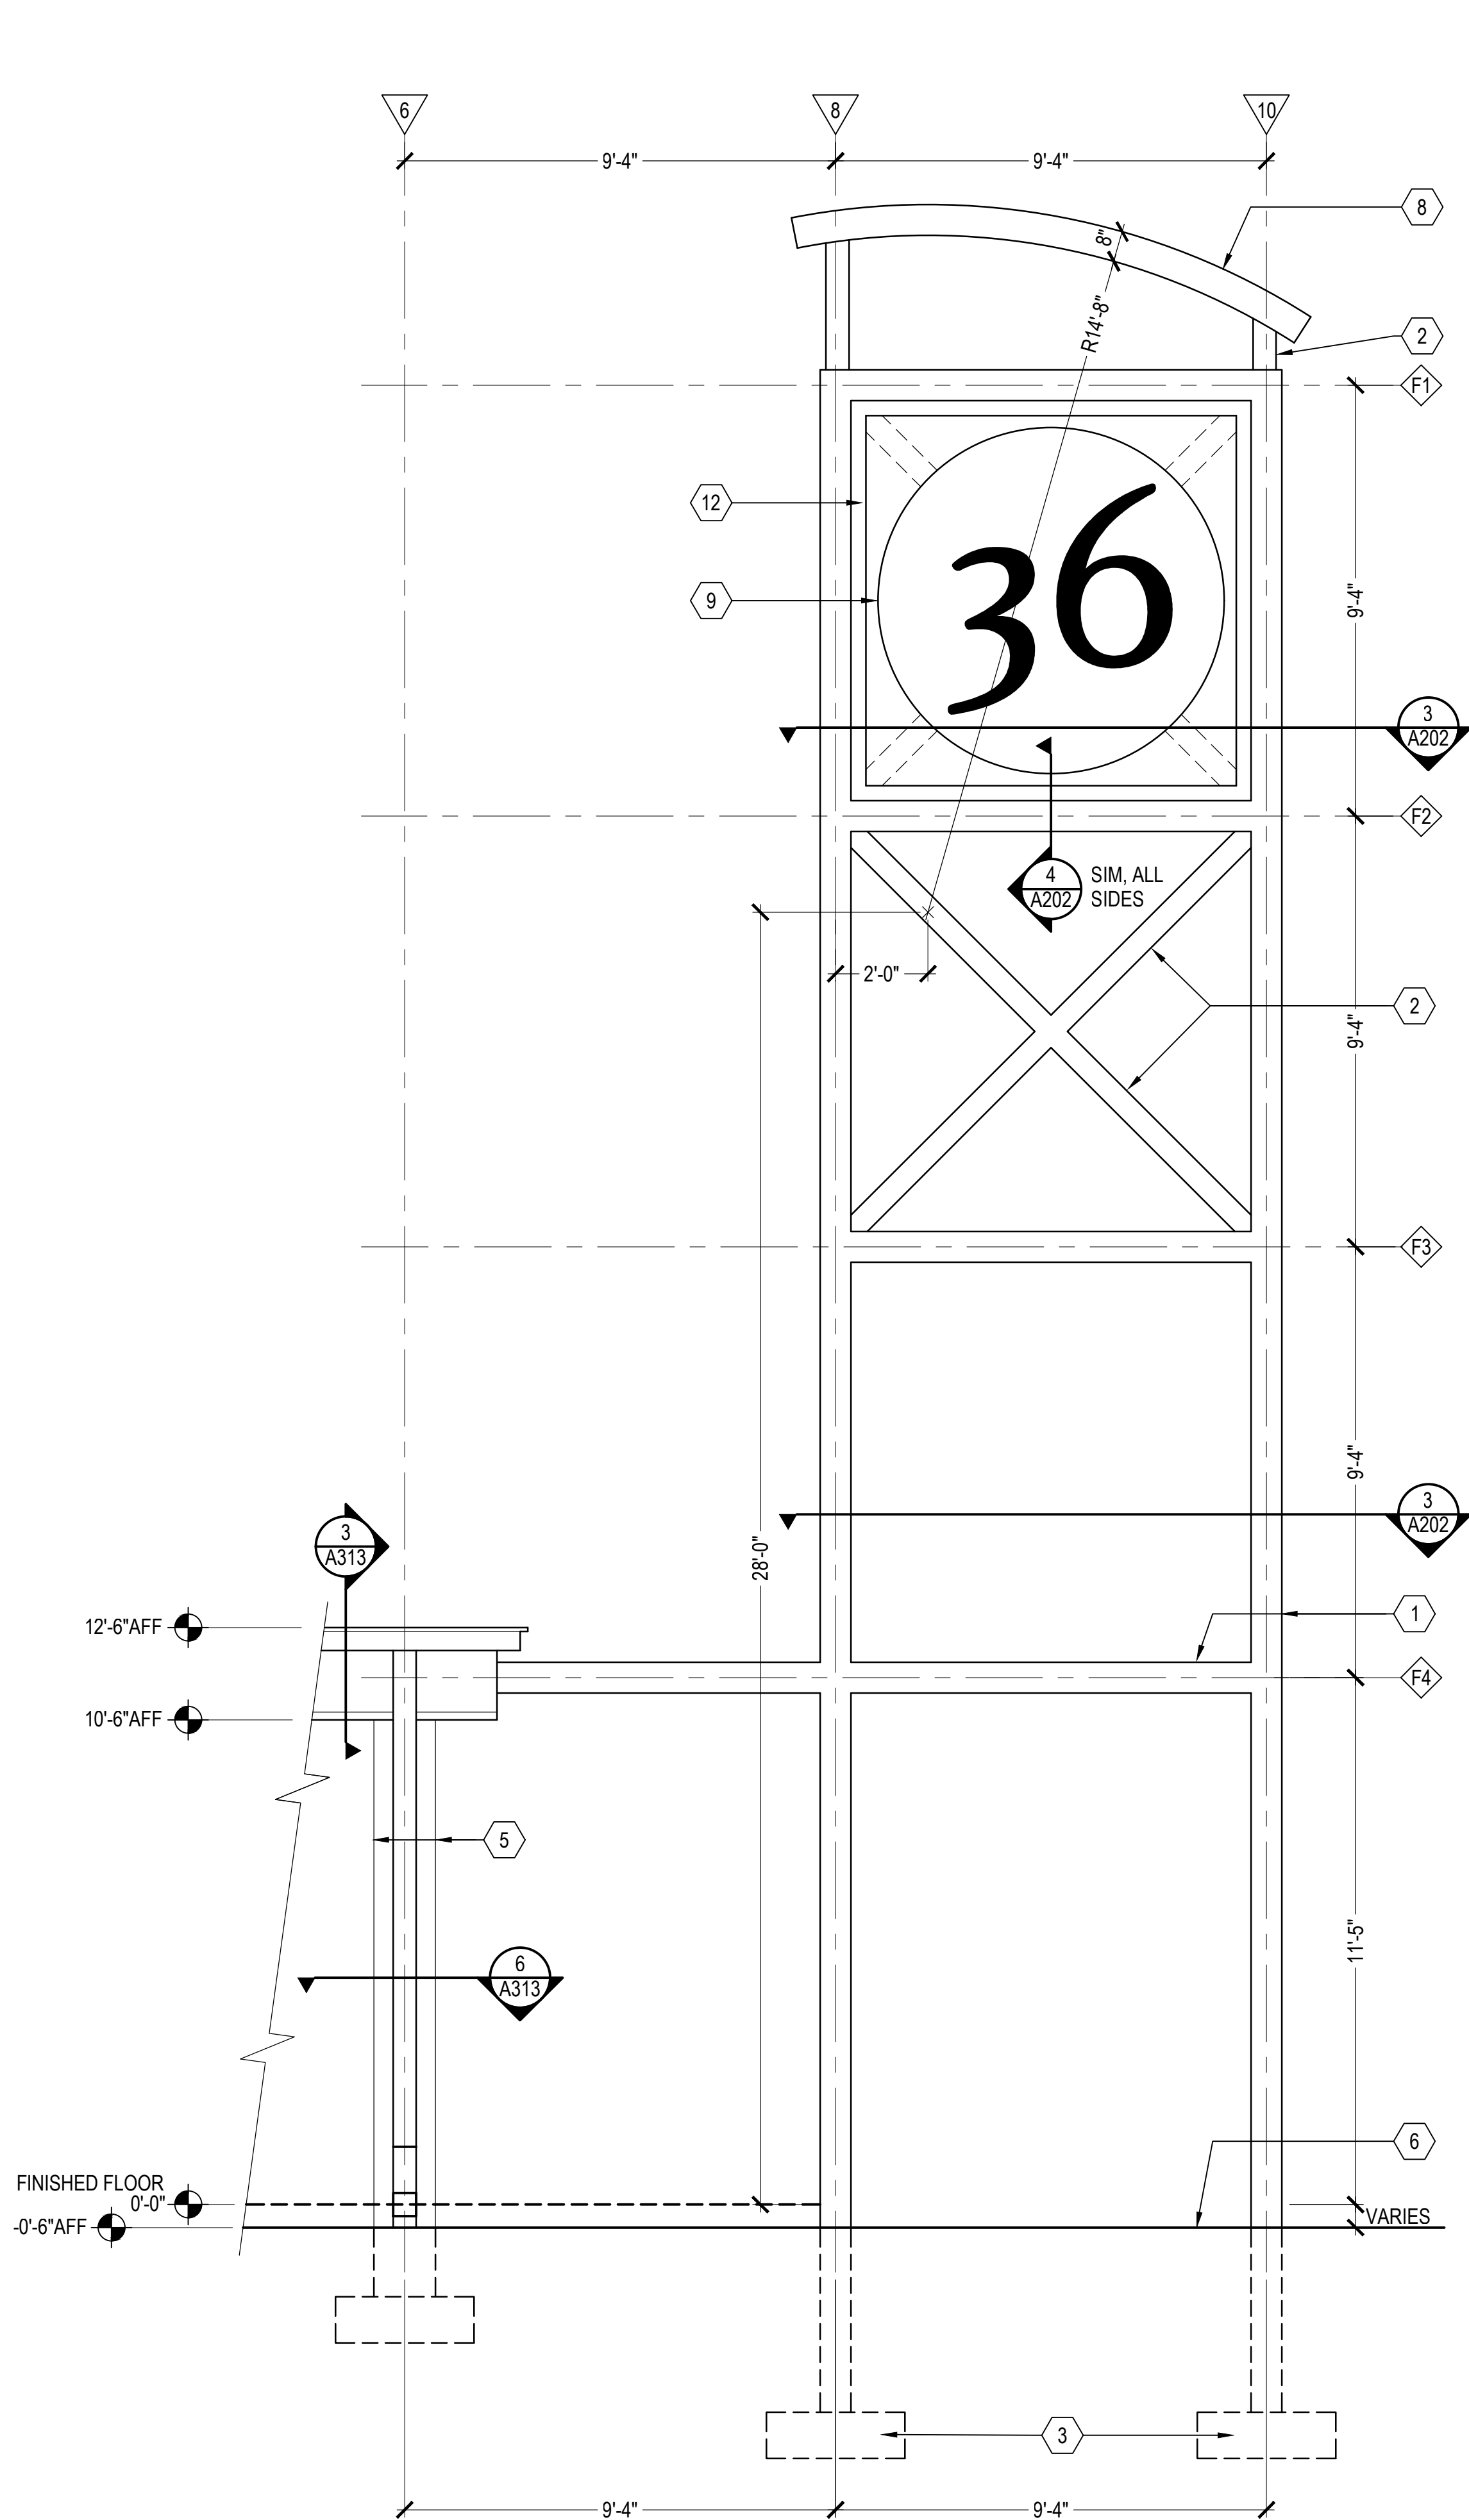


1 TOWER DETAIL
SCALE: 3/8"=1'-0"

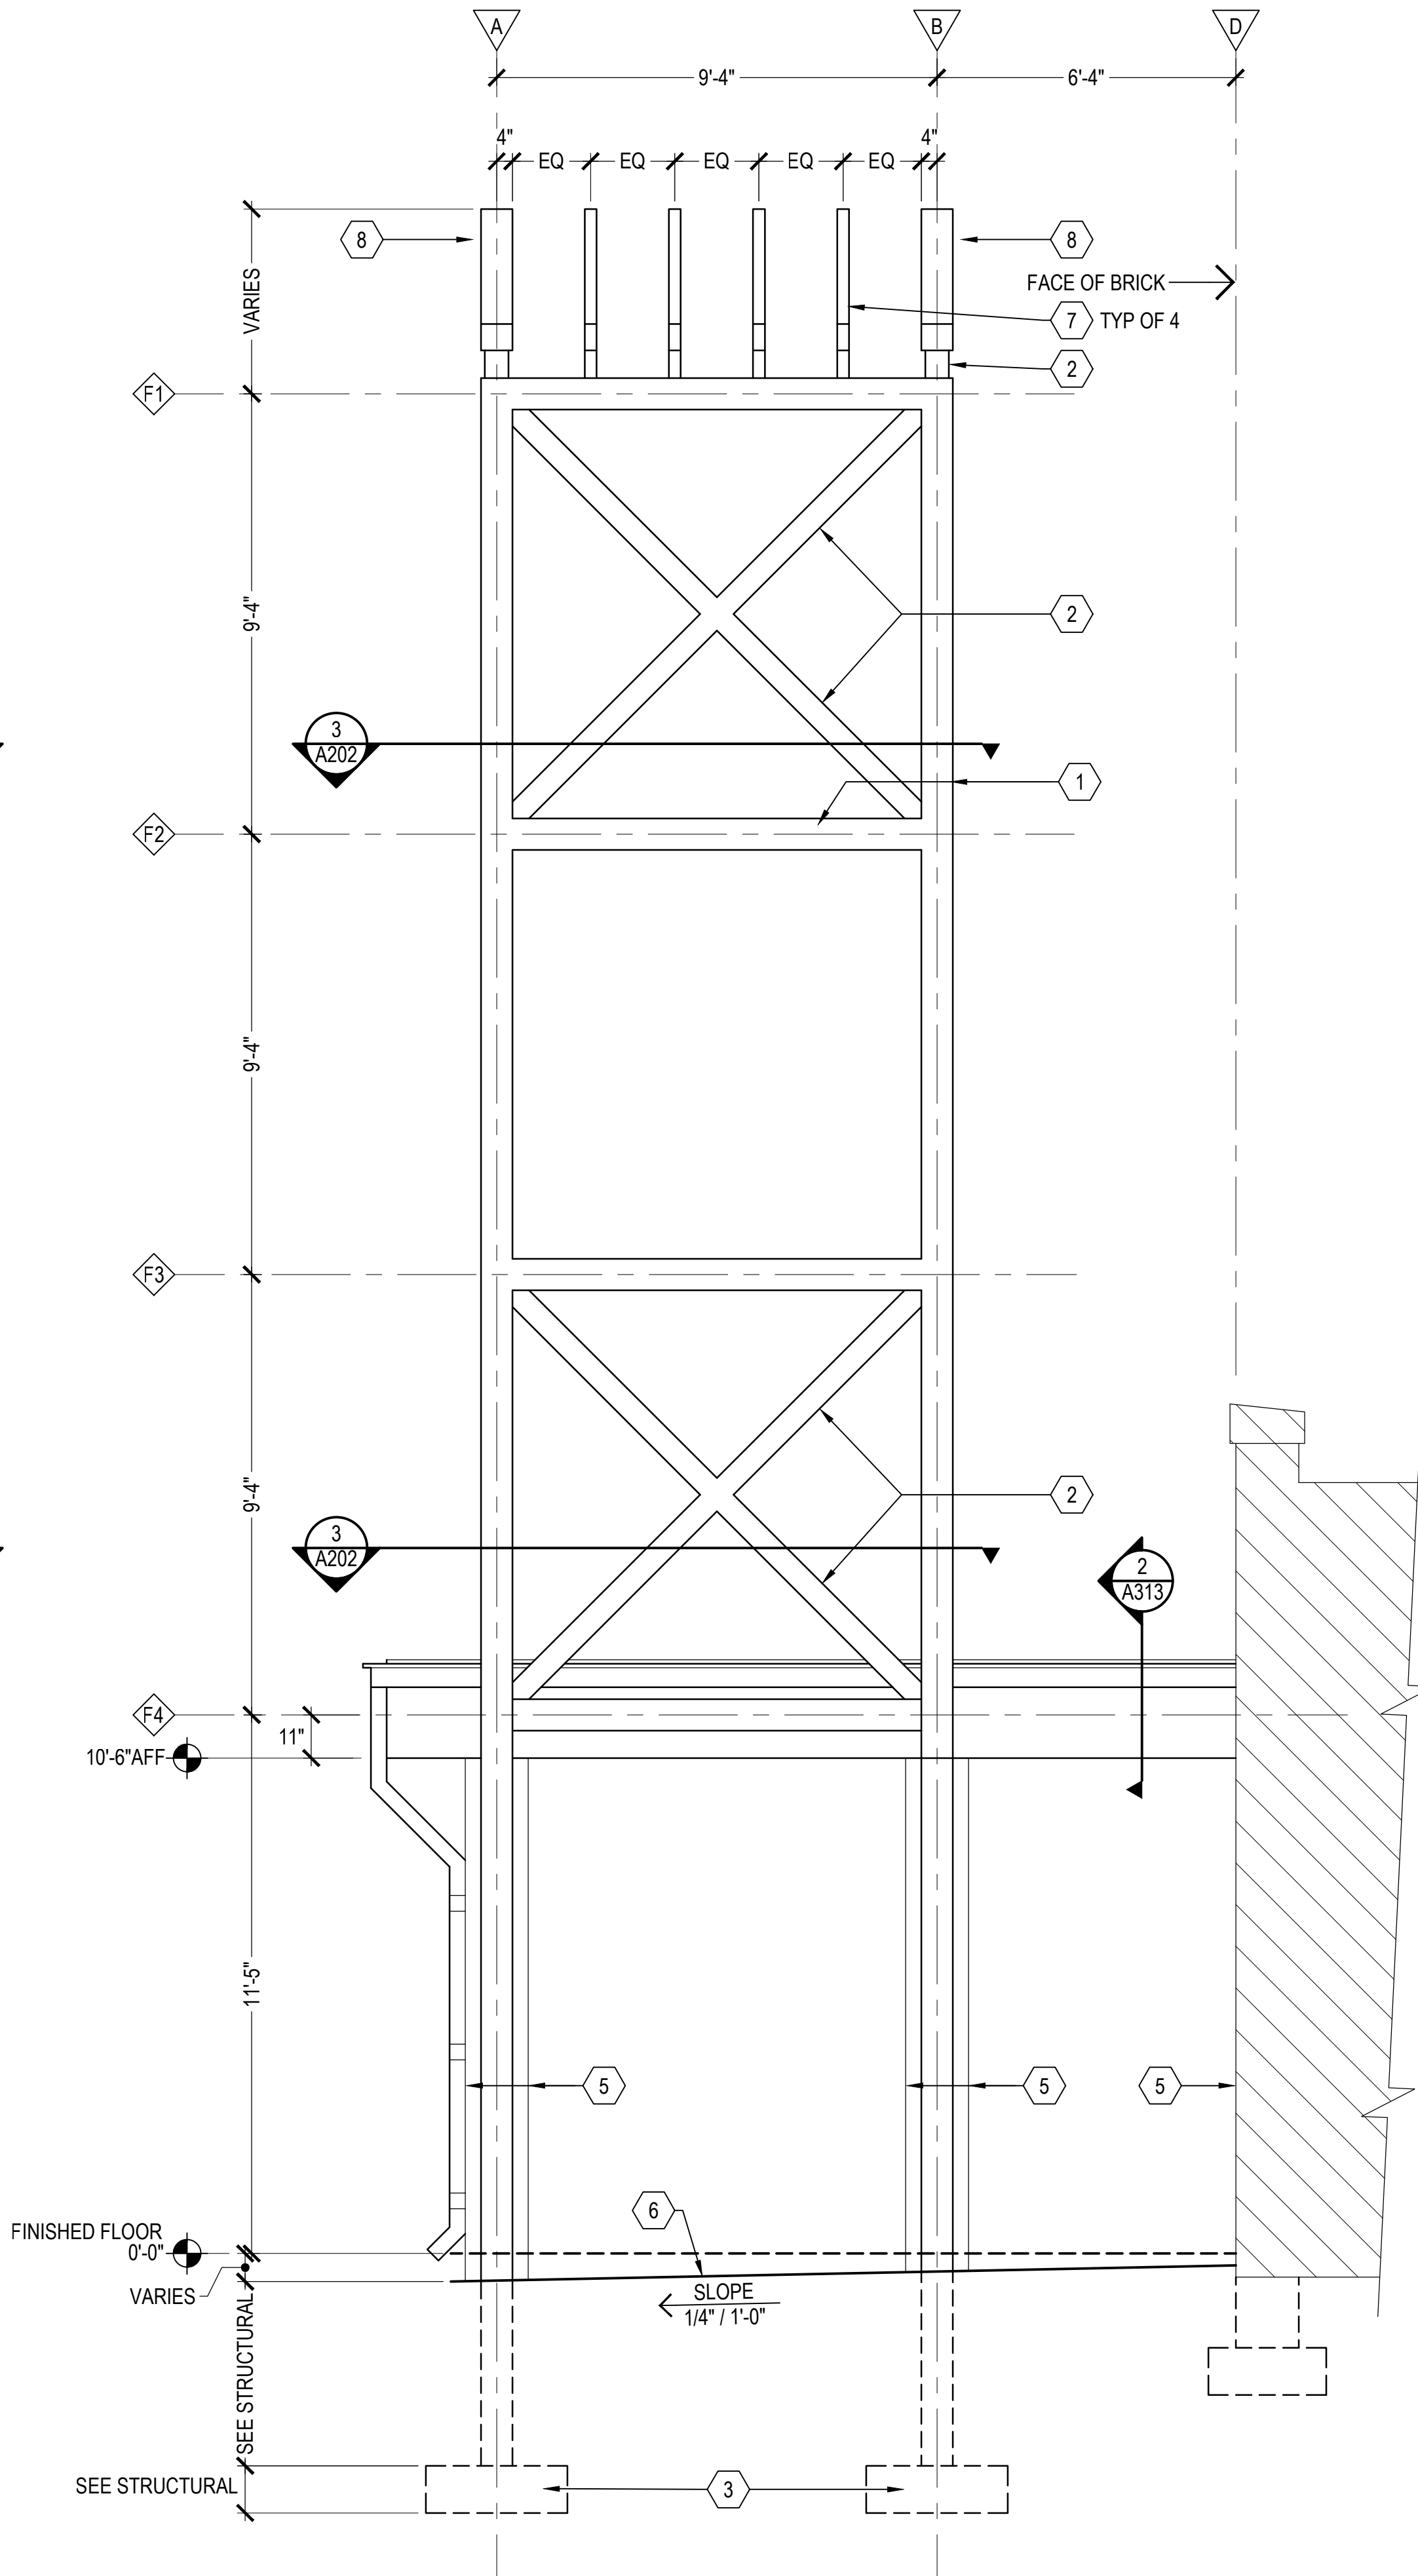

2 TOWER DETAIL
SCALE: 3/8"=1'-0"

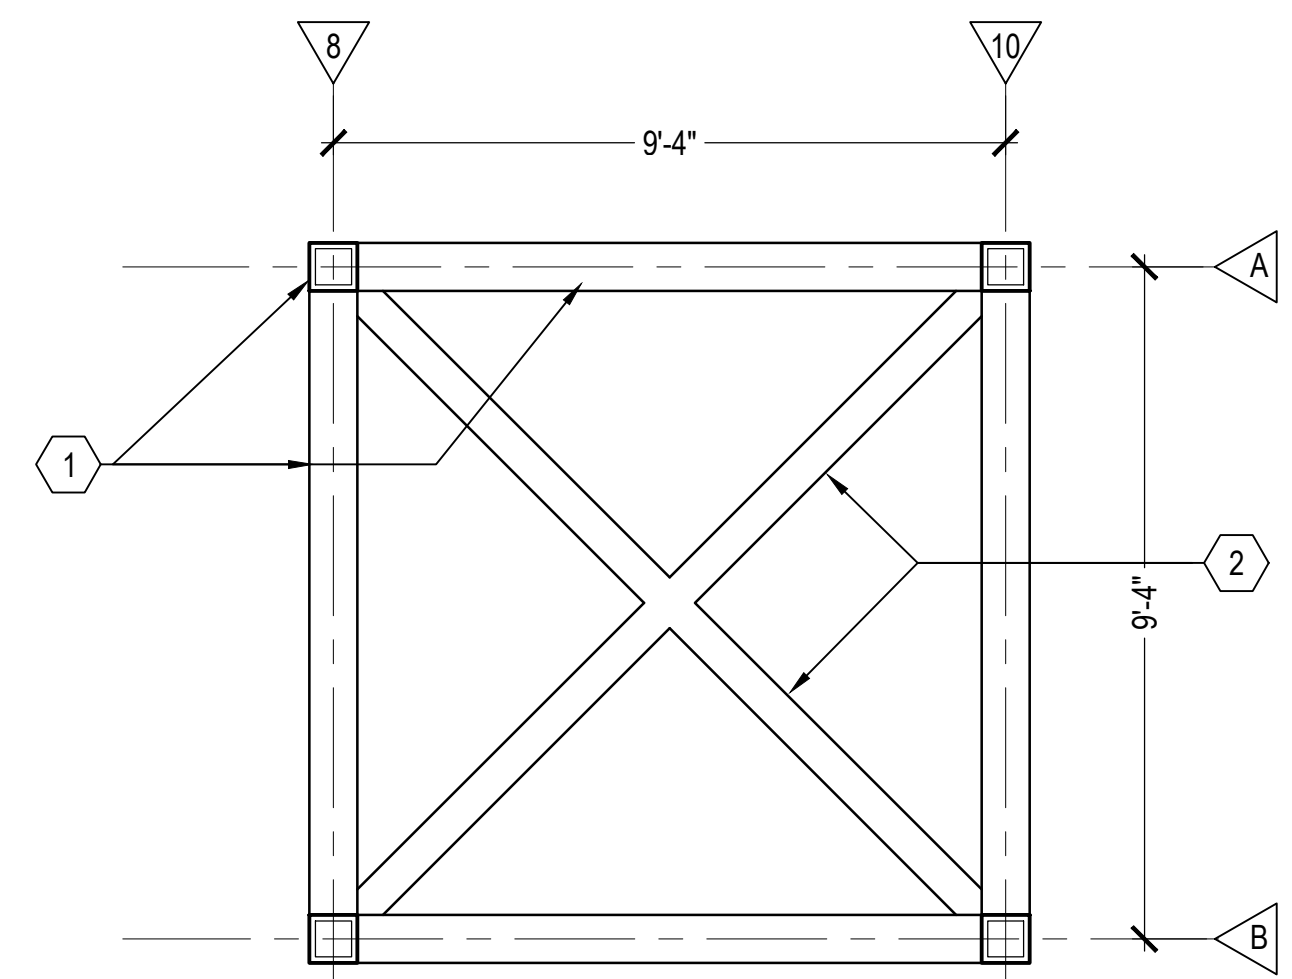

3 CROSS-BRACING PLAN AT FRAME 2 & 4, ONLY
SCALE: 3/8"=1'-0" FRAMES DESIGNATED THUS: F2 F4

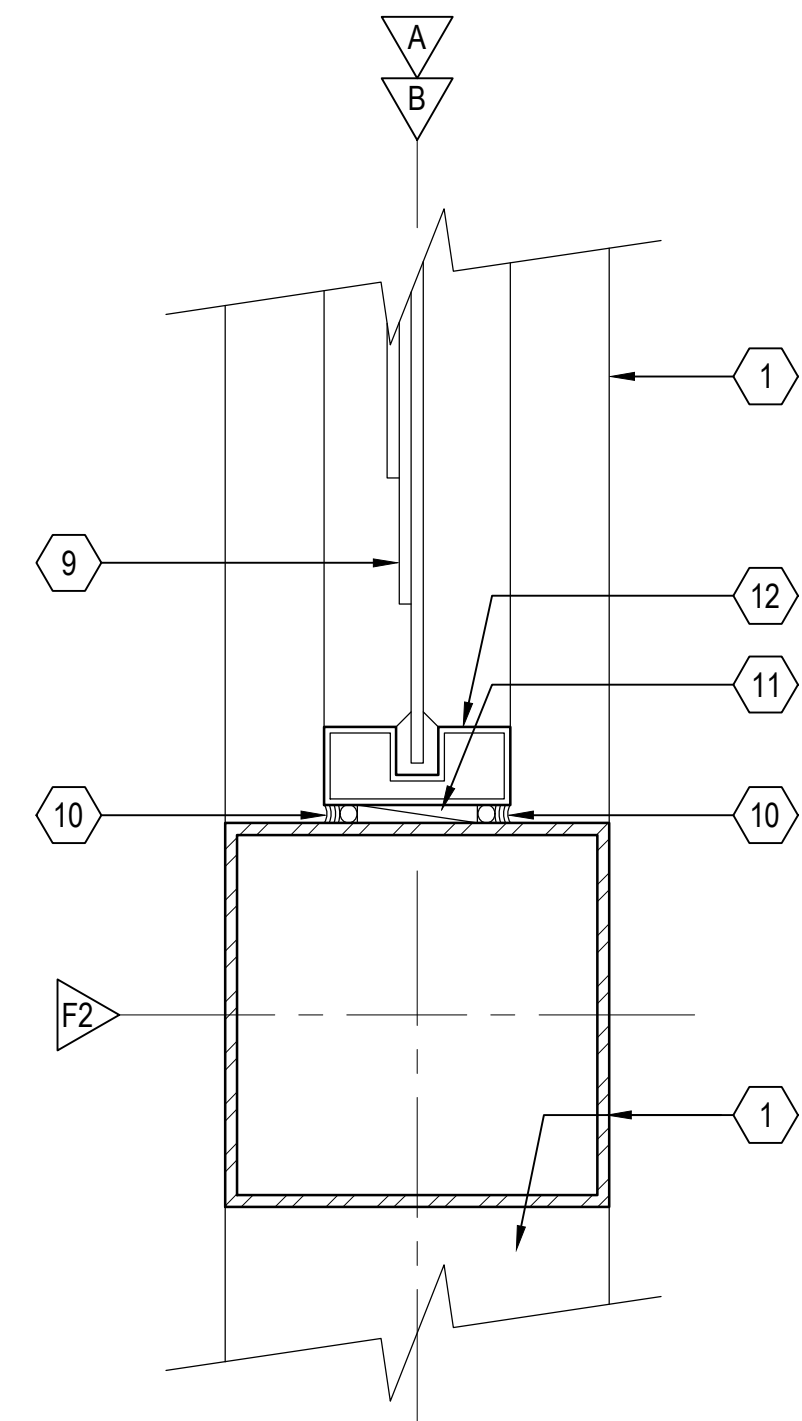

4 SIGN DETAIL
SCALE: 3/8"=1'-0"

- KEYNOTES
- 1 8"x8" TUBE STEEL, WITH HIGH-PERFORMANCE COATING, SEE STRUCTURAL.
 - 2 6"x6" TUBE STEEL, WITH HIGH-PERFORMANCE COATING: CENTER ON 8"x8" TUBE STEEL, SEE STRUCTURAL.
 - 3 CONCRETE FOUNDATION, SEE STRUCTURAL.
 - 4 LINE OF BUILDING
 - 5 LINE OF BRICK AT COLUMN BEYOND
 - 6 LINE OF CONCRETE SIDEWALK BEYOND
 - 7 2"x8" CURVED TUBE STEEL, WITH HIGH-PERFORMANCE COATING, SEE STRUCTURAL.
 - 8 8"x8" CURVED TUBE STEEL, WITH HIGH-PERFORMANCE COATING, SEE STRUCTURAL.
 - 9 1/4" THICK, MULTI-LAYERED ALUMINUM COMPOSITE PANEL IN FRAME (ALUCOBOND BASIS OF DESIGN, OR APPROVED EQUAL).
 - 10 SEALANT
 - 11 SHIM
 - 12 ALUMINUM, SINGLE-GLAZED STORE-FRONT FRAMING: INSTALL PER FLORIDA PRODUCT APPROVAL REQUIREMENTS, CORAL ALUMINUM-FL200.


ENLARGED TOWER ELEVATIONS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL


Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:


A202
SHEET #

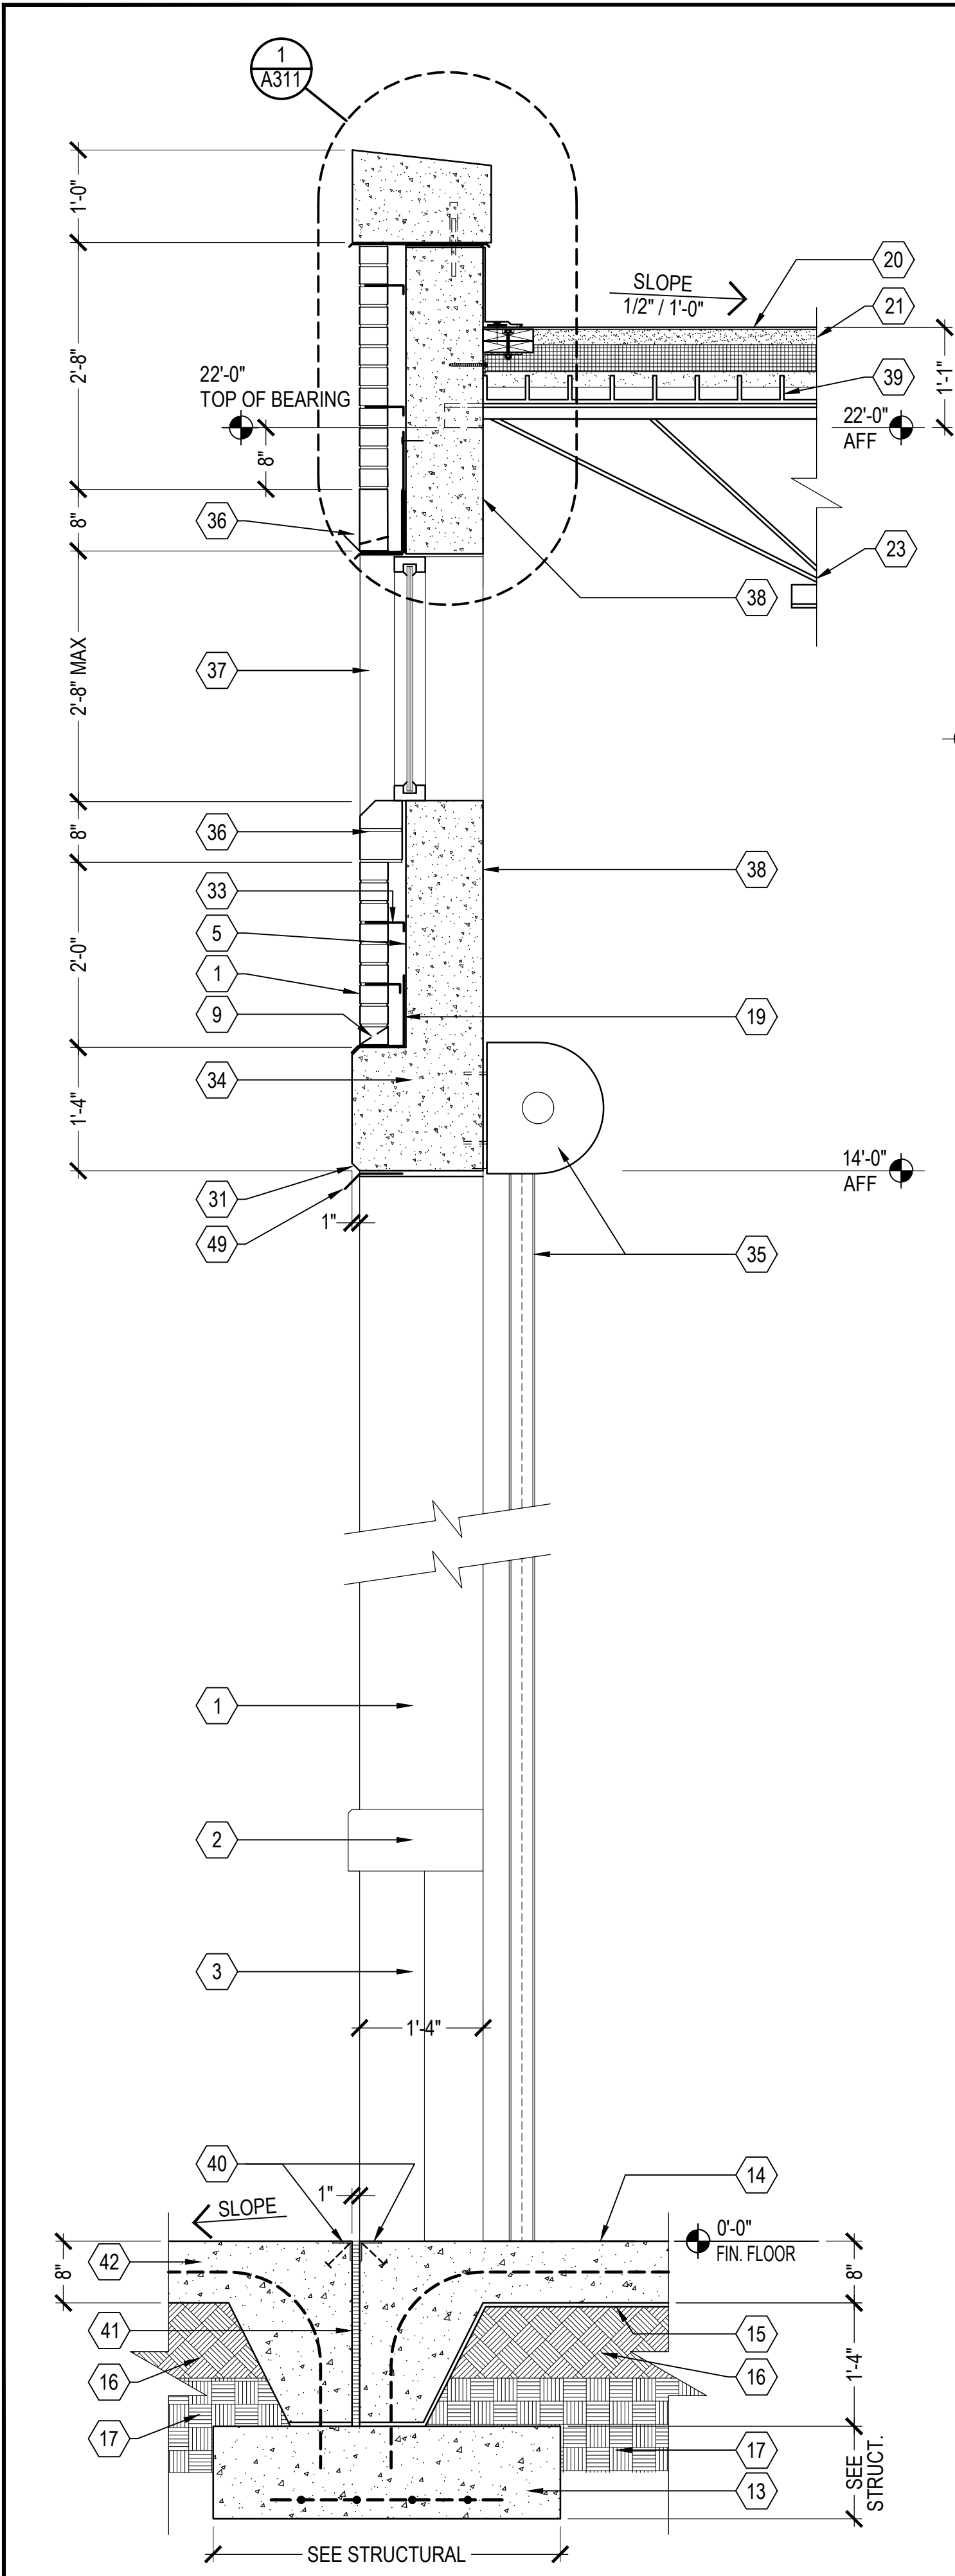


1 WALL SECTION
A301 SCALE: 3/4"=1'-0"

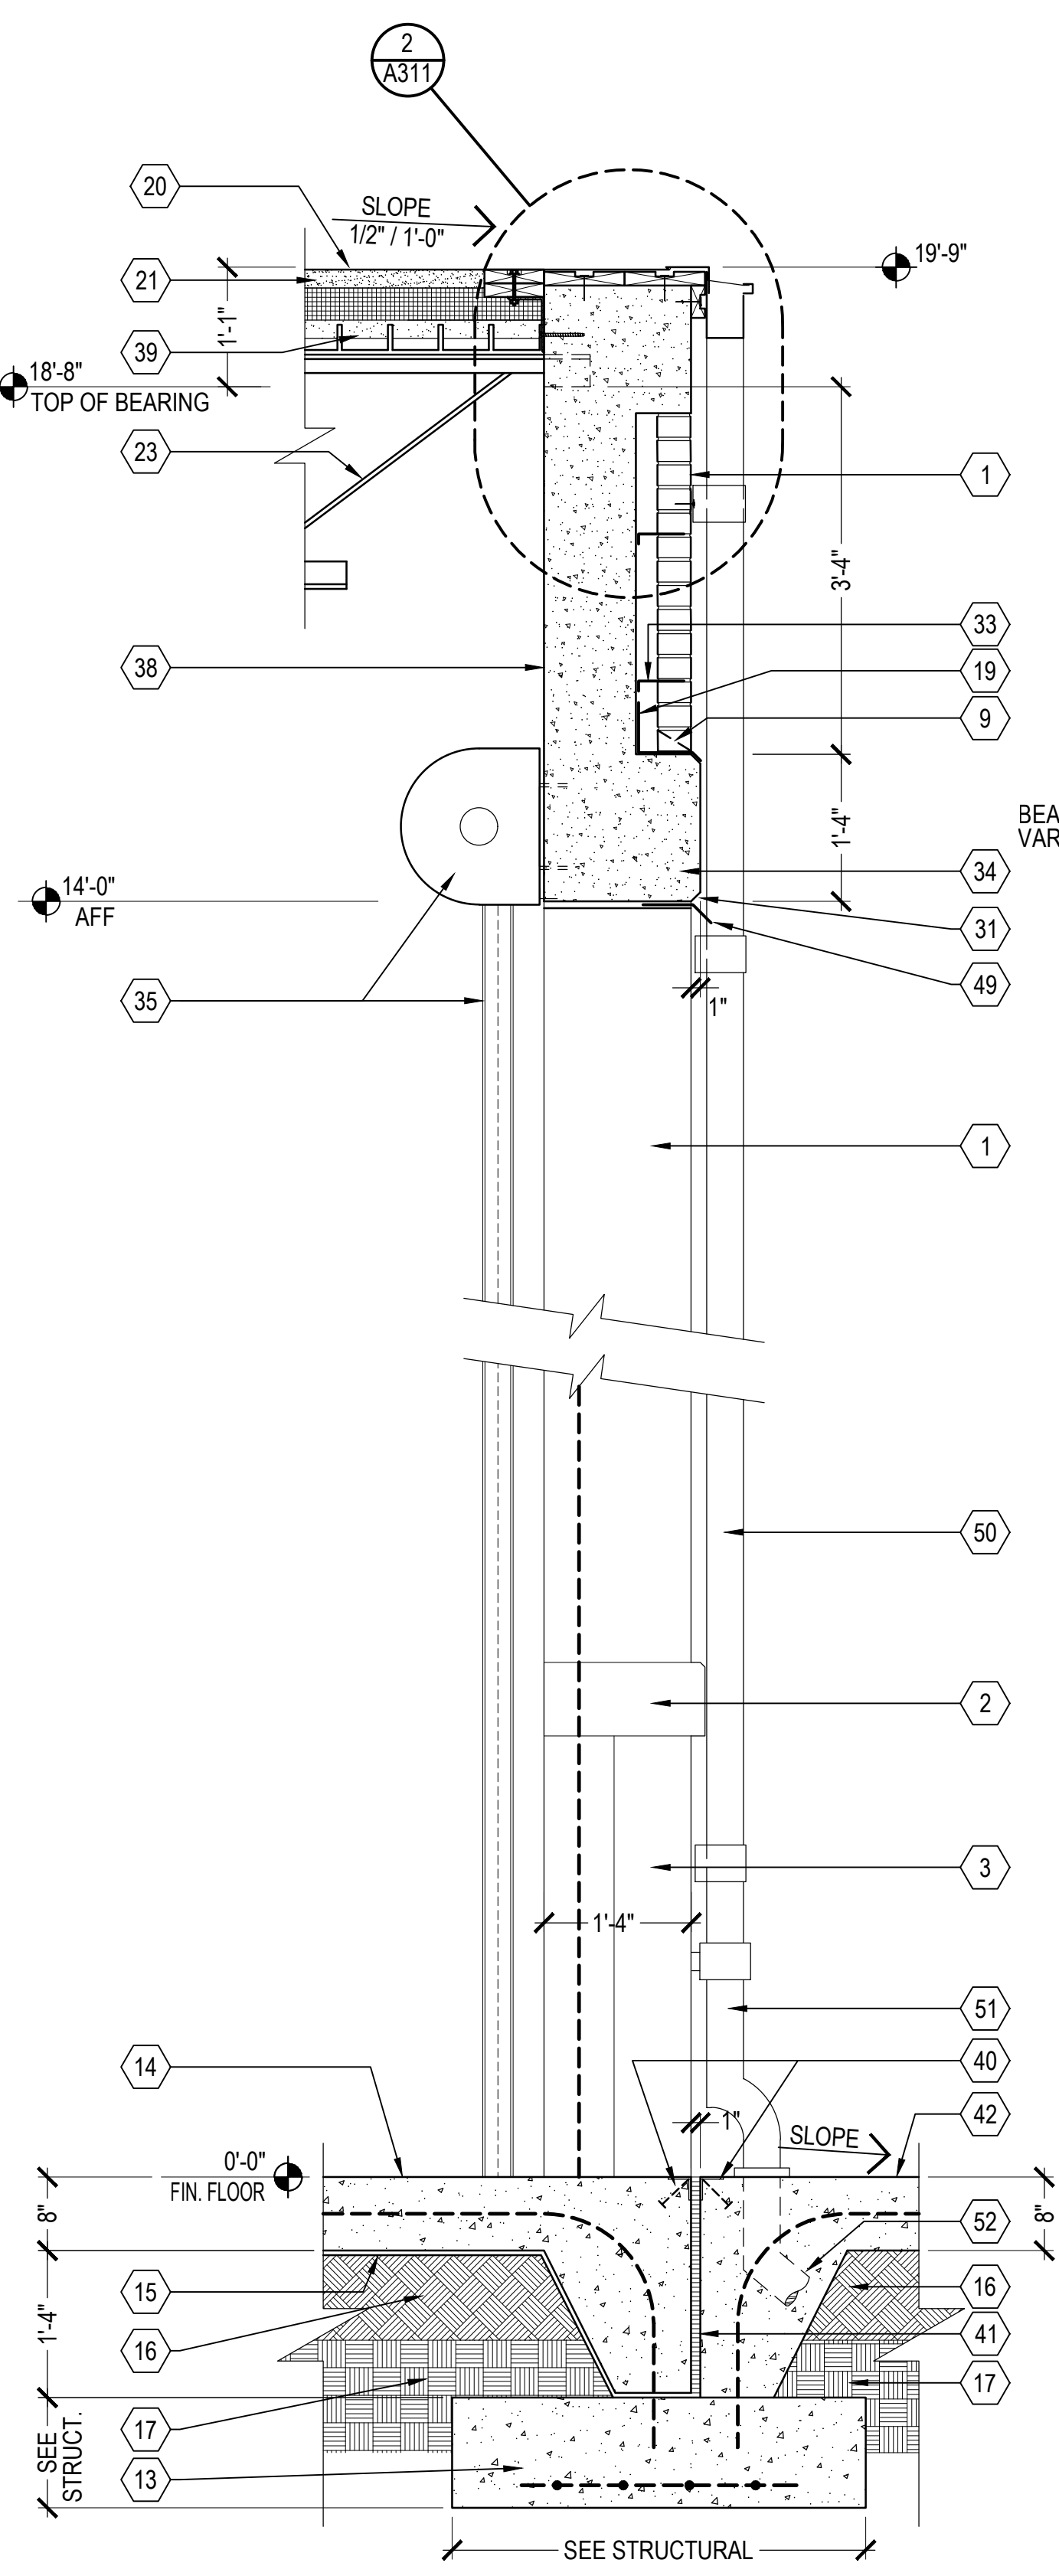

2 WALL SECTION
A301 SCALE: 3/4"=1'-0"

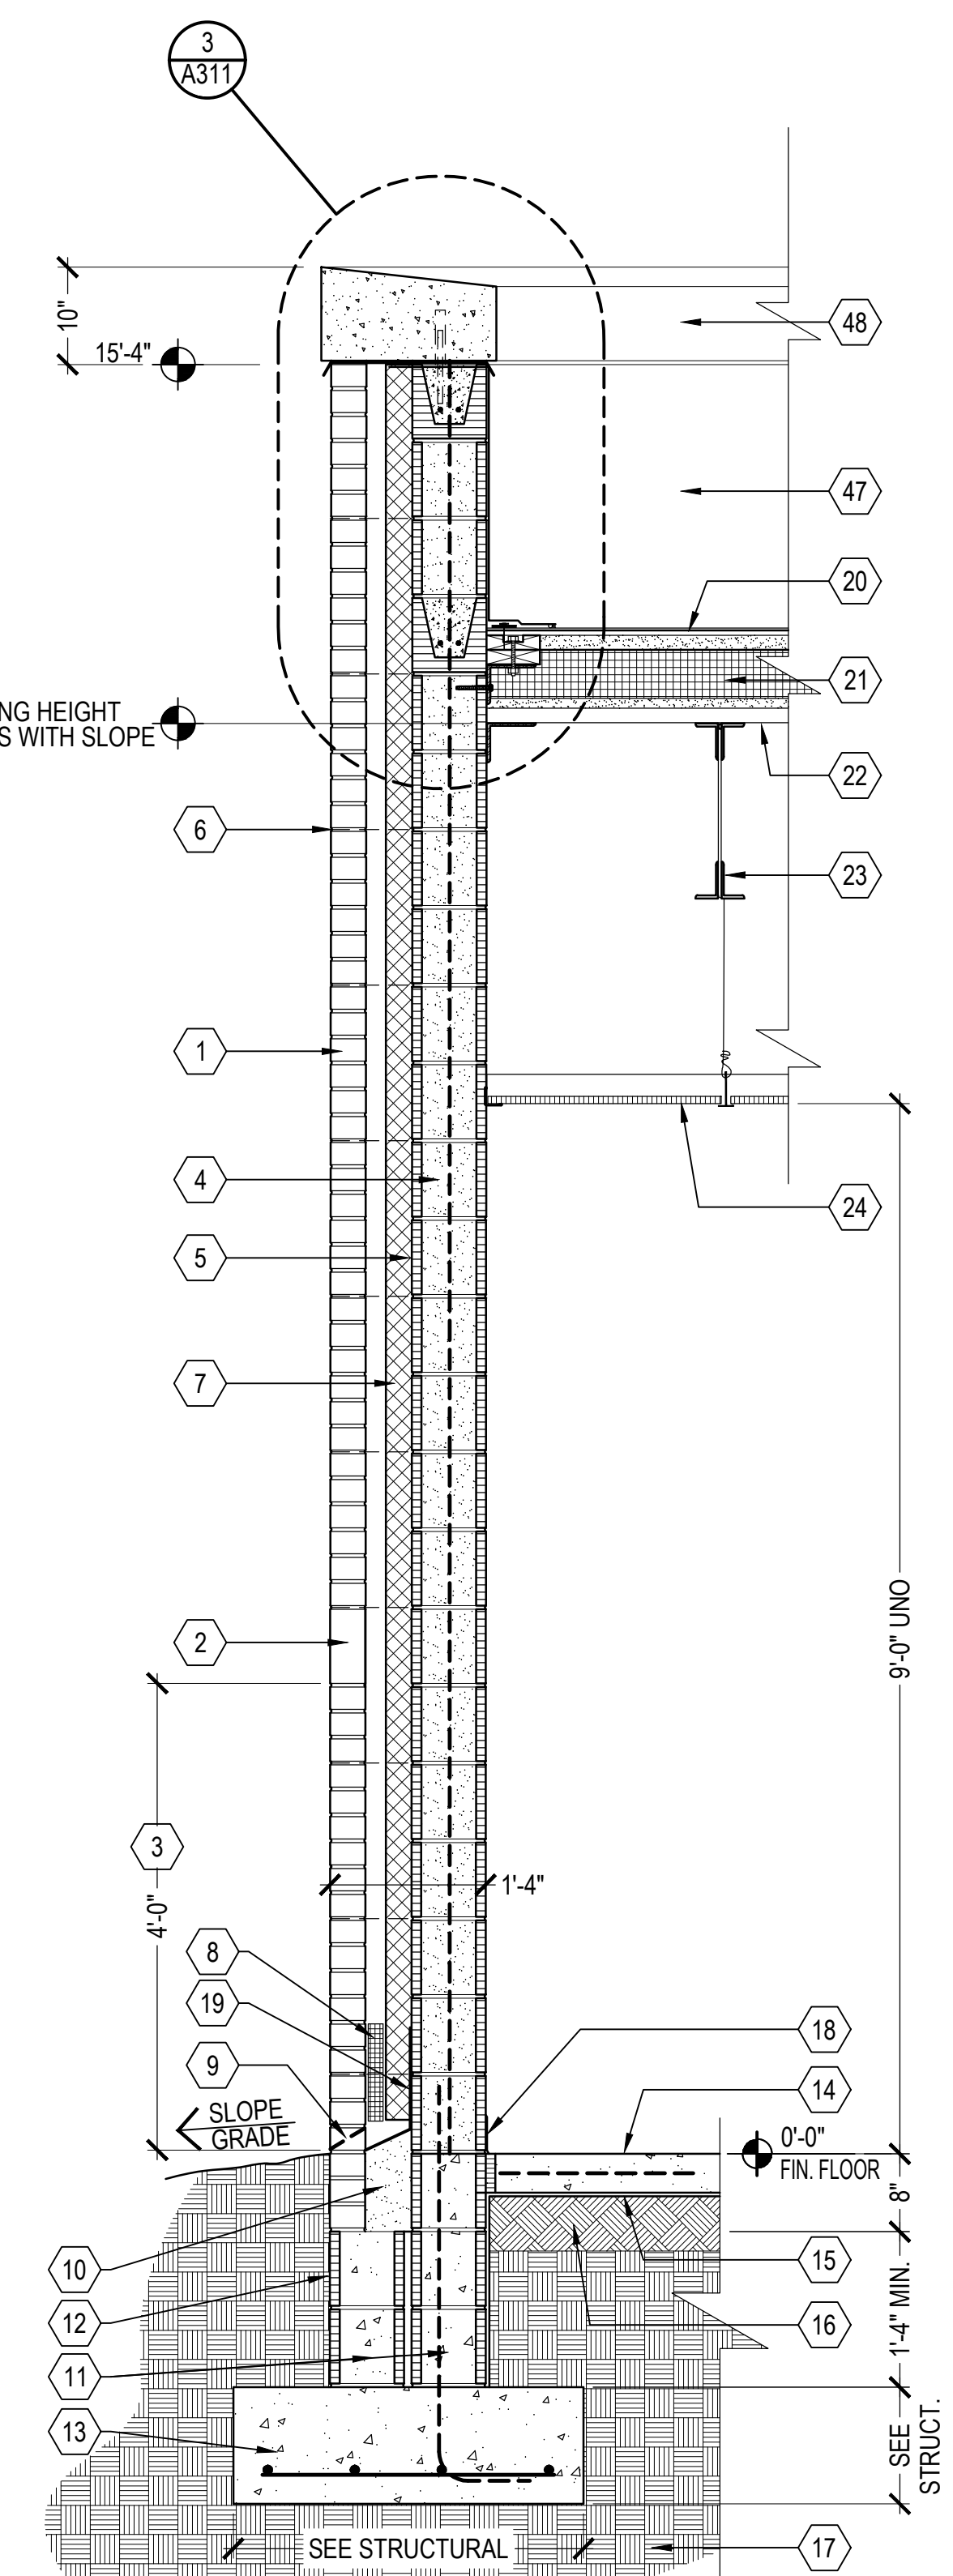

3 WALL SECTION
A301 SCALE: 3/4"=1'-0"

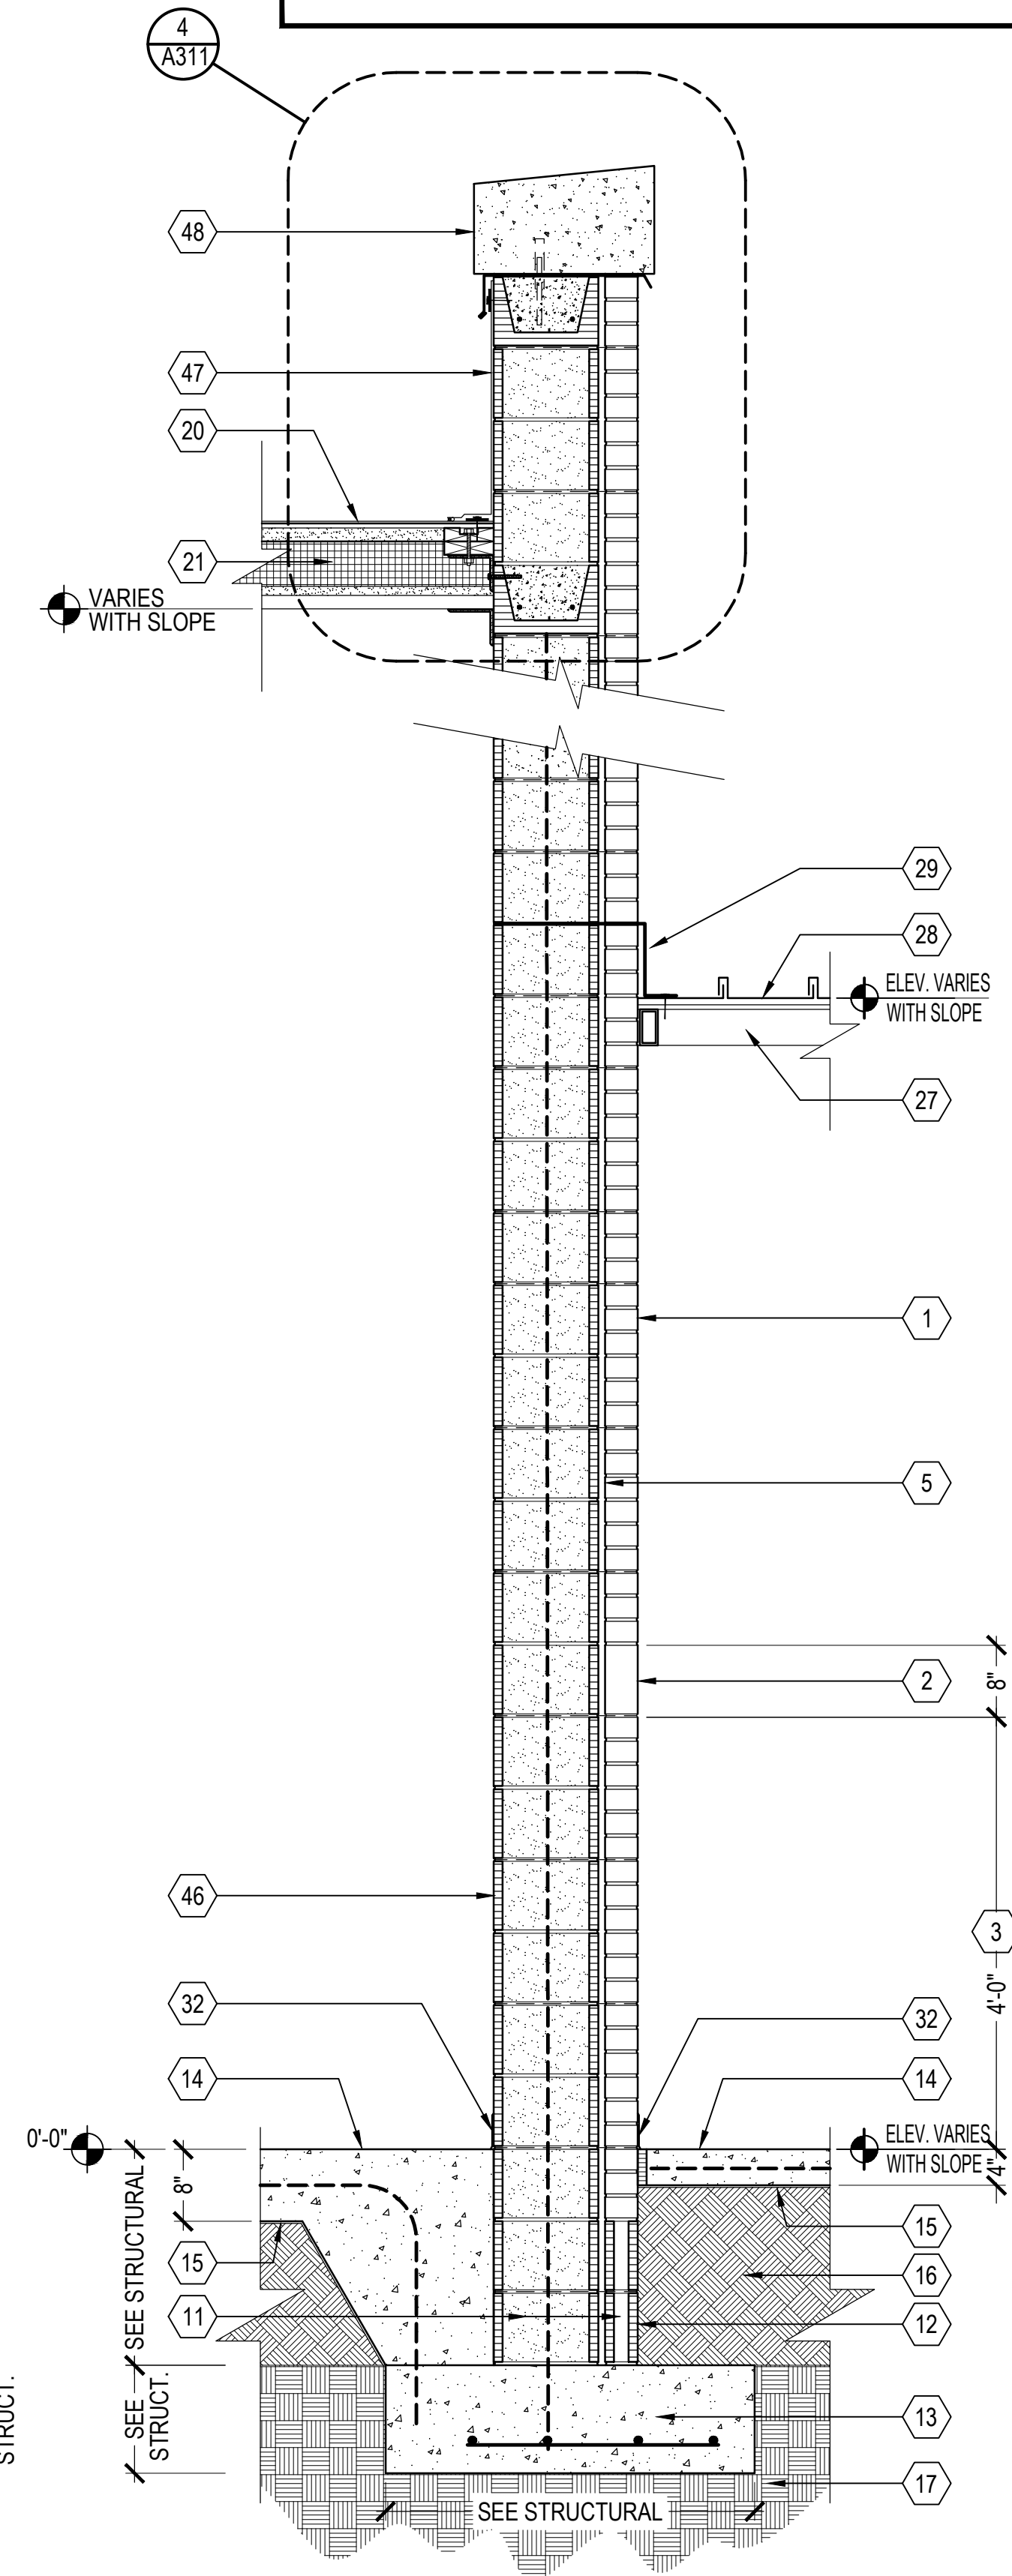

4 WALL SECTION
A301 SCALE: 3/4"=1'-0"

- KEYNOTES
- 50 6"x4"x0.032 PRE-FINISHED ALUMINUM DOWNSPOUT WITH 3 STAND OFF BRACKETS.
 - 51 6"x4" CAST ALUMINUM DOWNSPOUT BOOT.
 - 52 STORM DRAINAGE, SEE CIVIL.
 - 53 4"x4"x0.032 PREFINISHED ALUMINUM DOWNSPOUT WITH 2 STAND OFF BRACKETS.
 - 54 4"x4" CAST ALUMINUM DOWNSPOUT BOOT, SQUARE TO ROUND.
 - 55 6"x4"x4"x0.032 PREFINISHED ALUMINUM GUTTER WITH SUPPORT BRACKETS AT 4'-0" O.C.

- KEYNOTES
- 1 FACE BRICK, RUNNING BOND
 - 2 ACCENT BRICK, SOLDIER COURSE
 - 3 FACE BRICK, STACK BOND
 - 4 8" CMU, SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL ALL UNFILLED CELLS WITH FOAM INSULATION
 - 5 FLUID-APPLIED VAPOR BARRIER, CONTINUOUS
 - 6 HORIZONTAL WIRE REINFORCING AT 16" O.C. VERTICAL
 - 7 2" EXPANDED POLYSTYRENE RIGID BOARD INSULATION, ADHERE TO CMU
 - 8 NON WOVEN MORTAR NETTING CONTINUOUS
 - 9 WEEP HOLE WITH PVC INSERT AT 4'-0" O.C.
 - 10 GROUT COLLAR JOINT SOLID
 - 11 8"/12"/4" CMU, GROUT ALL CELLS BELOW GRADE SOLID, SEE STRUCTURAL FOR REINFORCING
 - 12 BITUMINOUS DAMP PROOFING BELOW GRADE, CONTINUOUS
 - 13 CONCRETE FOUNDATION, SEE STRUCTURAL
 - 14 CONCRETE SLAB, SEE STRUCTURAL
 - 15 20 MIL POLYOLEFIN VAPOR BARRIER, TAPE ALL JOINTS
 - 16 COMPACTED STRUCTURAL FILL, SEE GEOTECH REPORT
 - 17 COMPACTED SUBGRADE, SEE GEOTECH REPORT
 - 18 RESILIENT BASE, SEE FINISH SCHEDULE
 - 19 THRU WALL FLEXIBLE FLASHING
 - 20 60 MIL FLEECE BACK FULLY ADHERED WHITE PVC ROOF MEMBRANE
 - 21 LIGHTWEIGHT CELLULAR INSULATING CONCRETE WITH R25 EPS BOARD AT CONDITIONED SPACES & R12 EPS AT APPARATUS BAY
 - 22 1-1/2 METAL FORM DECK, SEE STRUCTURAL
 - 23 STEEL BAR JOIST, SEE STRUCTURAL, PAINT WHERE EXPOSED TO VIEW
 - 24 FINISH CEILING, SEE FINISH SCHEDULE
 - 25 STEEL BEAM, SEE STRUCTURAL
 - 26 STEEL COLUMN, SEE STRUCTURAL
 - 27 GALV. TUBE STEEL COLUMNS, BEAMS & RAFTERS, SEE STRUCTURAL
 - 28 STANDING SEAM STRUCTURAL PRE-FINISHED 22 GA. GALV. STEEL ROOF
 - 29 26 GA. GALV. PREFINISHED STEEL FLASHING
 - 30 #5 REBAR CONTINUOUS
 - 31 45° CHAMFER
 - 32 1/2" ASPHALTIC BOARD
 - 33 EYE & PINTLE ADJUSTABLE MASONRY ANCHOR AT 16" O.C., EACH WAY, STAGGERED
 - 34 REINFORCED CONCRETE BEAM, RUB EXPOSED SURFACES SMOOTH, FILL ALL VOIDS & CAVITIES, SEE STRUCTURAL. PROVIDE ONE COAT OF COLORED ACRYLIC STUCCO.
 - 35 OVERHEAD COILING DOOR & TRACK, IMPACT & STORM RATED
 - 36 BRICK WINDOW SURROUND, SEE WINDOW DETAILS.
 - 37 ALUMINUM STOREFRONT IMPACT RATED, INSULATED WINDOW
 - 38 REINFORCED CONCRETE WALL, SEE STRUCTURAL, PAINT WHERE EXPOSED TO VIEW
 - 39 CELLULAR ACOUSTICAL ROOF DECK (EPIC METALS - TORIS 5.5, PRE-FINISHED, BASIS OF DESIGN).
 - 40 4"x4"x1/2" ANGLE, CAST IN PLACE, WITH WELDED 6" STUDS AT 12" O.C.
 - 41 POURABLE TRAFFIC RATED JOINT FILLER. FILL JOINT SOLID
 - 42 CONCRETE APRON, SEE CIVIL
 - 43 5/8" GYPSUM BOARD
 - 44 3-5/8" x 20 GA. STEEL STUDS AT 16" O.C.
 - 45 3-1/2" KRAFT FACED FIBERGLASS INSULATION
 - 46 12" CMU, SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL ALL UNFILLED WITH FOAM INSULATION
 - 47 FULLY-ADHERED PVC MEMBRANE WALL FLASHING
 - 48 PRECAST CONCRETE COPING
 - 49 PRE-FINISHED 0.032" ALUMINUM DRIP


WALL SECTIONS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	By	Date

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

A301
SHEET #




-
- 1
A317
- 10'
- 17'-4"
- BEARING HEIGHT VARIES WITH SLOPE
- 6
- 5
- 1
- 7

- | | |
|----|--|
| 46 | 12" CMU, SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL ALL UNFILLED WITH FOAM INSULATION |
| 47 | FULLY-ADHERED PVC MEMBRANE WALL FLASHING |
| 48 | PRECAST CONCRETE COPING |
| 49 | PRE-FINISHED 0.032" ALUMINUM DRIP |


Revision	

Scale:	AS NOTED
Date:	04-03-202
Drawn:	Checked:
A302 SHEET #	

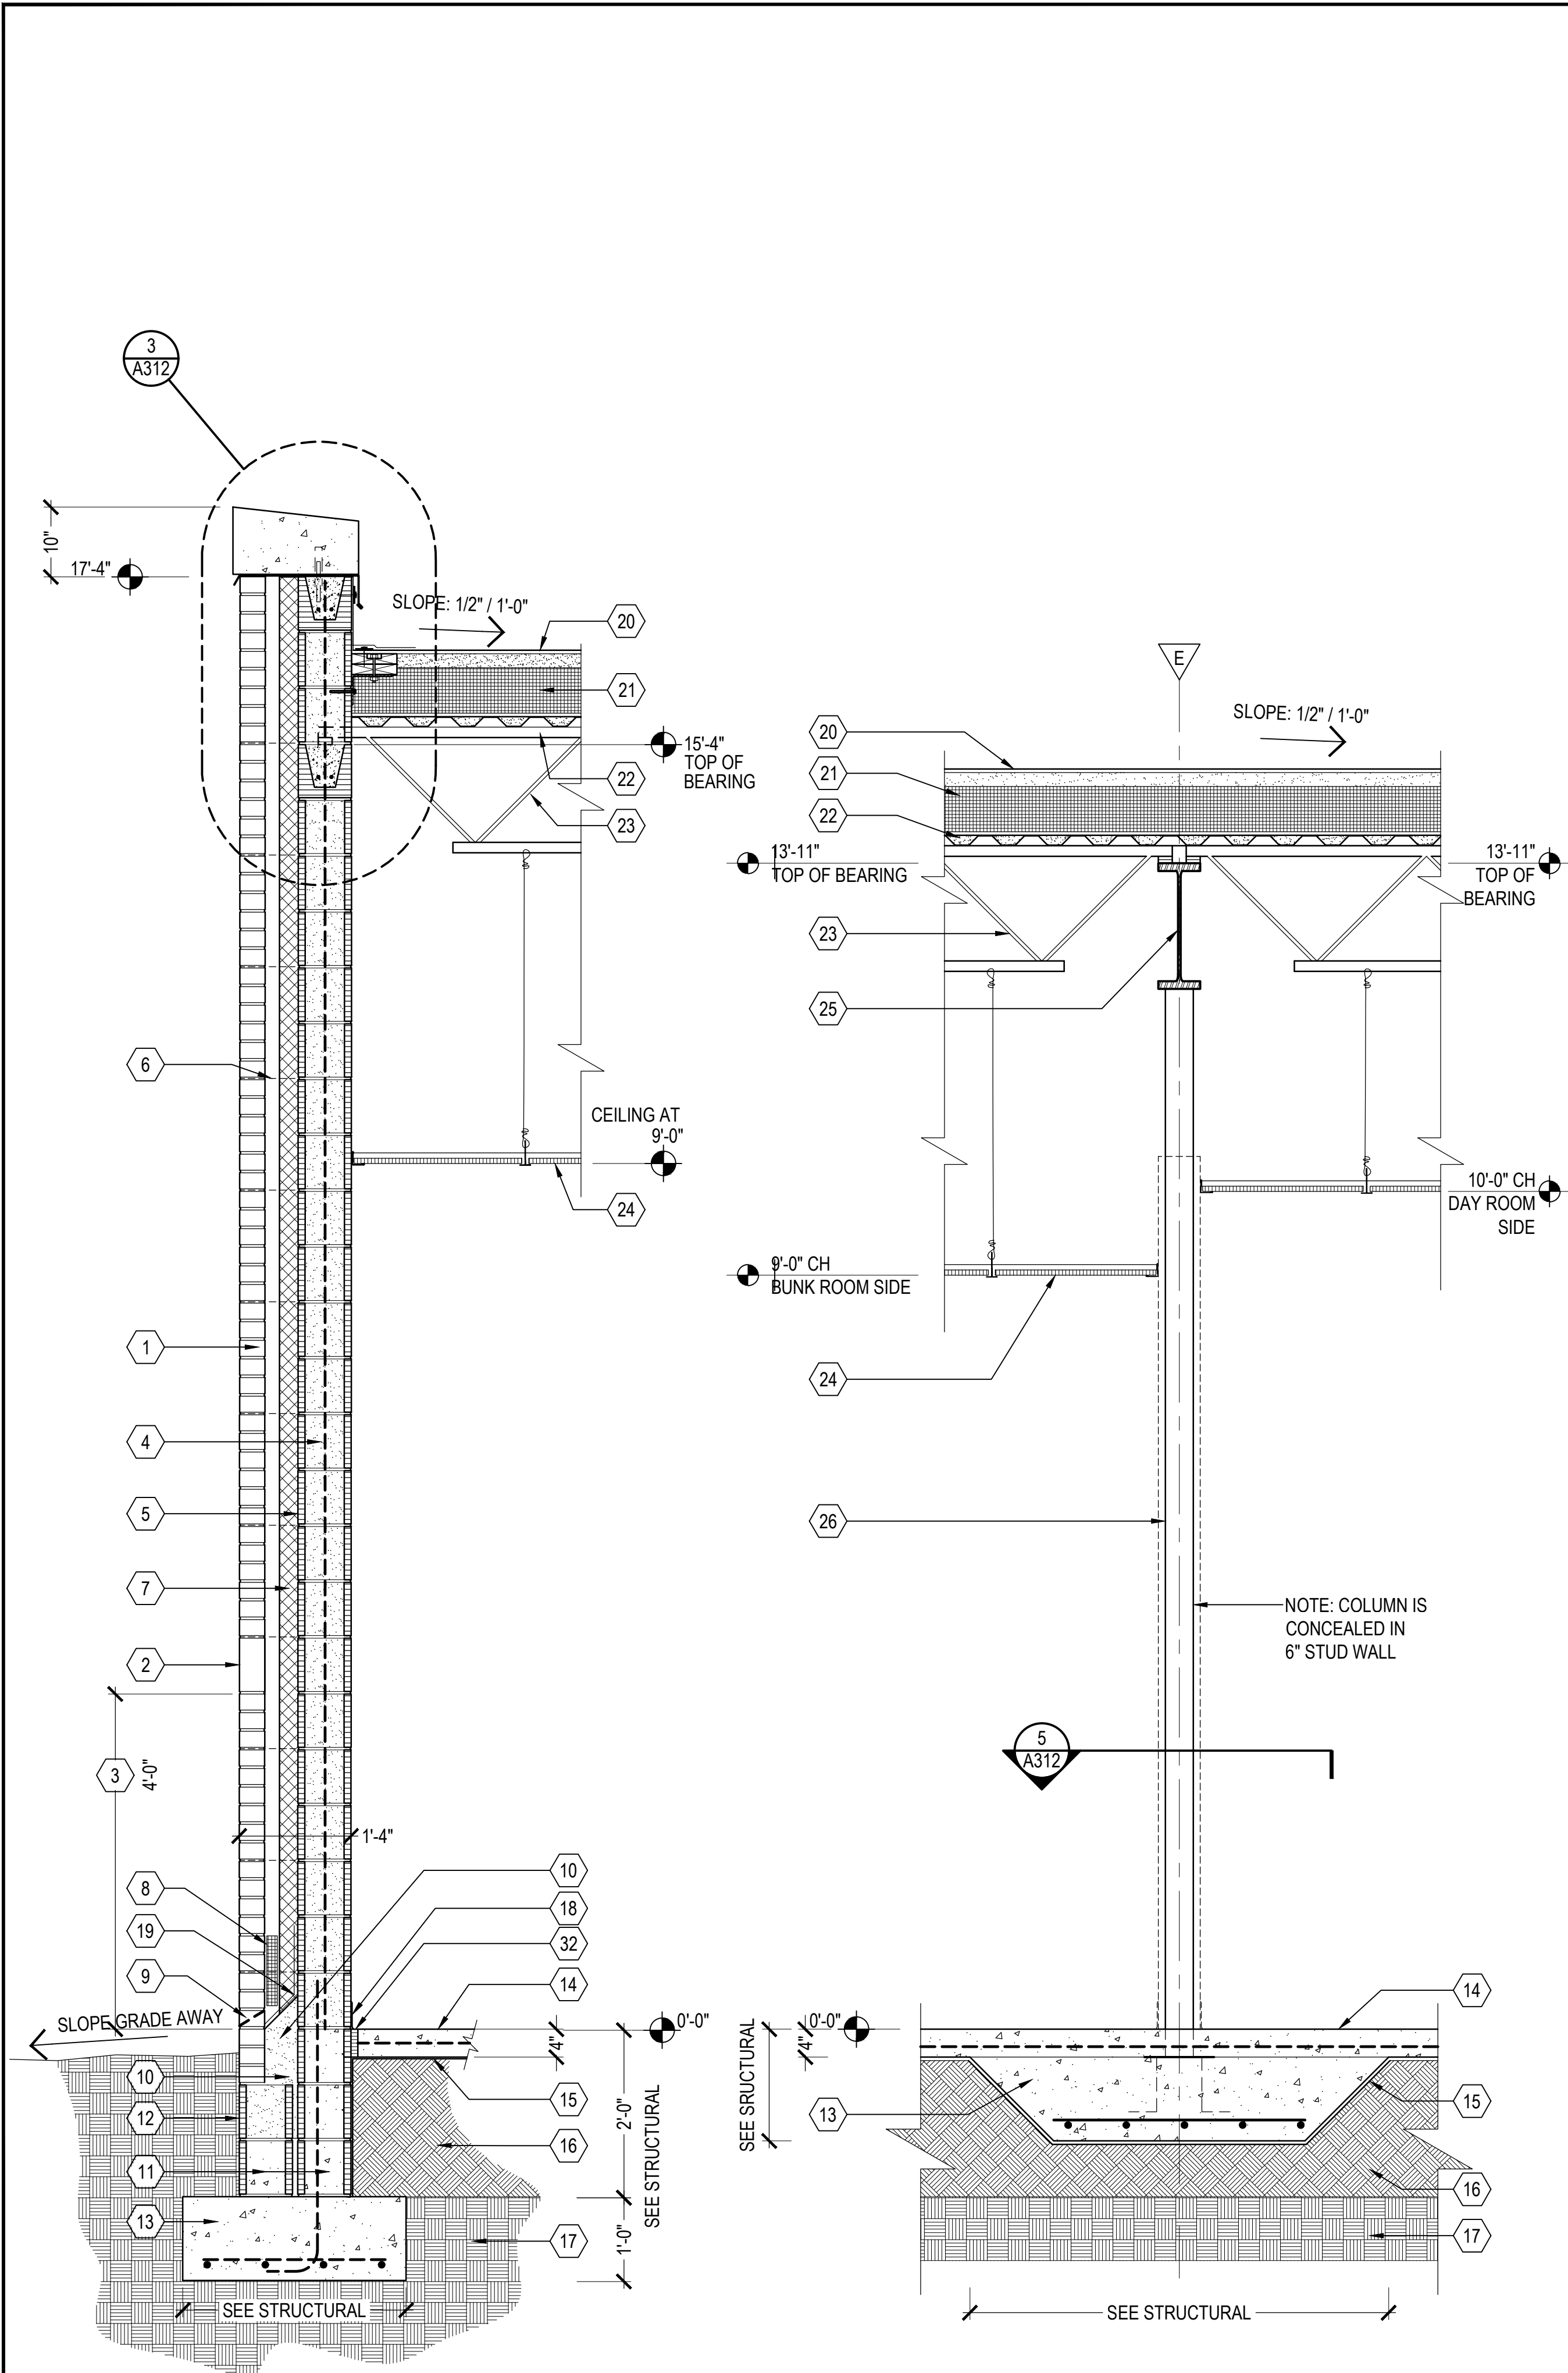

1 WALL SECTION
A303 SCALE: 3/4"=1'-0"

2 WALL SECTION
A303 SCALE: 3/4"=1'-0"

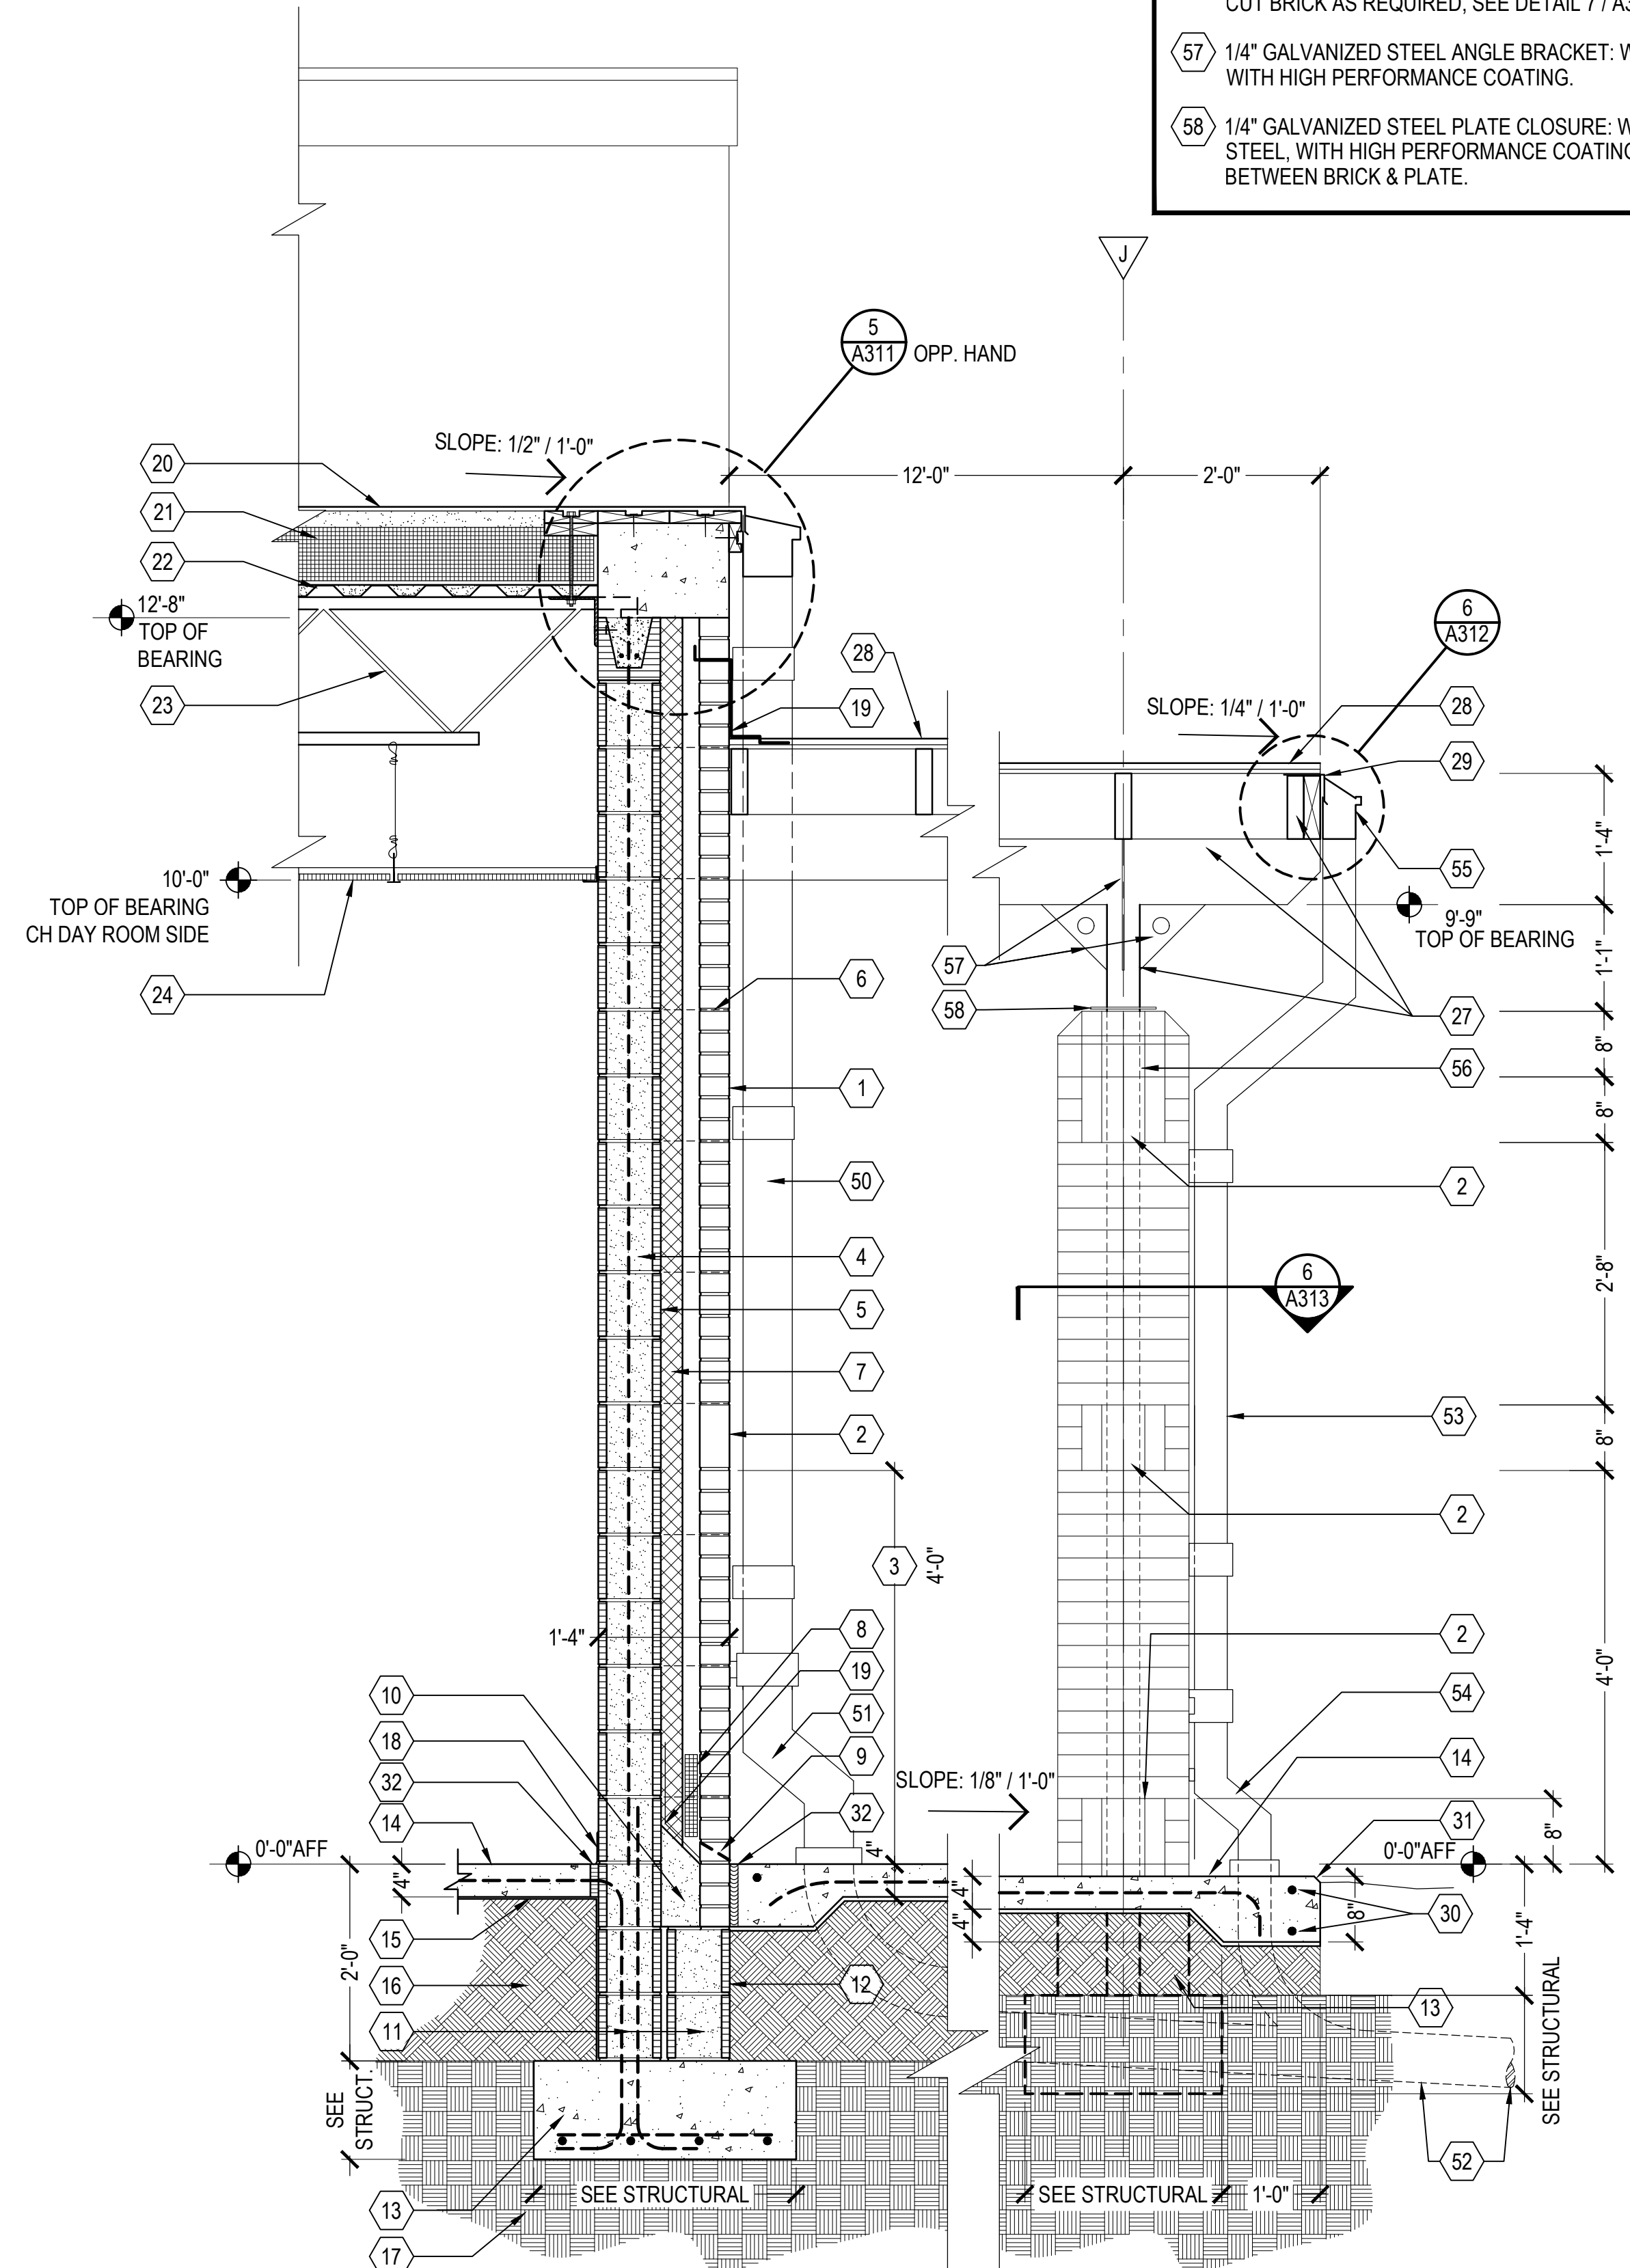

3 WALL SECTION
A303 SCALE: 3/4"=1'-0"

- KEYNOTES
- 49 PRE-FINISHED 0.032" ALUMINUM DRIP
 - 50 6"x4"x0.032 PRE-FINISHED ALUMINUM DOWNSPOUT WITH 3 STAND OFF BRACKETS.
 - 51 6"x4" CAST ALUMINUM DOWNSPOUT BOOT.
 - 52 STORM DRAINAGE, SEE CIVIL.
 - 53 4"x4"x0.032 PRE-FINISHED ALUMINUM DOWNSPOUT WITH 2 STAND OFF BRACKETS.
 - 54 4"x4" CAST ALUMINUM DOWNSPOUT BOOT, SQUARE TO ROUND.
 - 55 6"x4"x4"x0.032 PRE-FINISHED ALUMINUM GUTTER WITH SUPPORT BRACKETS AT 4'-0" O.C.
 - 56 SLOPED-SILL ROWLOCK BRICK & ROWLOCK BRICK COURSE: CUT BRICK AS REQUIRED, SEE DETAIL 7 / A313.
 - 57 1/4" GALVANIZED STEEL ANGLE BRACKET: WELD TO TUBE, WITH HIGH PERFORMANCE COATING.
 - 58 1/4" GALVANIZED STEEL PLATE CLOSURE: WELD TO TUBE STEEL, WITH HIGH PERFORMANCE COATING. CAULK JOINT BETWEEN BRICK & PLATE.


- KEYNOTES
- 1 FACE BRICK, RUNNING BOND
 - 2 ACCENT BRICK, SOLDIER COURSE
 - 3 FACE BRICK, STACK BOND
 - 4 8" CMU, SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL ALL UNFILLED CELLS WITH FOAM INSULATION
 - 5 FLUID-APPLIED VAPOR BARRIER, CONTINUOUS
 - 6 HORIZONTAL WIRE REINFORCING AT 16" O.C. VERTICAL
 - 7 2" EXPANDED POLYSTYRENE RIGID BOARD INSULATION, ADHERE TO CMU
 - 8 NON WOVEN MORTAR NETTING CONTINUOUS
 - 9 WEEP HOLE WITH PVC INSERT AT 4'-0" O.C.
 - 10 GROUT COLLAR JOINT SOLID
 - 11 8"/12"/4" CMU, GROUT ALL CELLS BELOW GRADE SOLID, SEE STRUCTURAL FOR REINFORCING
 - 12 BITUMINOUS DAMP PROOFING BELOW GRADE, CONTINUOUS
 - 13 CONCRETE FOUNDATION, SEE STRUCTURAL
 - 14 CONCRETE SLAB WITH 6x6 W10 x W10 WWF, SEE STRUCTURAL
 - 15 20 MIL POLYOLEFIN VAPOR BARRIER, TAPE ALL JOINTS
 - 16 COMPACTED STRUCTURAL FILL, SEE GEOTECH REPORT
 - 17 COMPACTED SUBGRADE, SEE GEOTECH REPORT
 - 18 RESILIENT BASE, SEE FINISH SCHEDULE
 - 19 THRU WALL FLEXIBLE FLASHING
 - 20 60 MIL FLEECE BACK FULLY ADHERED WHITE PVC ROOF MEMBRANE
 - 21 LIGHTWEIGHT CELLULAR INSULATING CONCRETE WITH R25 EPS BOARD AT CONDITIONED SPACES & R12 EPS AT APPARATUS BAY
 - 22 1-1/2 METAL FORM DECK, SEE STRUCTURAL
 - 23 STEEL BAR JOIST, SEE STRUCTURAL, PAINT WHERE EXPOSED TO VIEW
 - 24 FINISH CEILING, SEE FINISH SCHEDULE
 - 25 STEEL BEAM, SEE STRUCTURAL
 - 26 STEEL COLUMN, SEE STRUCTURAL
 - 27 GALVANIZED TUBE STEEL COLUMNS, BEAMS & RAFTERS WITH HIGH PERFORMANCE COATING, SEE STRUCTURAL
 - 28 STANDING SEAM STRUCTURAL PRE-FINISHED 22 GA. GALV. STEEL ROOF
 - 29 26 GA. GALV. PREFINISHED STEEL FLASHING
 - 30 #5 REBAR CONTINUOUS
 - 31 45° CHAMFER
 - 32 1/2" ASPHALTIC BOARD
 - 33 EYE & PINTLE ADJUSTABLE MASONRY ANCHOR AT 16" O.C., EACH WAY, STAGGERED
 - 34 REINFORCED CONCRETE BEAM, RUB EXPOSED SURFACES SMOOTH, FILL ALL VOIDS & CAVITIES, SEE STRUCTURAL. PROVIDE ONE COAT OF COLORED ACRYLIC STUCCO.
 - 35 OVERHEAD COILING DOOR & TRACK, IMPACT & STORM RATED
 - 36 BRICK WINDOW SURROUND, SEE WINDOW DETAILS.
 - 37 ALUMINUM STOREFRONT IMPACT RATED, INSULATED WINDOW
 - 38 REINFORCED CONCRETE WALL, SEE STRUCTURAL, PAINT WHERE EXPOSED TO VIEW
 - 39 CELLULAR ACOUSTICAL ROOF DECK (EPIC METALS - TORIS 5.5, PRE-FINISHED, BASIS OF DESIGN).
 - 40 4"x4"x1/2" ANGLE, CAST IN PLACE, WITH WELDED 6" STUDS AT 12" O.C.
 - 41 POURABLE TRAFFIC RATED JOINT FILLER. FILL JOINT SOLID
 - 42 CONCRETE APRON, SEE CIVIL
 - 43 5/8" GYPSUM BOARD
 - 44 3-5/8" x 20 GA. STEEL STUDS AT 16" O.C.
 - 45 3-1/2" KRAFT FACED FIBERGLASS INSULATION
 - 46 12" CMU, SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL ALL UNFILLED WITH FOAM INSULATION
 - 47 FULLY-ADHERED PVC MEMBRANE WALL FLASHING
 - 48 PRECAST CONCRETE COPING

WALL SECTIONS


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

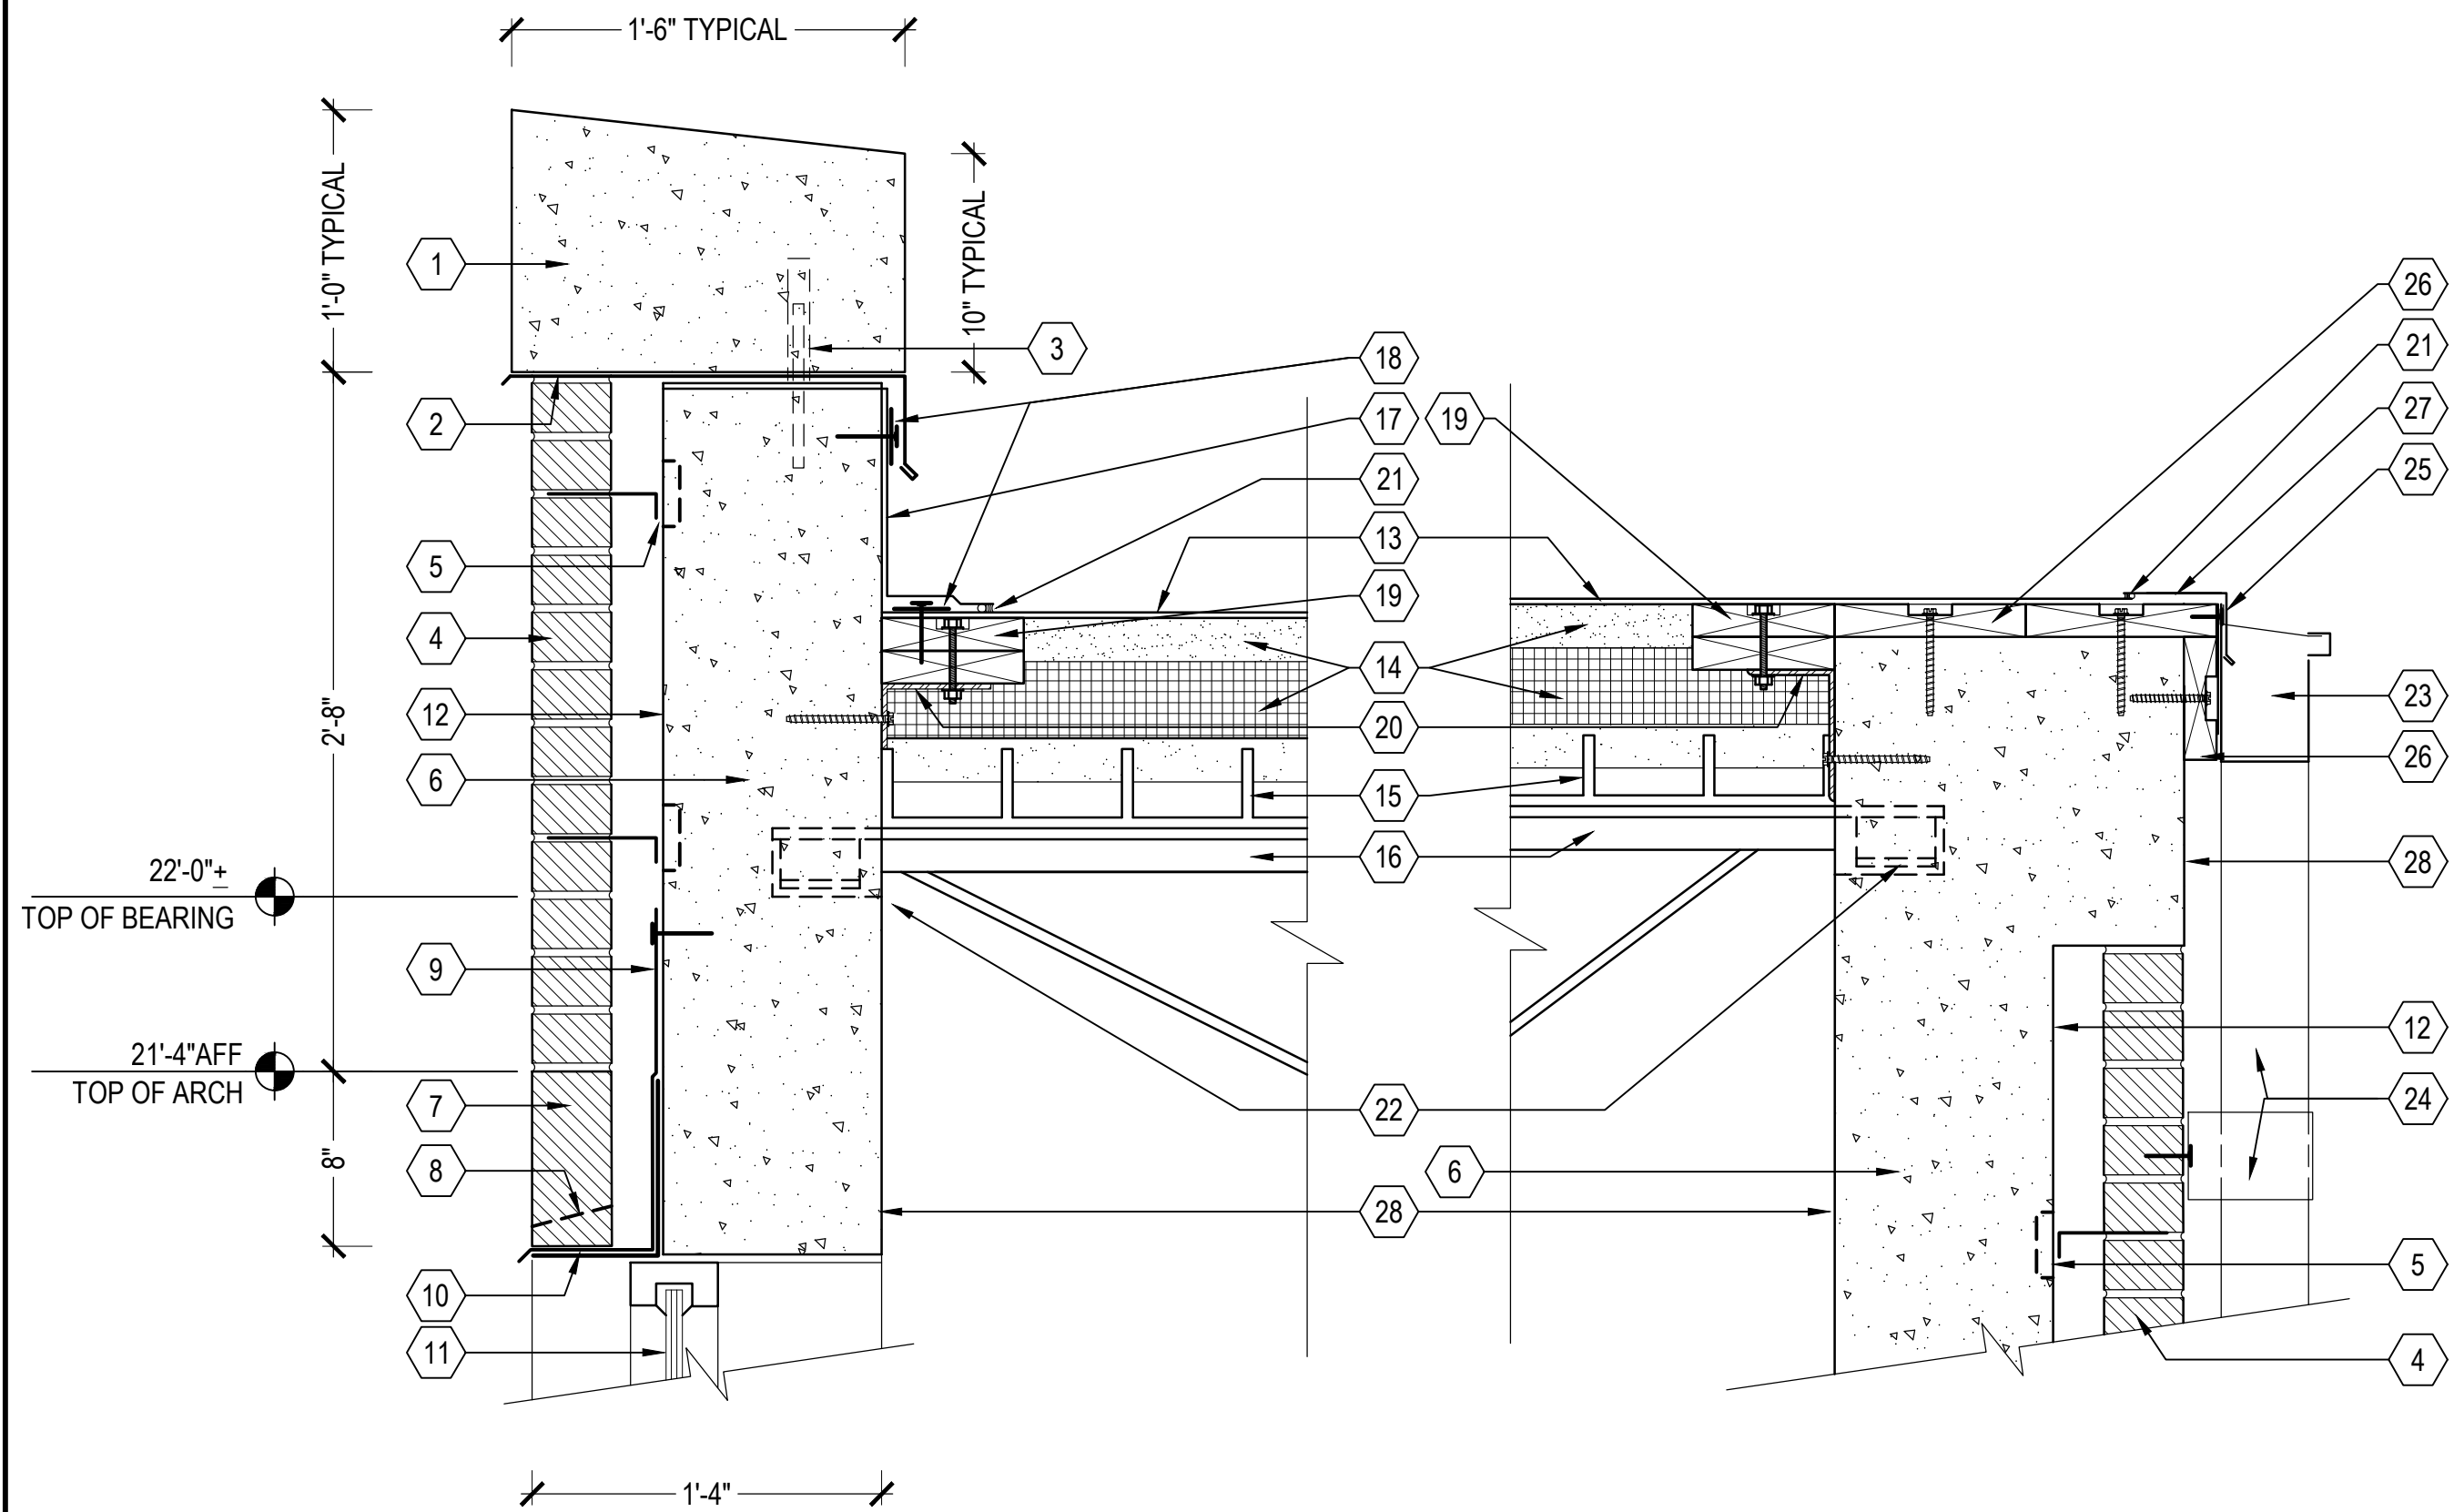


1 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

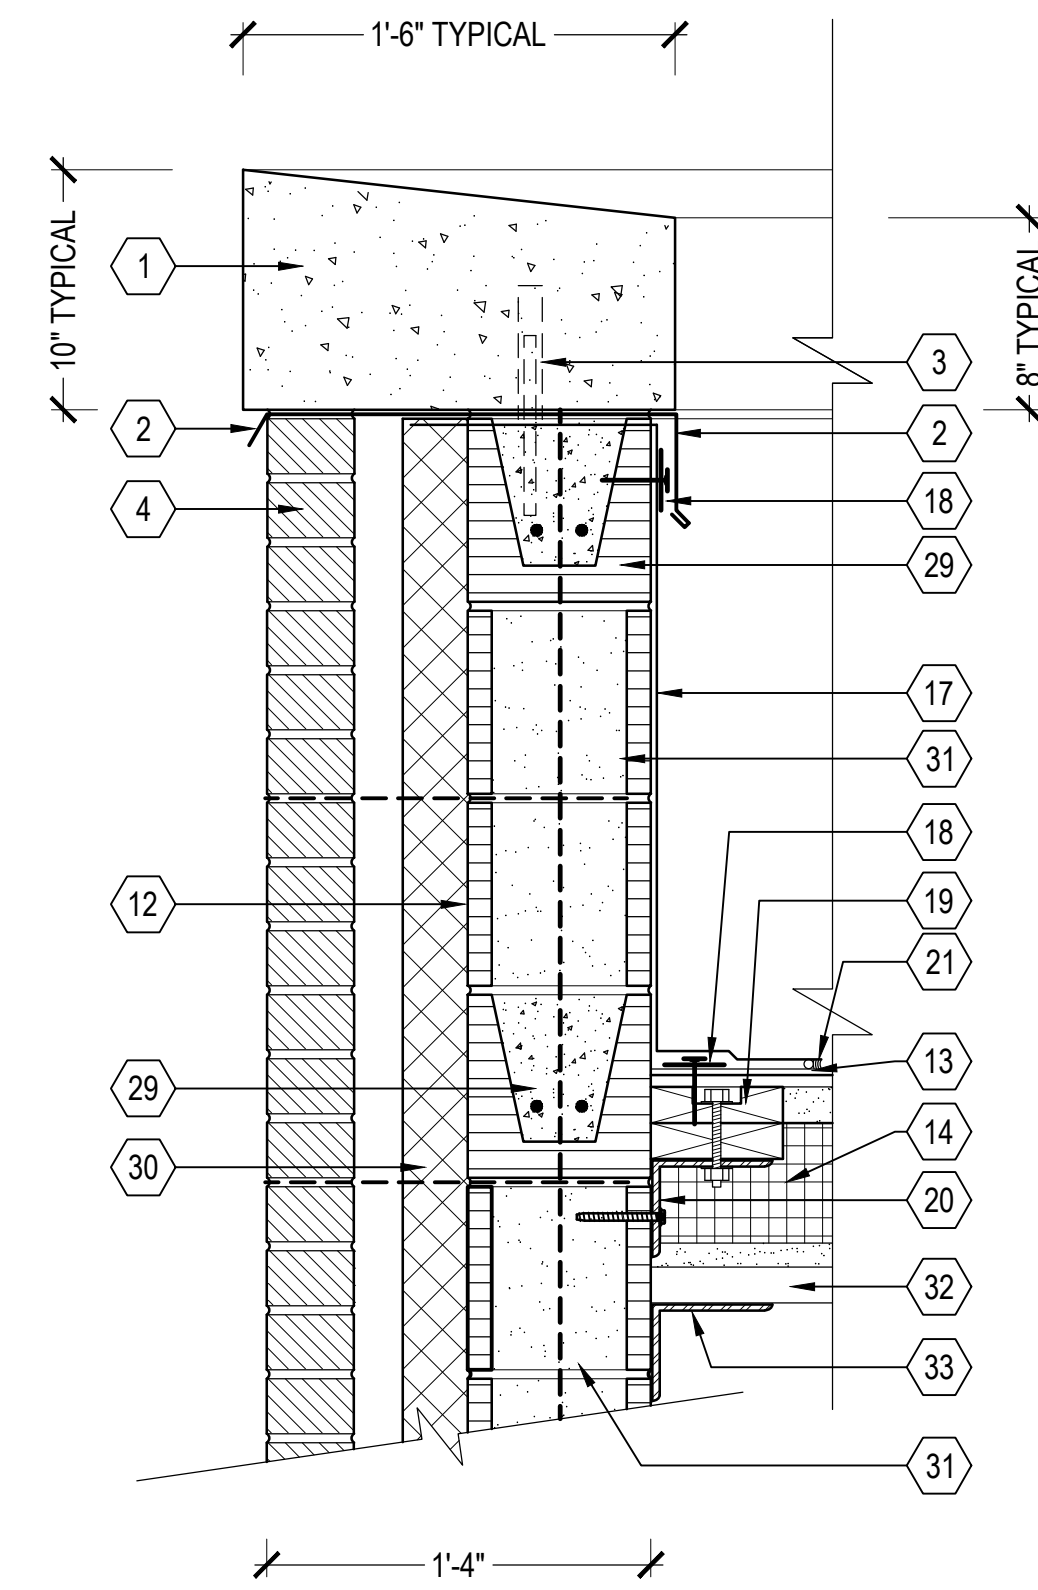


NOTE: FILL ALL CELLS ABOVE ROOF LINE WITH CONCRETE, TYPICAL


3 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

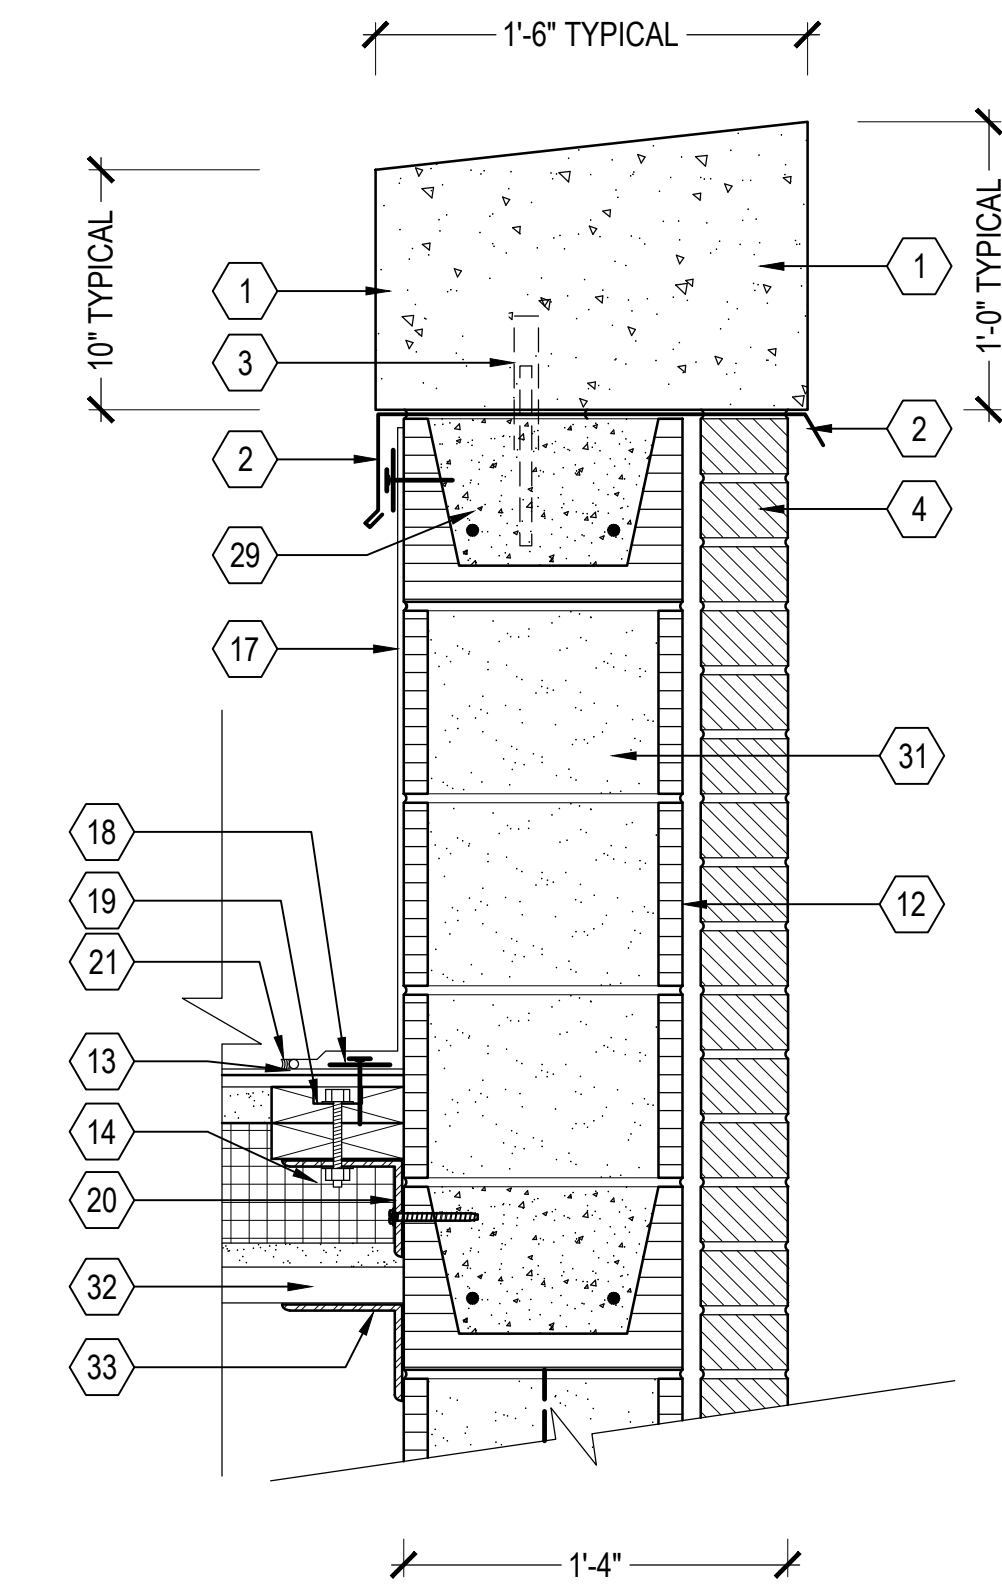

4 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

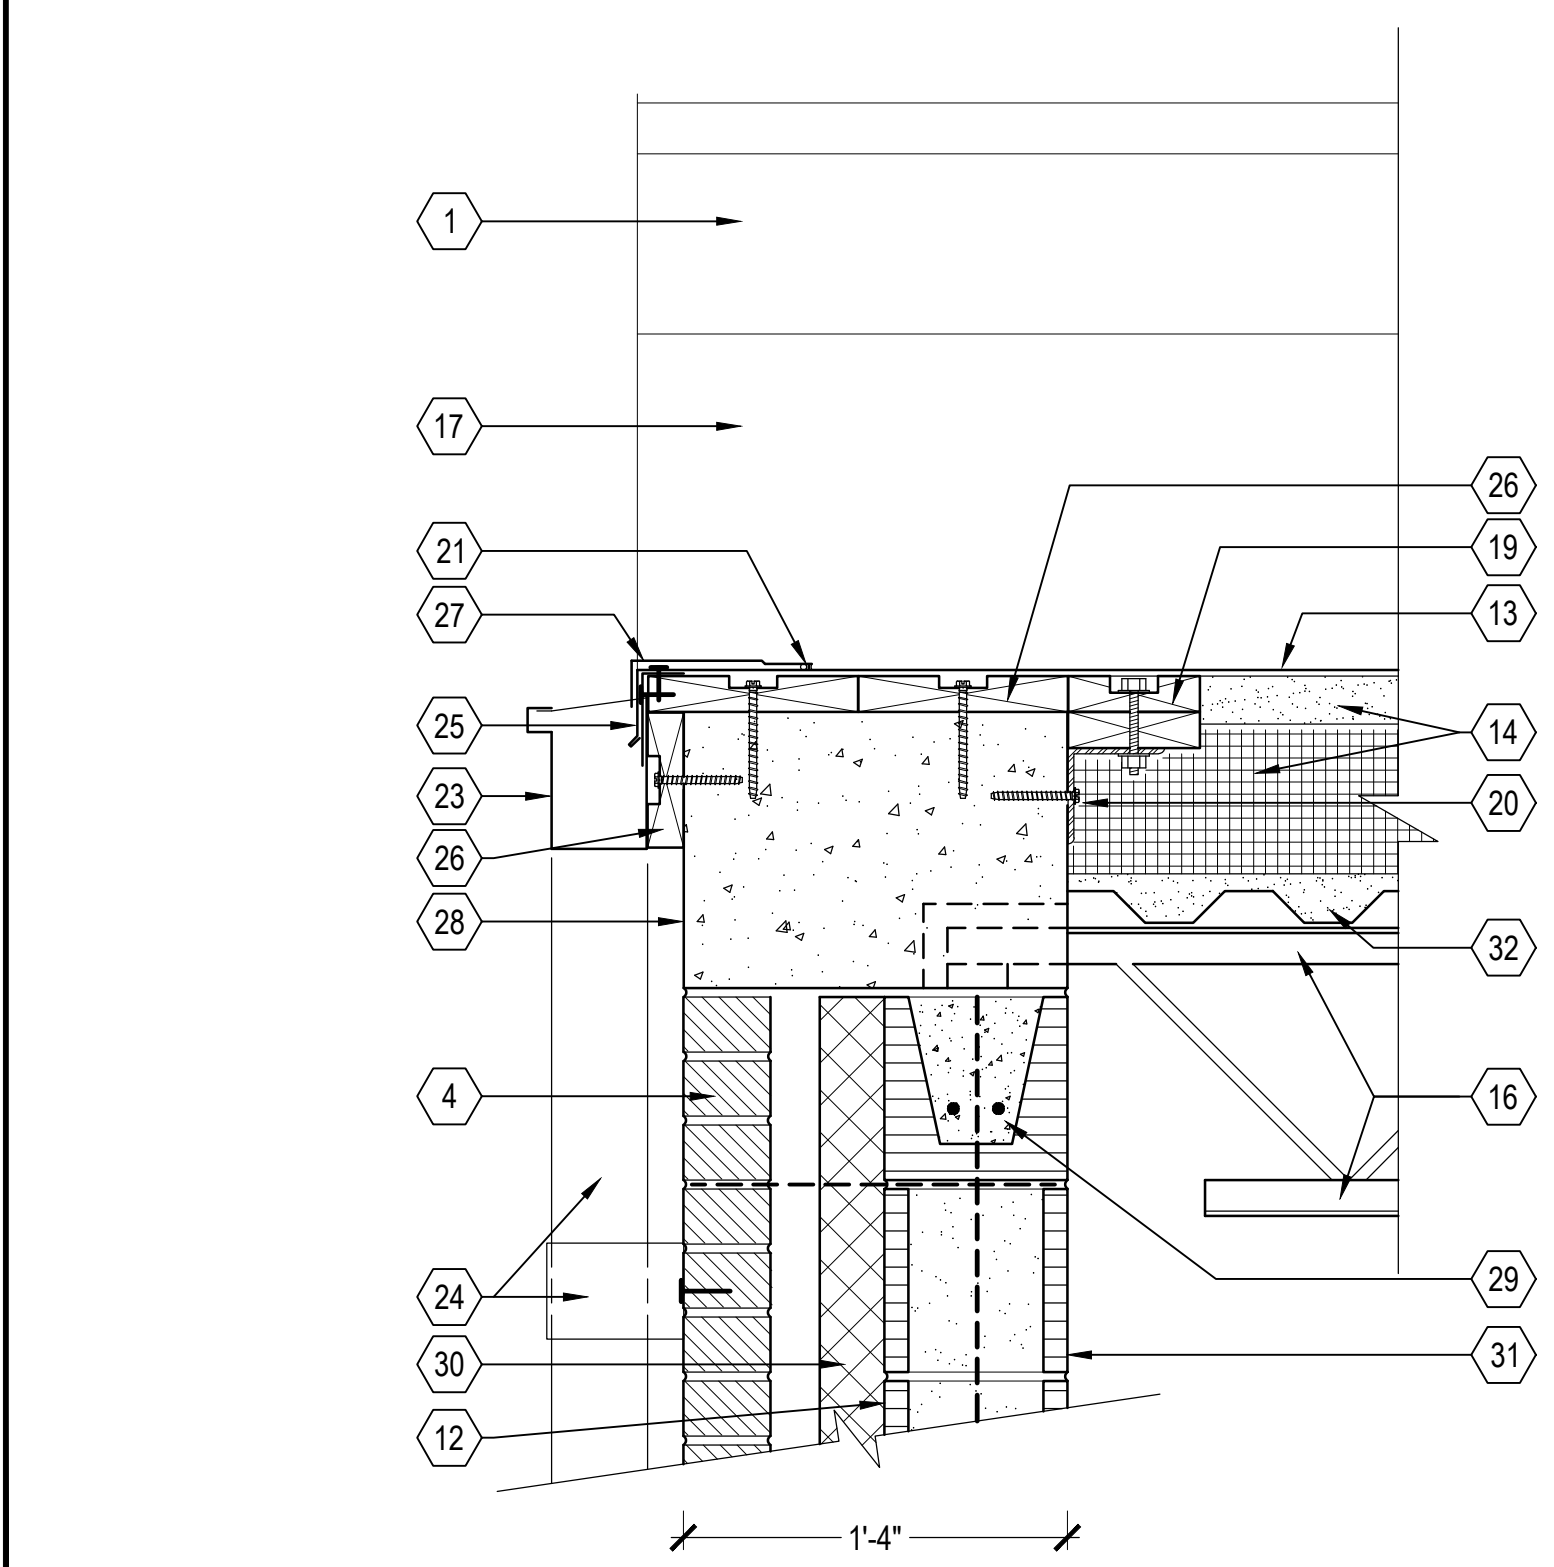


5 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

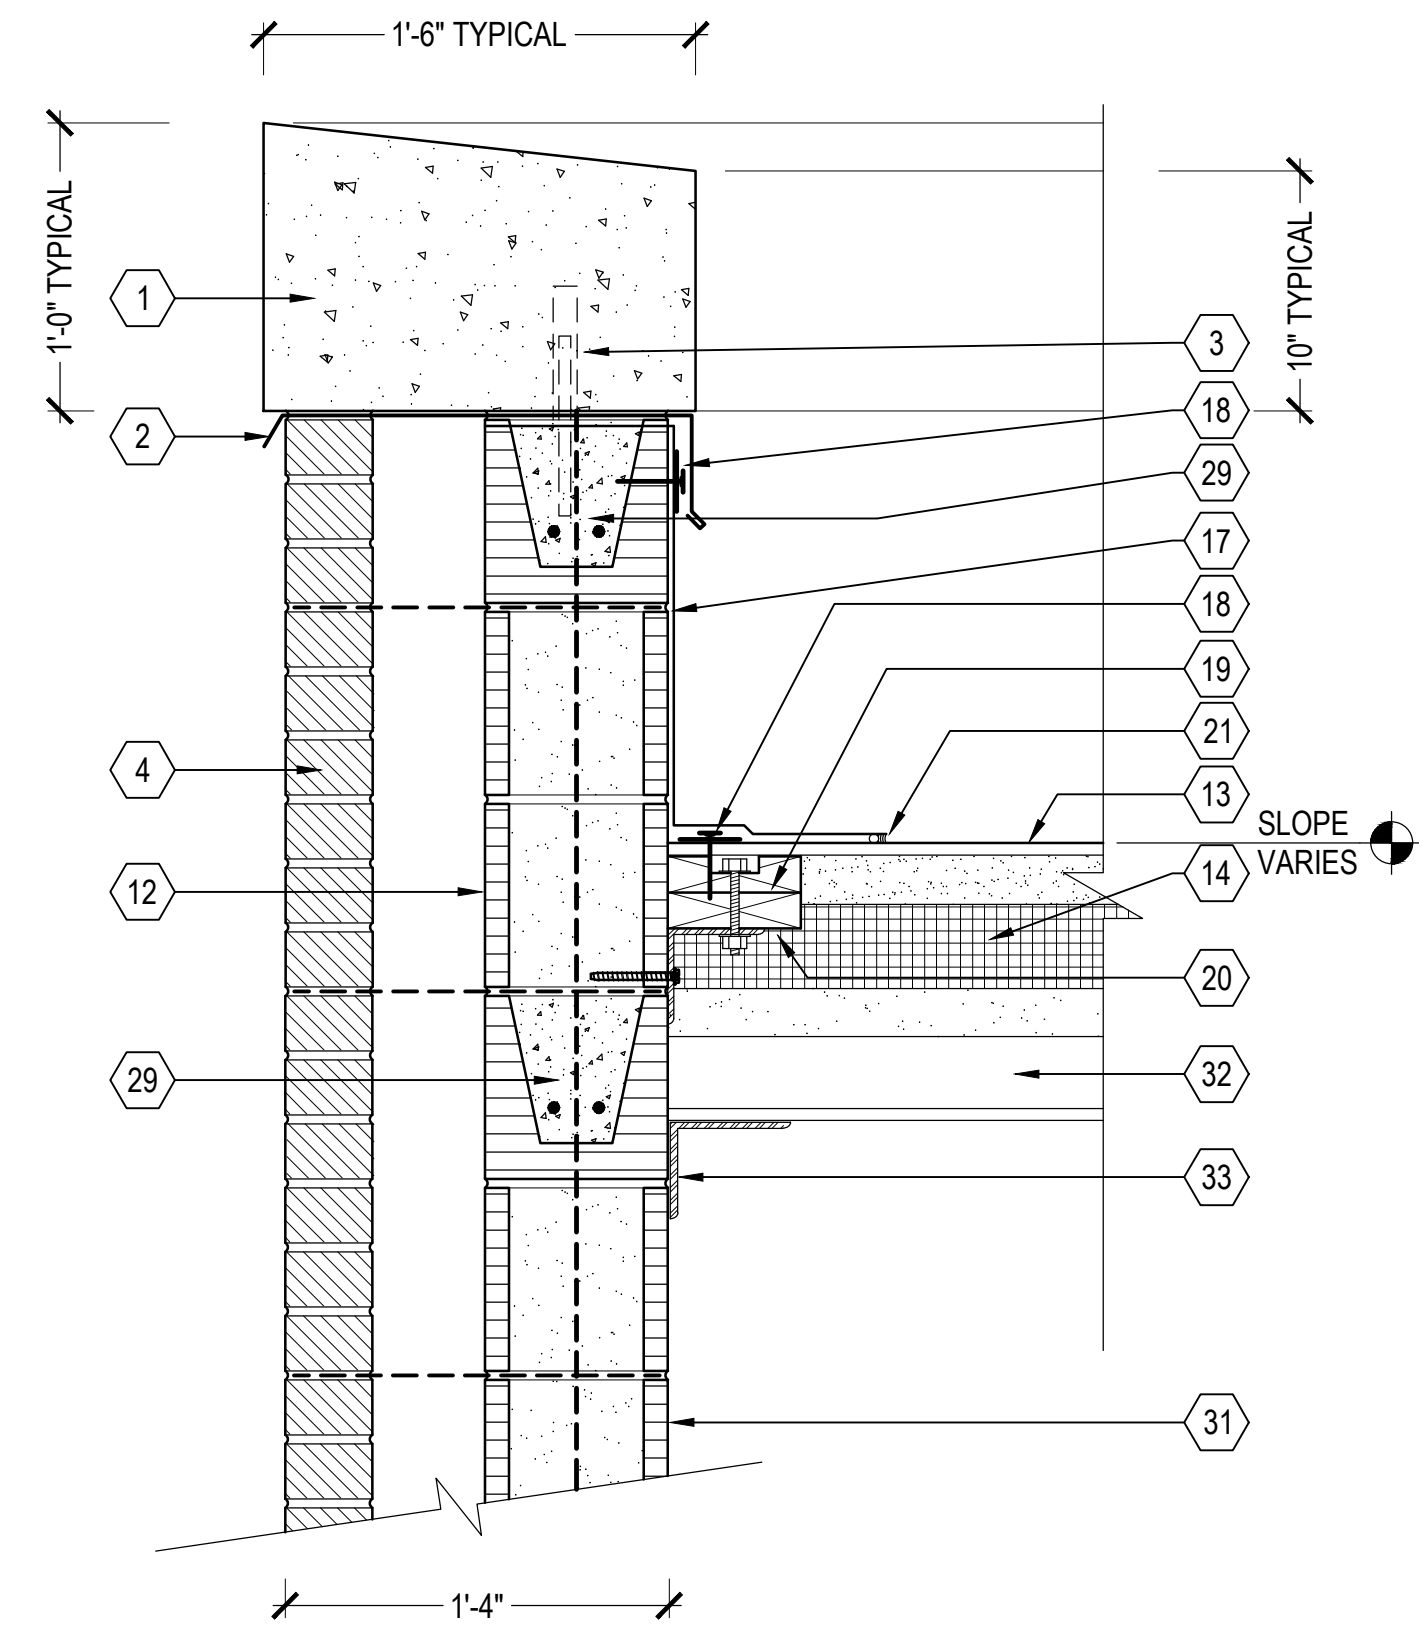

NOTE: FILL ALL CELLS ABOVE ROOF LINE WITH CONCRETE, TYPICAL

6 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

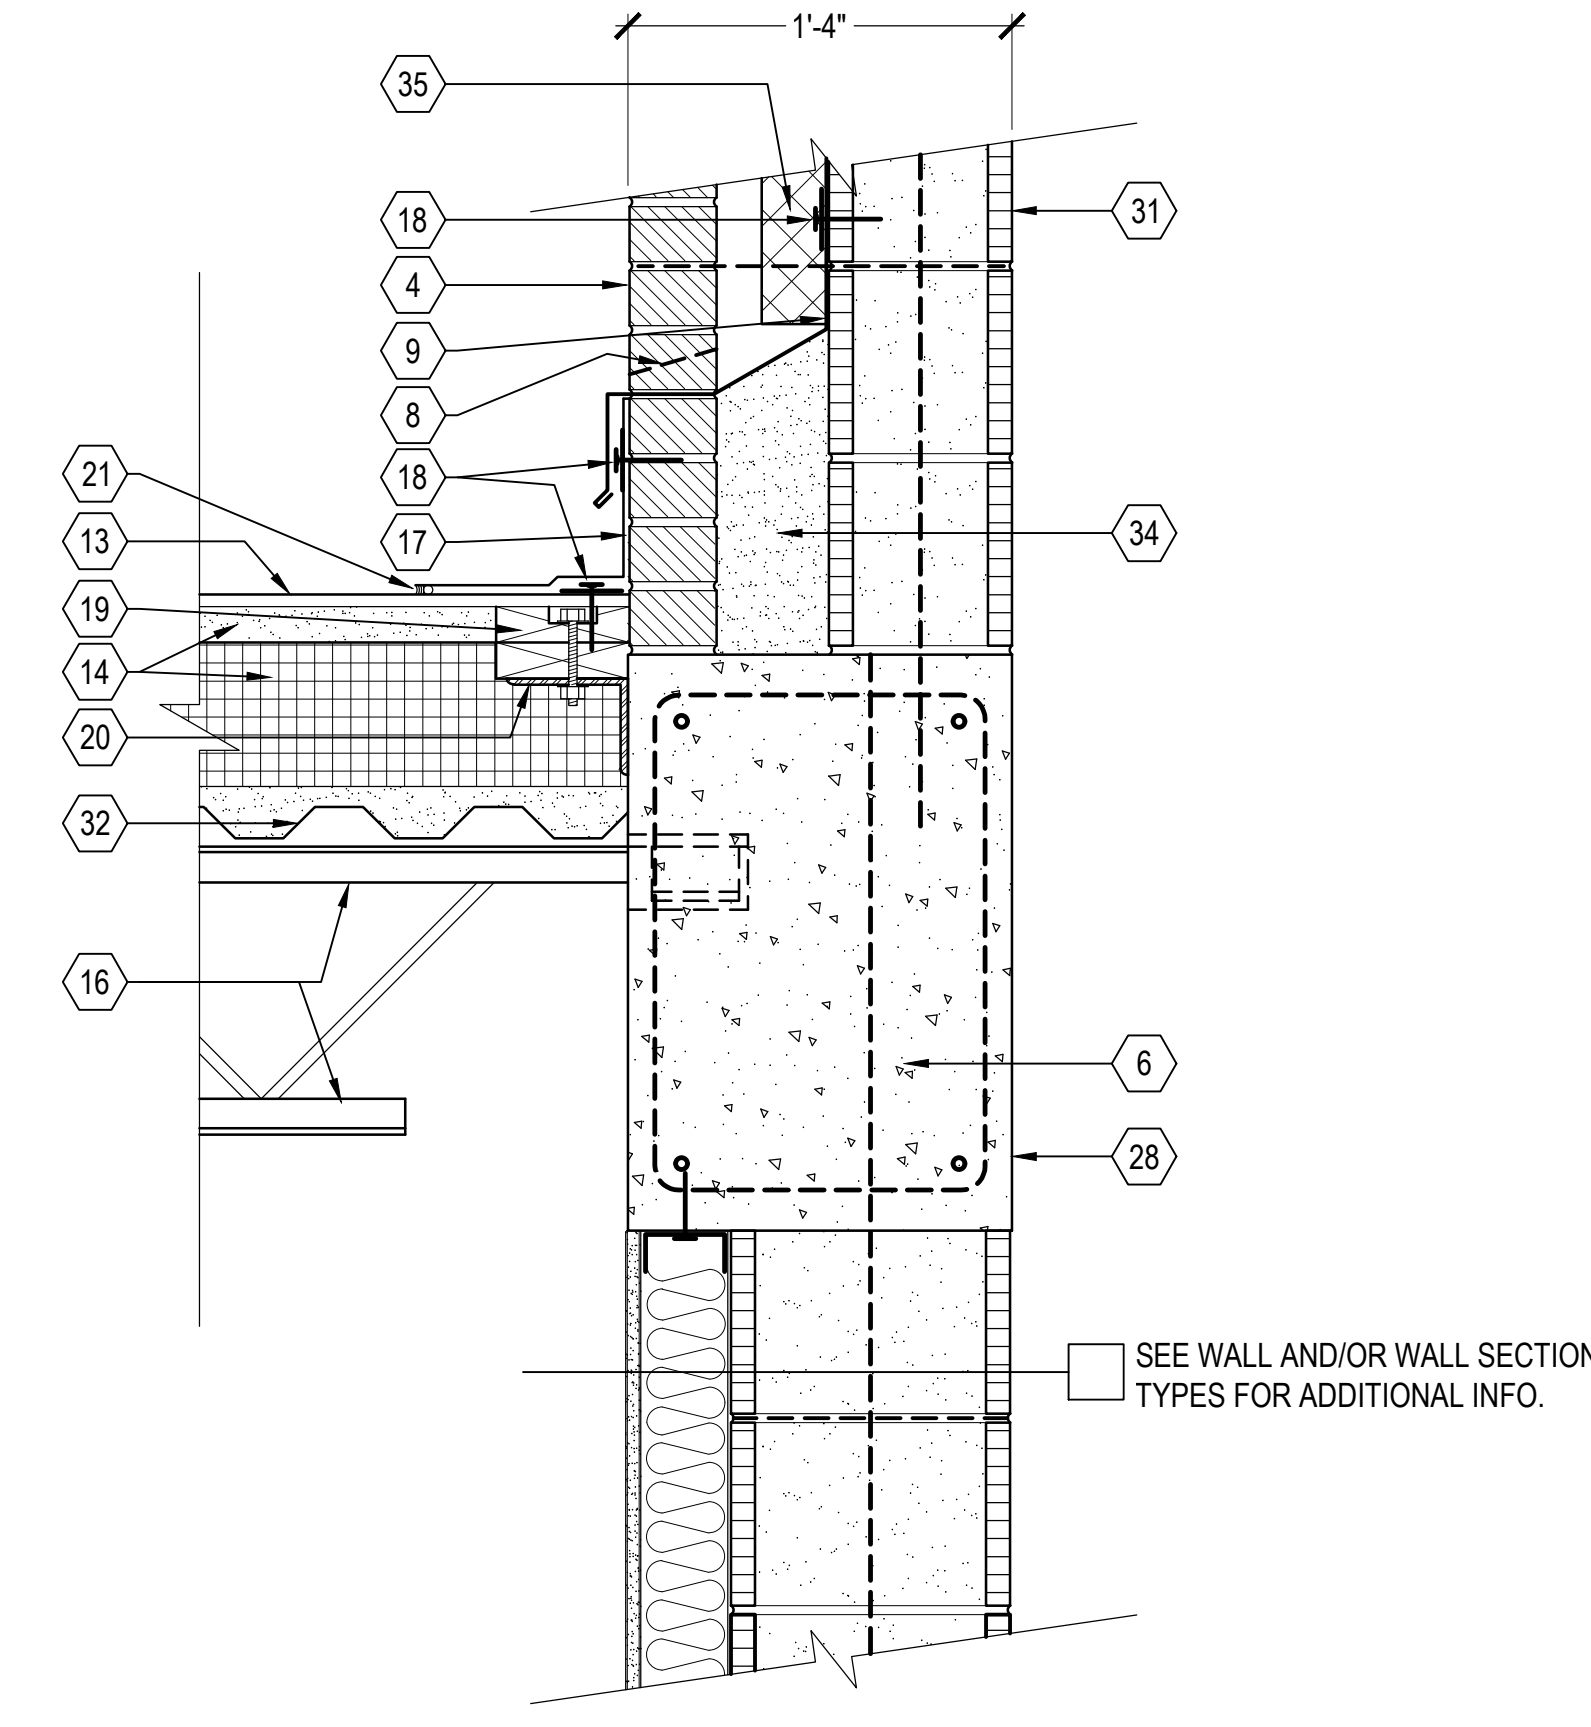

7 WALL DETAIL
A311 SCALE: 1-1/2"=1'-0"

KEYNOTES

- 1 PRECAST CONCRETE COPING, SEE SHEET A321 & A322 FOR DETAILS.
- 2 20 GA. STAINLESS STEEL COPING FLASHING. FORM DRIP EDGE.
- 3 1/2" DIA. STAINLESS STEEL PIN, MIN 2 PER PIECE, SET IN GROUT.
- 4 FACE BRICK, RUNNING BOND.
- 5 CAST IN PLACE BRICK ADJUSTABLE ANCHOR AT 16" O.C., EACH WAY.
- 6 CAST IN PLACE CONCRETE BEAM, SEE STRUCTURAL.
- 7 FACE BRICK SOLDIER COURSE BRICK ARCH.
- 8 WEEP HOLE.
- 9 FLEXIBLE MEMBRANE THROUGH WALL FLASHING.
- 10 8"x4"x1/4" GALV. RADIUS BENT STEEL PLATE.
- 11 FIXED ALUMINUM WINDOW, SEE SHEET A701.
- 12 FLUID APPLIED VAPOR BARRIER.
- 13 60 MIL FLEECE BACK FULLY ADHERED WHITE PVC ROOF MEMBRANE.
- 14 LIGHTWEIGHT CELLULAR INSULATING CONCRETE WITH R25 EPS BOARD AT CONDITIONED SPACE AND R12 EPS AT APPARATUS BAY.
- 15 CELLULAR ACOUSTICAL ROOF DECK - BASIS OF DESIGN: EPIC METALS "TORIS" S.S., PREFINISHED
- 16 BAR JOIST, SEE STRUCTURAL.
- 17 48 MIL, FULLY ADHERED PARAPET FLASHING, EXTEND UNDER SST FLASHING.
- 18 TERMINATION BAR, CONTINUOUS. FASTEN AT 12" O.C.
- 19 2x6 P.T. WOOD BLOCKING, BOLT TO ANGLE WITH 3/8" BOLTS AT 2'-0" O.C. PROVIDE ADDITIONAL BOLTS AT 1'-0" O.C., TO 6'-0" FROM CORNERS EACH WAY.
- 20 4"x4"x1/4" GALV. ANGLE, CONT., WITH 1/2"x4" TAPCON SCREWS AT 2'-0" O.C. PROVIDE ADDITIONAL SCREWS AT 1'-0" O.C. TO 6'-0" FROM CORNERS, EACH WAY. BACK PRIME WITH ASPHALTIC PAINT WHERE CONTACTING CONCRETE AND P.T. WOOD.
- 21 SEALANT.
- 22 BEARING POCKET, SEE STRUCTURAL.
- 23 8"x6"x4" PRE-FINISHED 0.032" ALUMINUM GUTTER, WITH BRACKETS AT 4'-0" O.C. BACK PRIME WITH ASPHALTIC PAINT WHERE IN CONTACT WITH P.T. WOOD, STEEL OR ANY OTHER DISSIMILAR MATERIAL.
- 24 6"x4" PRE-FINISHED 0.032" ALUMINUM DOWNSPOUT WITH A MINIMUM OF 3 STANDOFF BRACKETS.
- 25 4"x4"x0.032 PRE-FINISHED COUNTER-FLASHING. SCREW TO BLOCKING AT 12" O.C. WITH GASKETED DOME SCREWS
- 26 2"x P.T. BLOCKING WITH 1/2"x4" TAPCON SCREWS AT 24" O.C. PROVIDE ADDITIONAL SCREWS AT 1'-0" O.C., 6'-0" FROM CORNER.
- 27 48 MIL PVC LAP FLASHING
- 28 RUB EXPOSED SURFACE SMOOTH, FILL ALL VOIDS & CAVITIES. PROVIDE ONE COAT OF COLORED ACRYLIC STUCCO WHERE INDICATED.
- 29 8"/12" CMU BOND BEAM: SEE STRUCTURAL FOR REINFORCING, FILL WITH CONCRETE.
- 30 2" EXPANDED POLYSTYRENE RIDGID BOARD INSULATION. ADHERE TO CMU.
- 31 8"/12" CMU WITH HORIZONTAL 9 GAUGE GALV. WIRE REINFORCING AT 16" O.C. VERTICAL. SEE STRUCTURAL FOR VERTICAL REINFORCING. FILL ALL UN-FILLED CELLS WITH FOAM INSULATION, UNO.
- 32 1-1/2" METAL DECK: SEE STRUCTURAL
- 33 ROOF ANGLE: SEE STRUCTURAL
- 34 FILL COLLAR JOINT SOLID, SLOPE TOP TO DRAIN
- 35 NON-WOVEN MORTAR MESH
- 36 STEEL COLUMN, SEE STRUCTURAL
- 37 5/8" GYPSUM BOARD, SEE WALL TYPES
- 38 6"x20 GA. GALV. STEEL STUDS
- 39 3-5/8"x20 GA. GALV. STEEL STUDS


WALL
DETAILS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision		


Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

A311
SHEET #

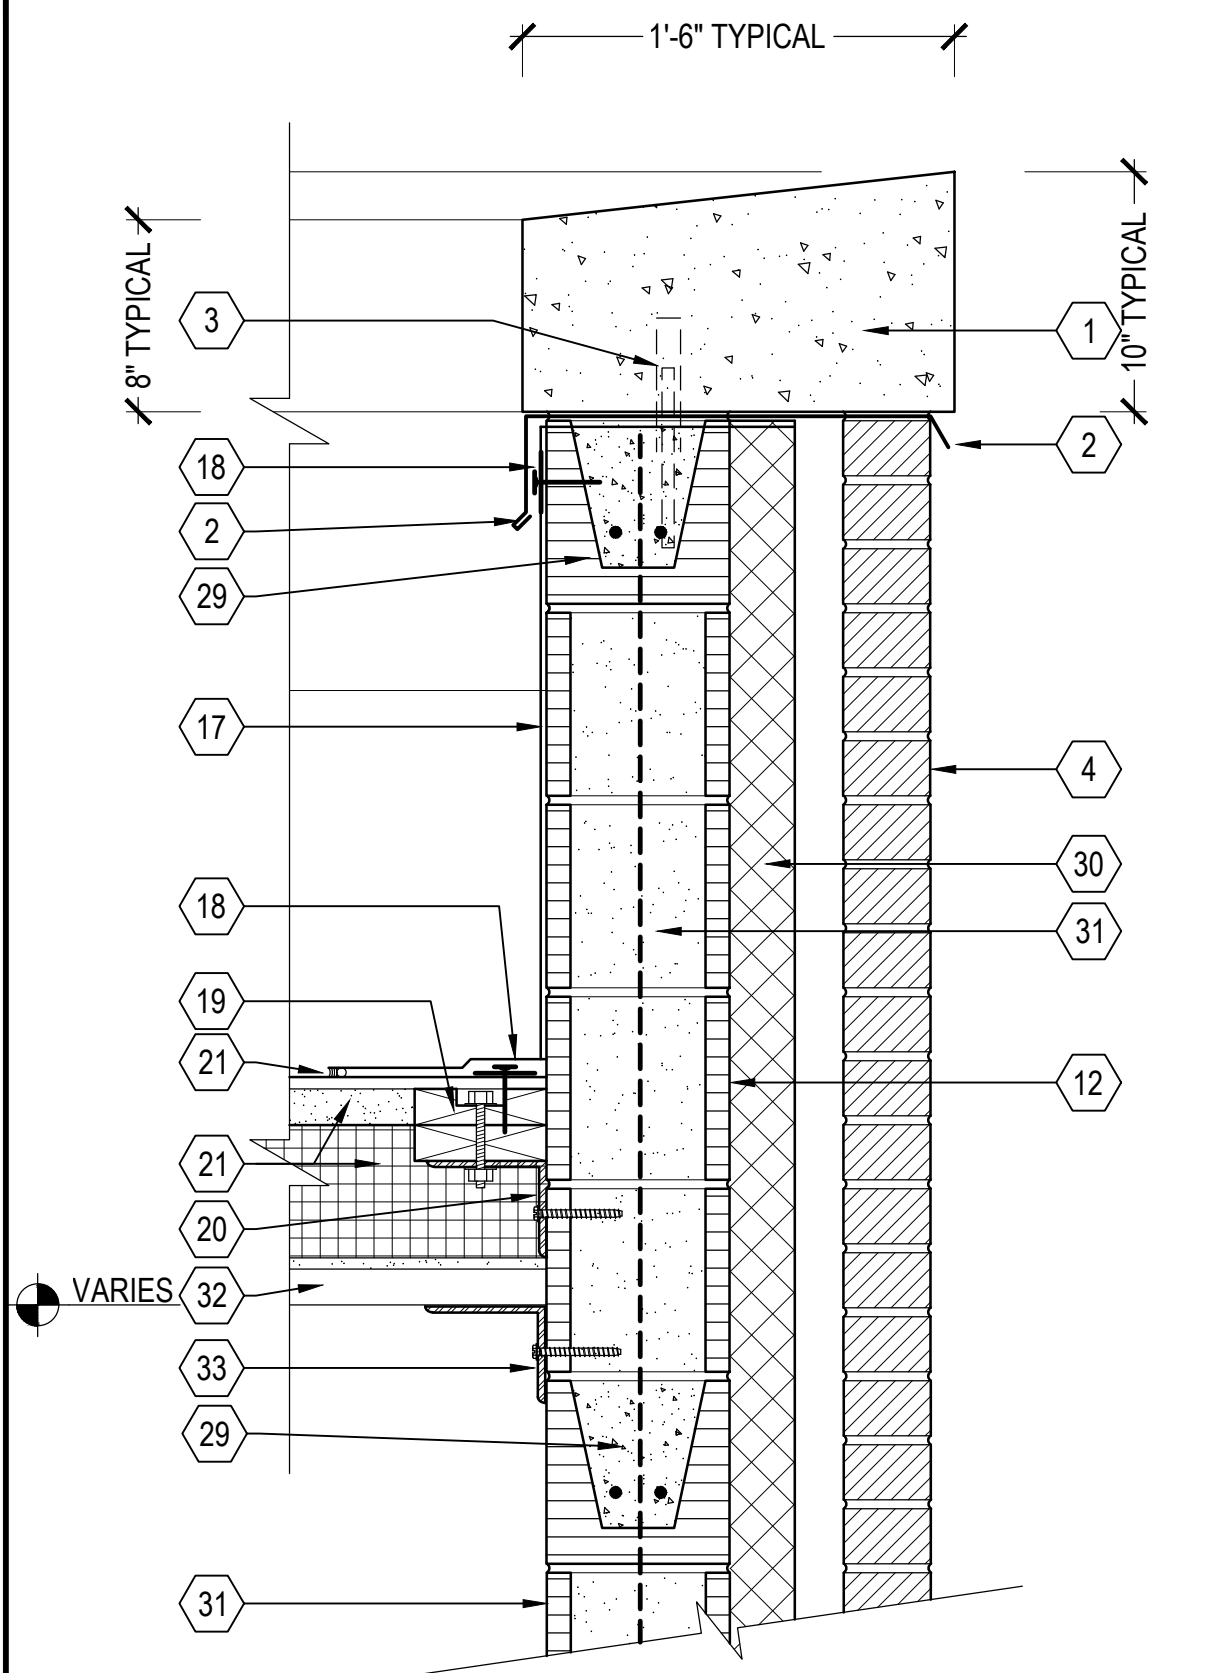


NOTE: FILL ALL CELLS ABOVE ROOF LINE WITH CONCRETE, TYPICAL

1 WALL DETAIL
A312 SCALE: 1-1/2"=1'-0"

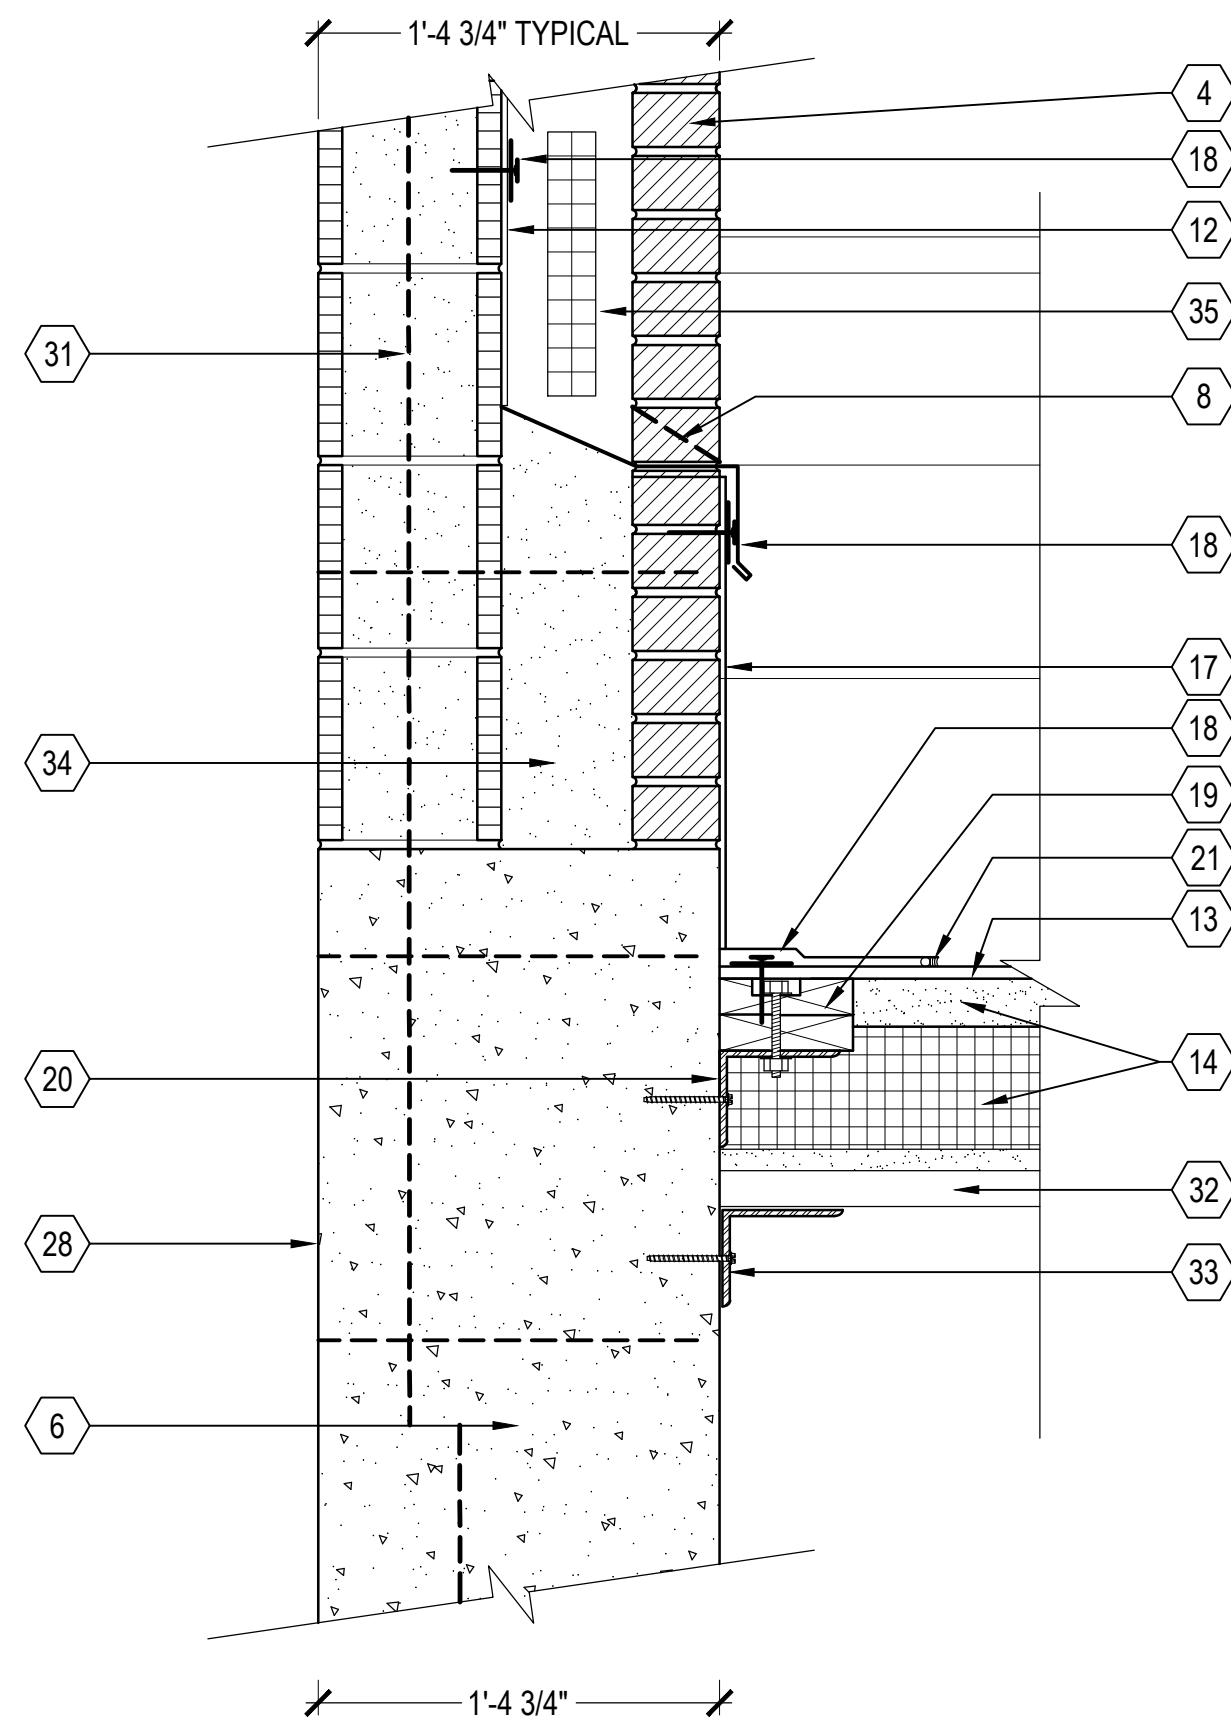


2 WALL DETAIL
A312 SCALE: 1-1/2"=1'-0"

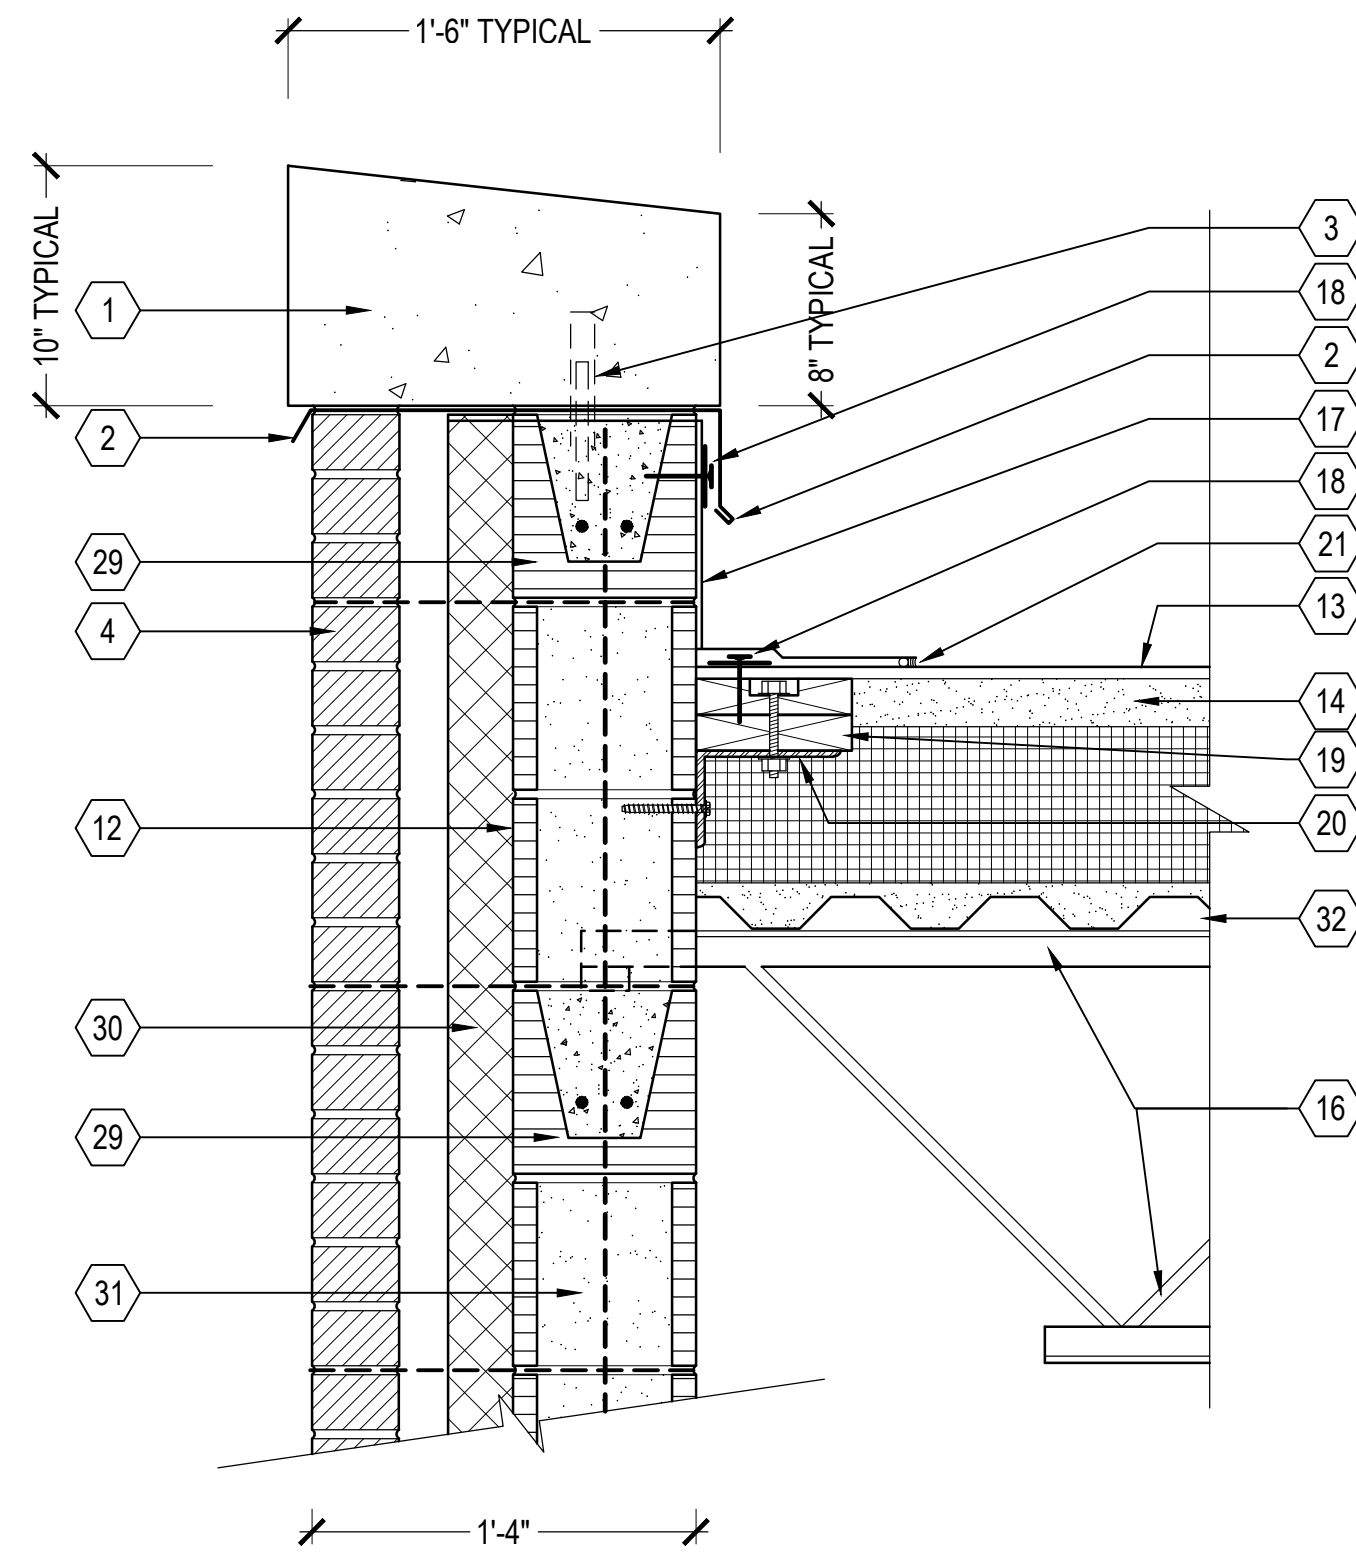


NOTE: FILL ALL CELLS ABOVE ROOF LINE WITH CONCRETE, TYPICAL


3 WALL DETAIL
A312 SCALE: 1-1/2"=1'-0"

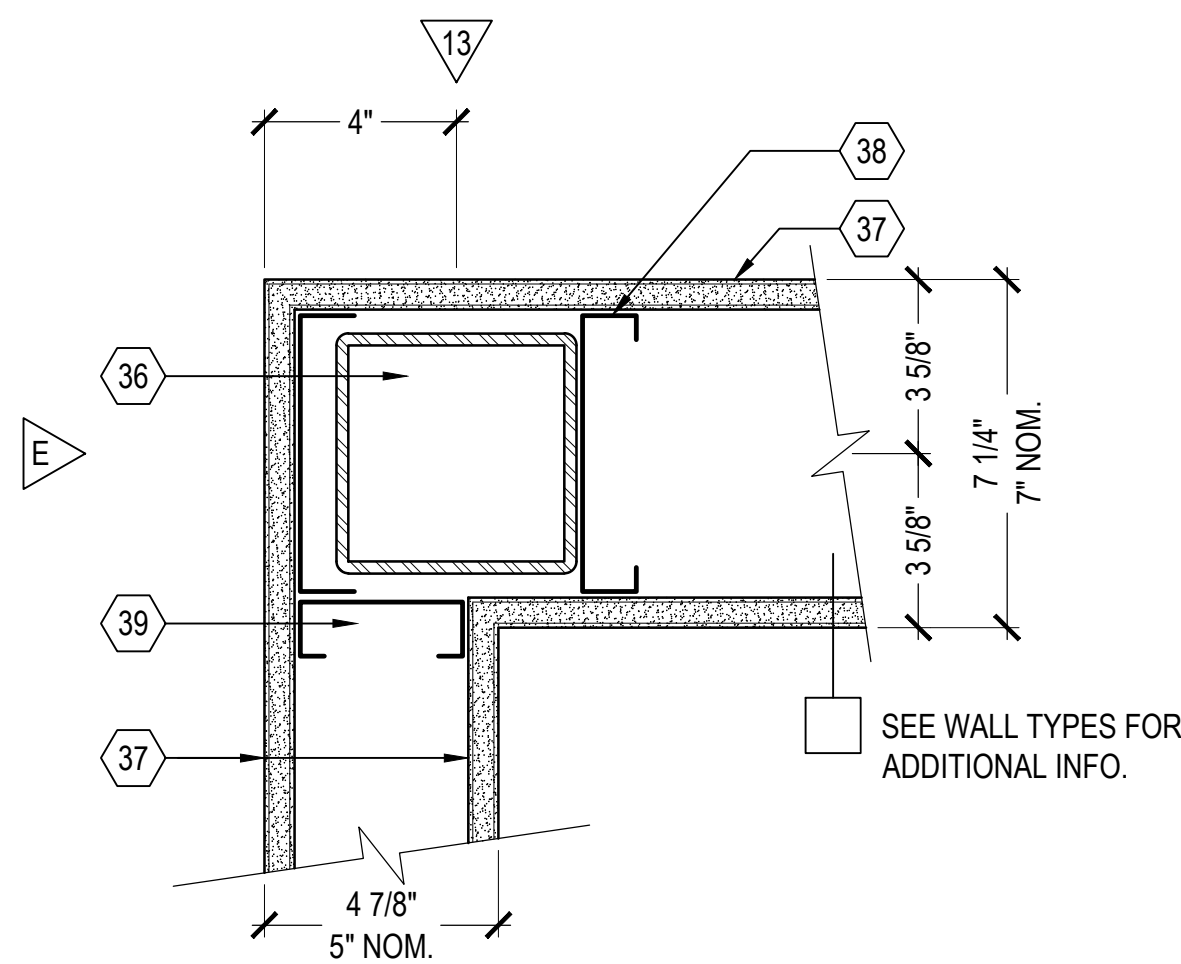


4 INTERIOR COLUMN DETAIL
A312 SCALE: 3"=1'-0"

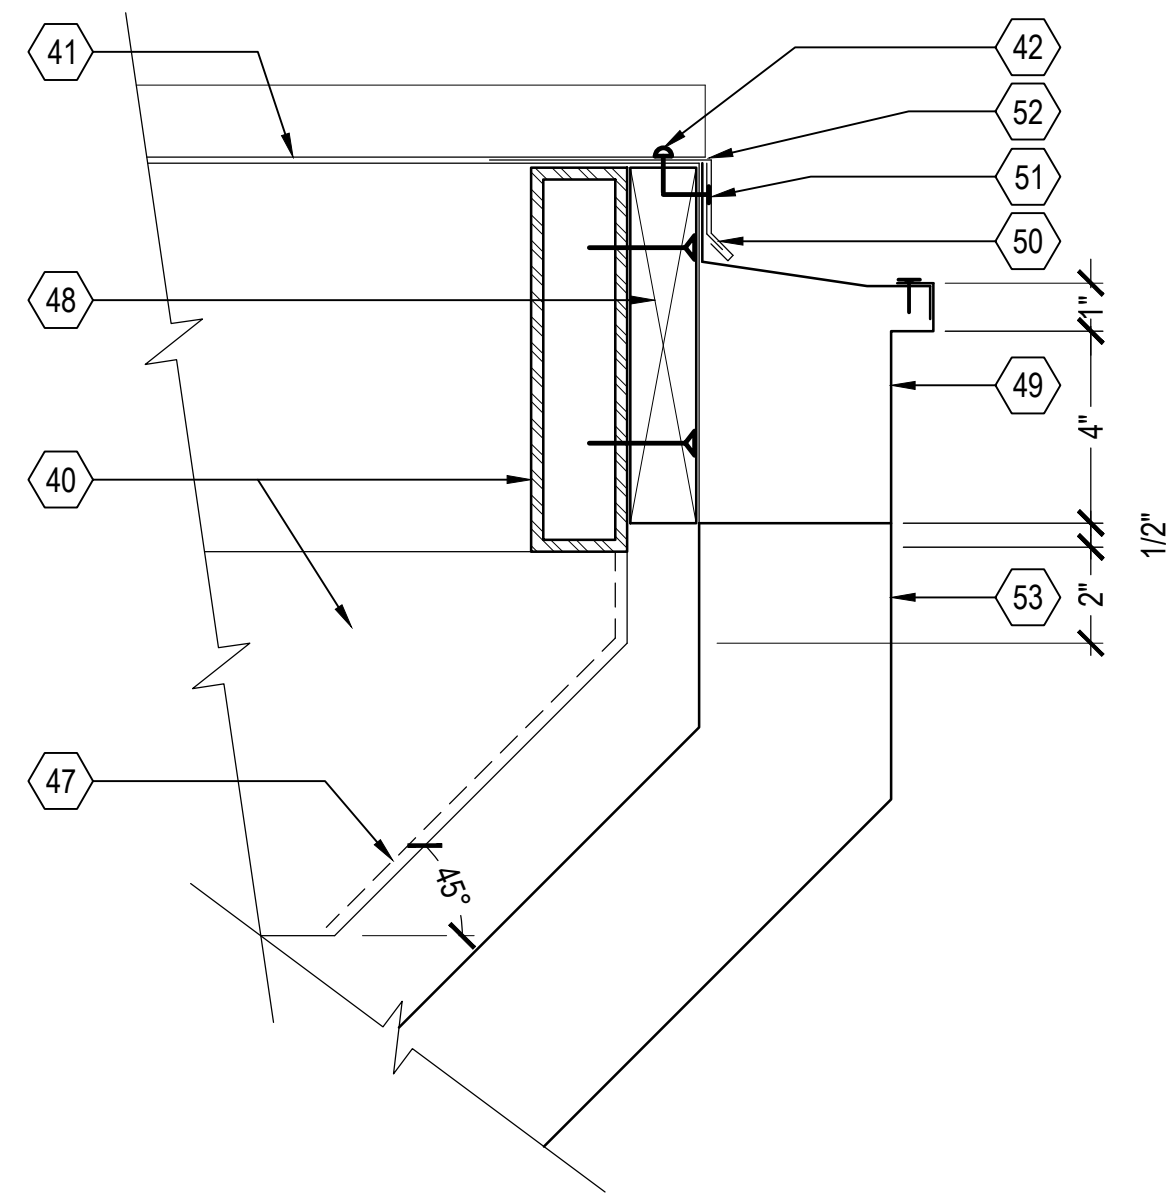


6 CANOPY DETAIL
A312 SCALE: 3"=1'-0"

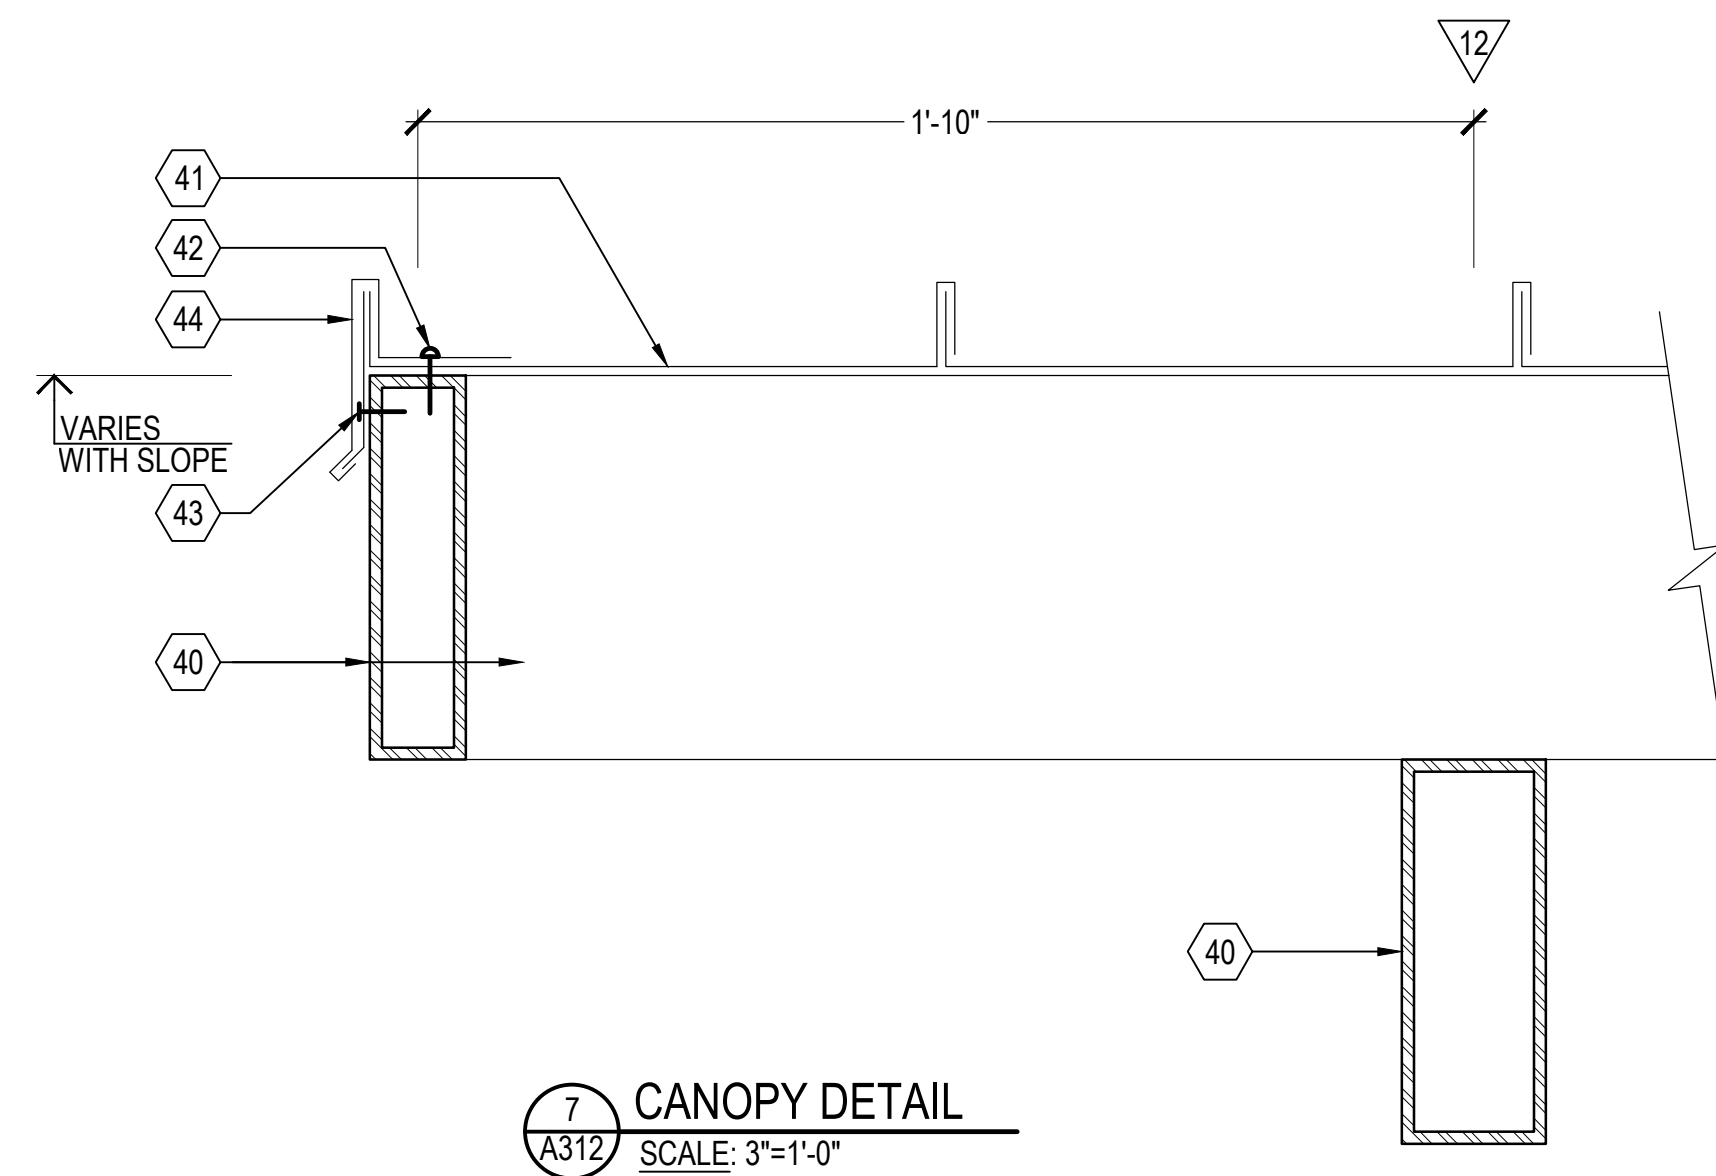

7 CANOPY DETAIL
A312 SCALE: 3"=1'-0"

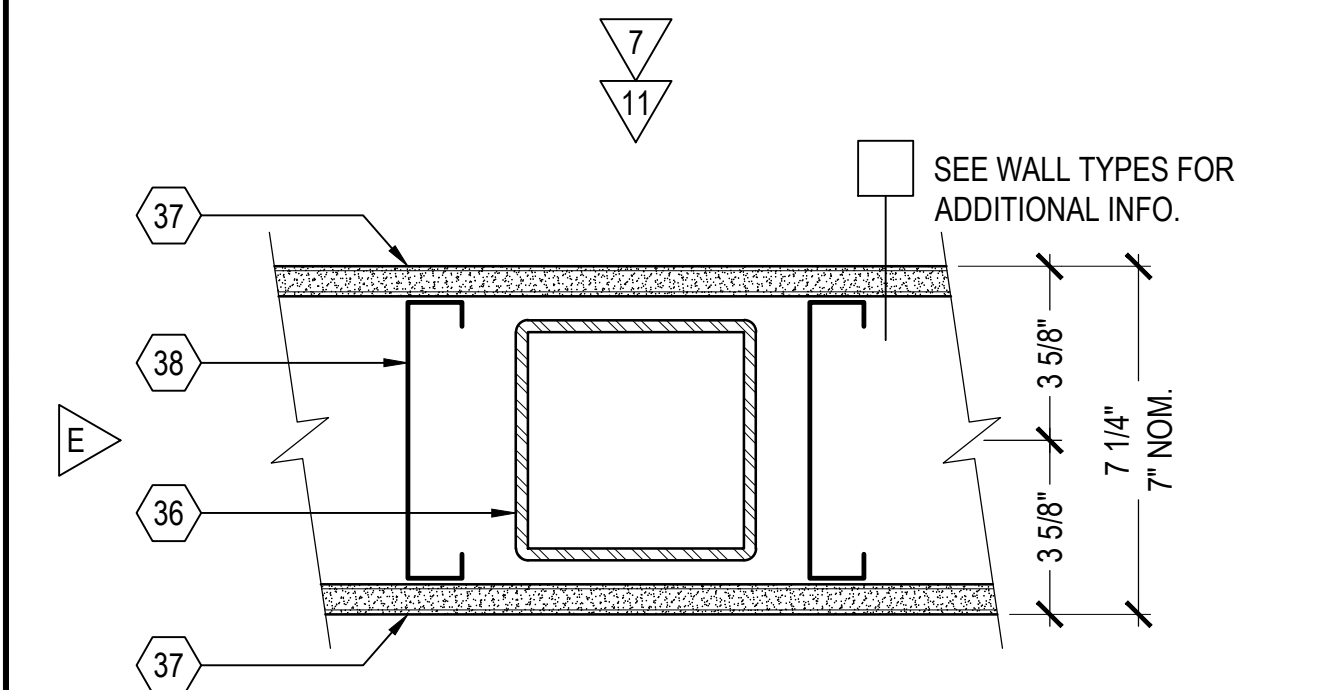

5 INTERIOR COLUMN DETAIL
A312 SCALE: 3"=1'-0"

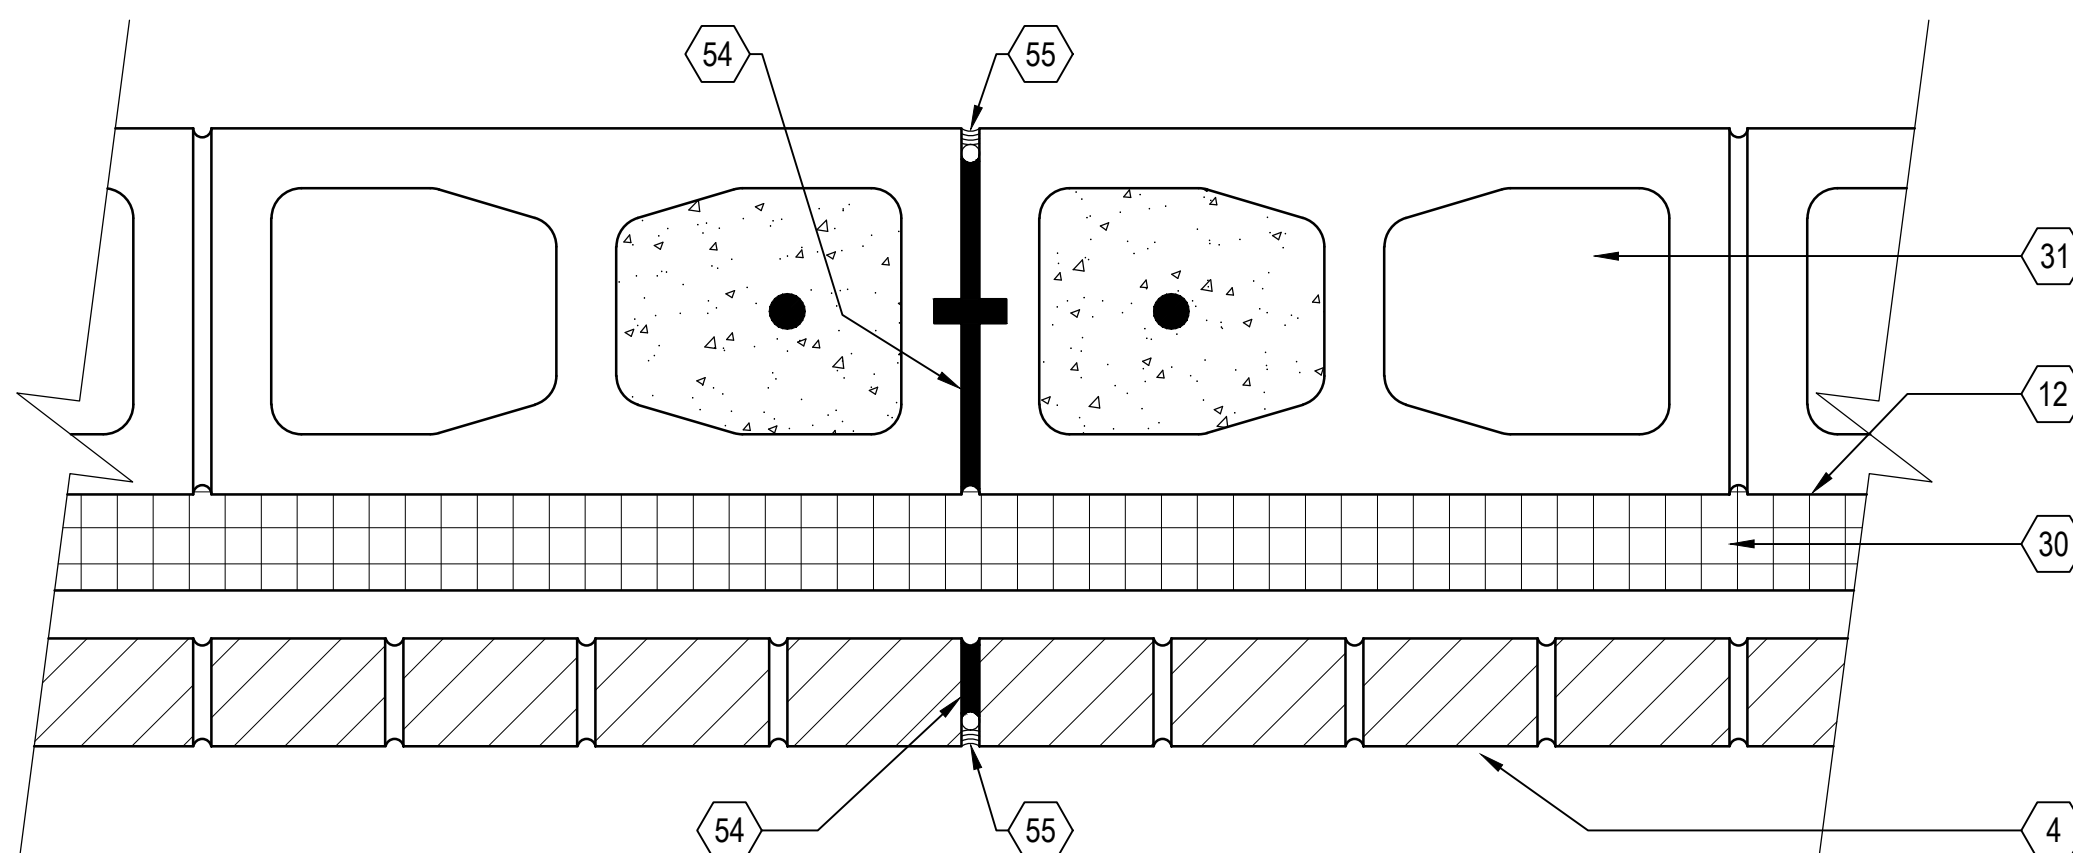

8 TYPICAL MASONRY WALL CONTROL JOINT
A312 SCALE: 3"=1'-0" SEE STRUCTURAL FOR ADDITIONAL INFORMATION

KEYNOTES

- 43 20 GA. GALV. CONTINUOUS CLEAT, WITH SELF TAPPING SCREWS AT 12" O.C.
- 44 22 GA. GALV. PRE-FINISHED FLASHING.
- 45 SELF ADHERING GASKET TAPE
- 46 POP RIVET AT 12" O.C., MIN.
- 47 1/4" STEEL GALV. END CLOSURE PLATE, WELD CONT. TO TUBE STEEL, PAINT TYP.
- 48 2x8 P.T. BLOCKING CONTINUOUS, SCREW TO TUBE STEEL WITH 2- #10 SELF TAPPING SCREWS AT 12" O.C., BACK PRIME WITH NON-FIBRATED ASPHALTIC PAINT.
- 49 7"x5" PRE-FINISHED 0.032 ALUM. GUTTER WITH BRACKETS AT 4'-0" O.C., MAX, BACK PRIME WITH NON-FIBRATED ASPHALTIC PAINT WHERE IN CONTACT WITH P.T. WOOD OR OTHER DISSIMILAR METALS.
- 50 18 GA. GALV. CLEAT CONT. SCREW TO BLOCKING AT 12" O.C.
- 51 24 GA. PRE-FINISHED COUNTER FLASHING.
- 52 SELF ADHERING GASKET TAPE CONT.
- 53 4"x4"x0.032 DOWN SPOUT.
- 54 NEOPRENE JOINT FILLER.
- 55 SEALANT & BACKER ROD; COLOR TO MATCH BRICK / MORTAR AT EXTERIOR

KEYNOTES

- 1 PRECAST CONCRETE COPING, SEE SHEET A321 & A322 FOR DETAILS.
- 2 20 GA. STAINLESS STEEL COPING FLASHING. FORM DRIP EDGE.
- 3 1/2" DIA. STAINLESS STEEL PIN, MIN 2 PER PIECE, SET IN GROUT.
- 4 FACE BRICK, RUNNING BOND.
- 5 CAST IN PLACE BRICK ADJUSTABLE ANCHOR AT 16" O.C., EACH WAY.
- 6 CAST IN PLACE CONCRETE BEAM, SEE STRUCTURAL.
- 7 FACE BRICK SOLDIER COURSE BRICK ARCH.
- 8 WEEP HOLE.
- 9 FLEXIBLE MEMBRANE THROUGH WALL FLASHING.
- 10 8"x4"x1/4" GALV. RADIUS BENT STEEL PLATE.
- 11 FIXED ALUMINUM WINDOW, SEE SHEET A701.
- 12 FLUID APPLIED VAPOR BARRIER.
- 13 60 MIL FLEECE BACK FULLY ADHERED WHITE PVC ROOF MEMBRANE.
- 14 LIGHTWEIGHT CELLULAR INSULATING CONCRETE WITH R25 EPS BOARD AT CONDITIONED SPACE AND R12 EPS AT APPARATUS BAY.
- 15 CELLULAR ACOUSTICAL ROOF DECK - BASIS OF DESIGN: EPIC METALS "TORIS" S.S., PREFINISHED
- 16 BAR JOIST, SEE STRUCTURAL.
- 17 48 MIL, FULLY ADHERED PARAPET FLASHING, EXTEND UNDER SST FLASHING.
- 18 TERMINATION BAR, CONTINUOUS. FASTEN AT 12" O.C.
- 19 2x6 P.T. WOOD BLOCKING, BOLT TO ANGLE WITH 3/8" BOLTS AT 2'-0" O.C. PROVIDE ADDITIONAL BOLTS AT 1'-0" O.C., TO 6'-0" FROM CORNERS EACH WAY.
- 20 4"x4"x1/4" GALV. ANGLE, CONT., WITH 1/2"x4" TAPCON SCREWS AT 2'-0" O.C. PROVIDE ADDITIONAL SCREWS AT 1'-0" O.C. TO 6'-0" FROM CORNERS, EACH WAY. BACK PRIME WITH ASPHALTIC PAINT WHERE CONTACTING CONCRETE AND P.T. WOOD.
- 21 SEALANT.
- 22 BEARING POCKET, SEE STRUCTURAL.
- 23 8"x6"x4" PRE-FINISHED 0.032" ALUMINUM GUTTER, WITH BRACKETS AT 4'-0" O.C. BACK PRIME WITH ASPHALTIC PAINT WHERE IN CONTACT WITH P.T. WOOD.
- 24 6"x4" PRE-FINISHED 0.032" ALUMINUM DOWNSPOUT WITH A MINIMUM OF 3 STANDOFF BRACKETS.
- 25 4"x4"x0.032 PRE-FINISHED COUNTER-FLASHING. NAIL TO BLOCKING AT 12" O.C.
- 26 2"x P.T. BLOCKING WITH 1/2"x4" TAPCON SCREWS AT 24" O.C. PROVIDE ADDITIONAL SCREWS AT 1'-0" O.C., 6'-0" FROM CORNER.
- 27 48 MIL PVC LAP FLASHING
- 28 RUB EXPOSED SURFACE SMOOTH, FILL ALL VOIDS & CAVATIES. PROVIDE ONE COAT OF COLORED ACRYLIC STUCCO WHERE INDICATED.
- 29 8"/12" CMU BOND BEAM: SEE STRUCTURAL FOR REINFORCING, FILL WITH CONCRETE.
- 30 2" EXPANDED POLYSTYRENE RIDGID BOARD INSULATION. ADHERE TO CMU.
- 31 8"/12" CMU WITH HORIZONTAL 9 GAUGE GALV. WIRE REINFORCING AT 16" O.C. VERTICAL. SEE STRUCTURAL FOR VERTICAL REINFORCING. FILL ALL UN-FILLED CELLS WITH FOAM INSULATION, UNO.
- 32 1-1/2" METAL DECK: SEE STRUCTURAL
- 33 ROOF ANGLE: SEE STRUCTURAL
- 34 FILL COLLAR JOINT SOLID, SLOPE TOP TO DRAIN
- 35 NON-WOVEN MORTAR MESH
- 36 STEEL COLUMN, SEE STRUCTURAL
- 37 5/8" GYPSUM BOARD, SEE WALL TYPES
- 38 6"x20 GA. GALV. STEEL STUDS
- 39 3-5/8"x20 GA. GALV. STEEL STUDS
- 40 GALV. TUBE STEEL, PAINT WITH HIGH PERFORMANCE COATING. SEE STRUCTURAL.
- 41 STANDING SEAM STRUCTURAL PRE-FINISHED 22 GA. GALV. STEEL ROOF.
- 42 DOMED GASKETED FASTENER AT 12" O.C.









WALL
DETAILS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

A312
SHEET #

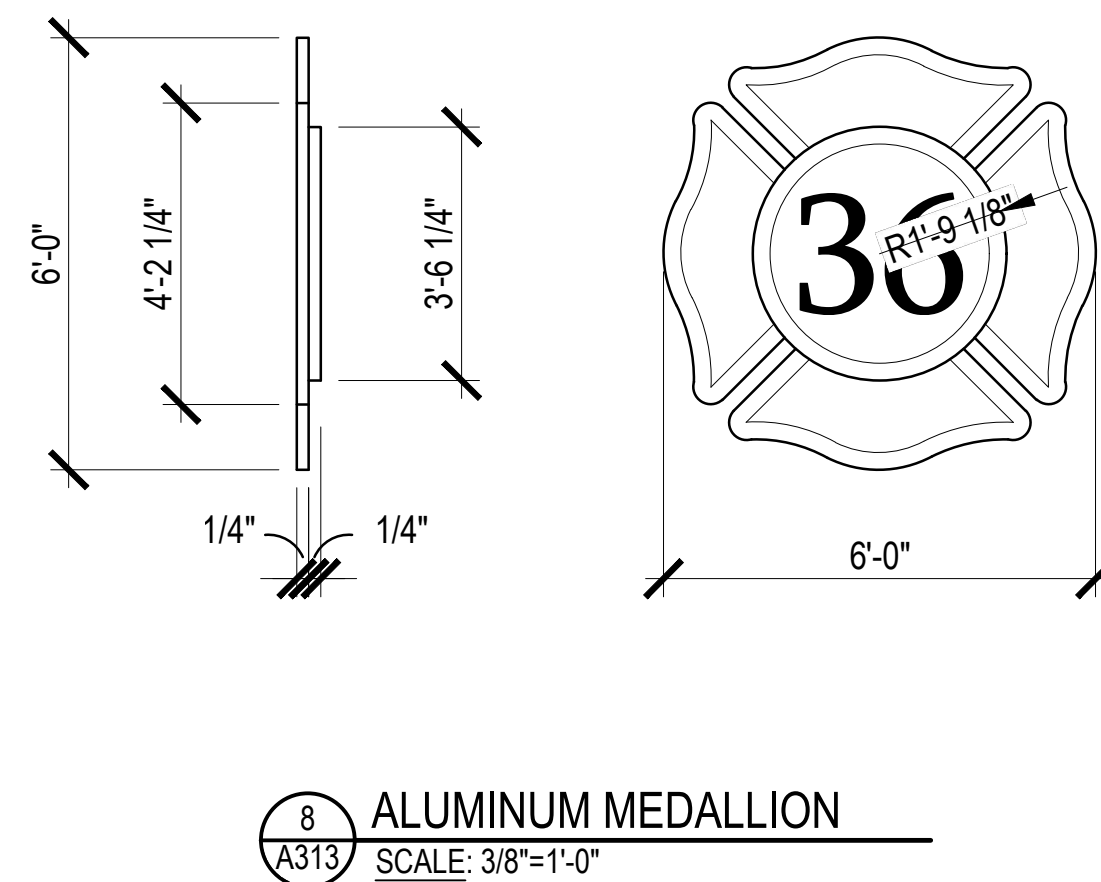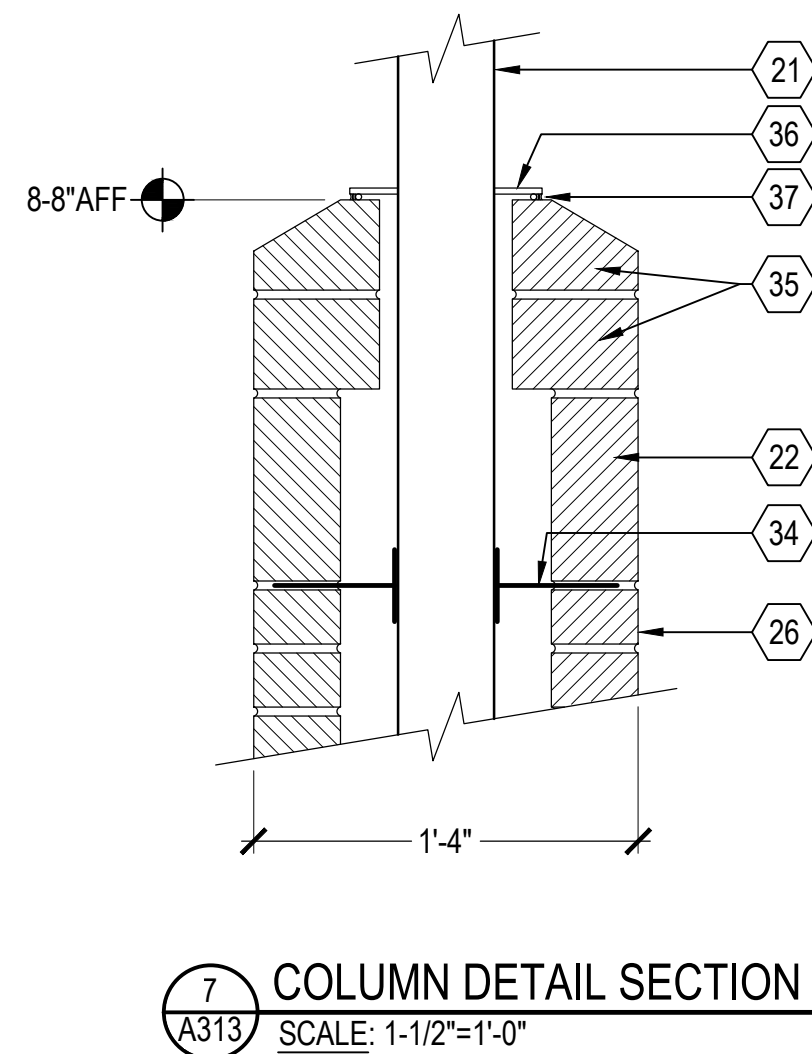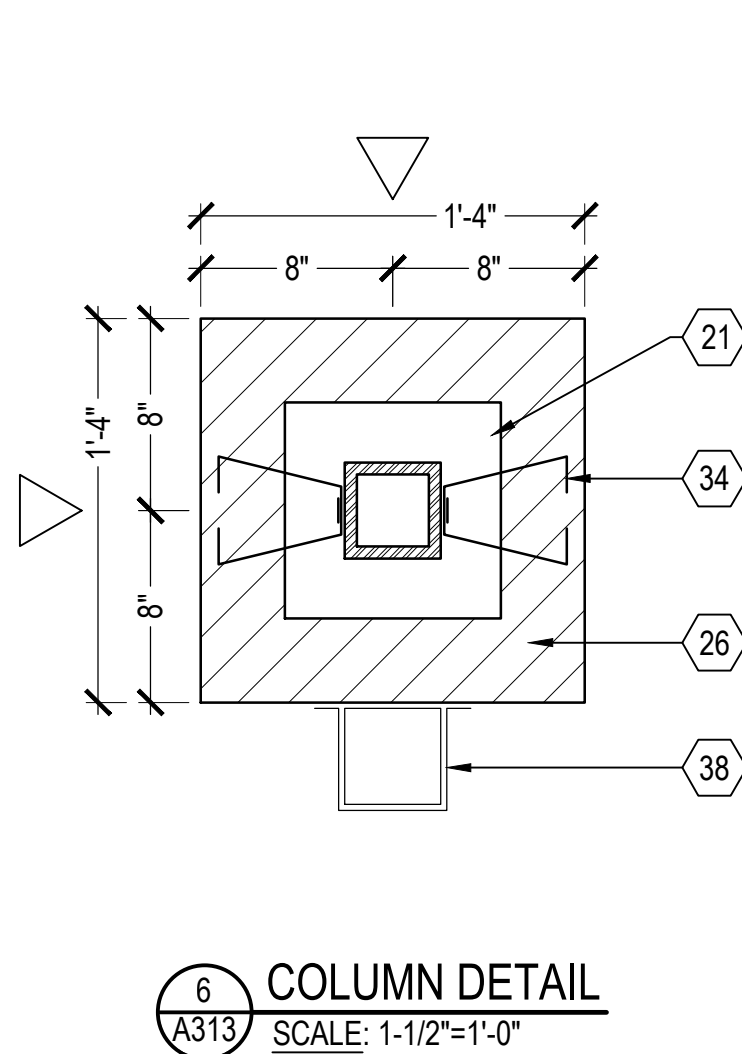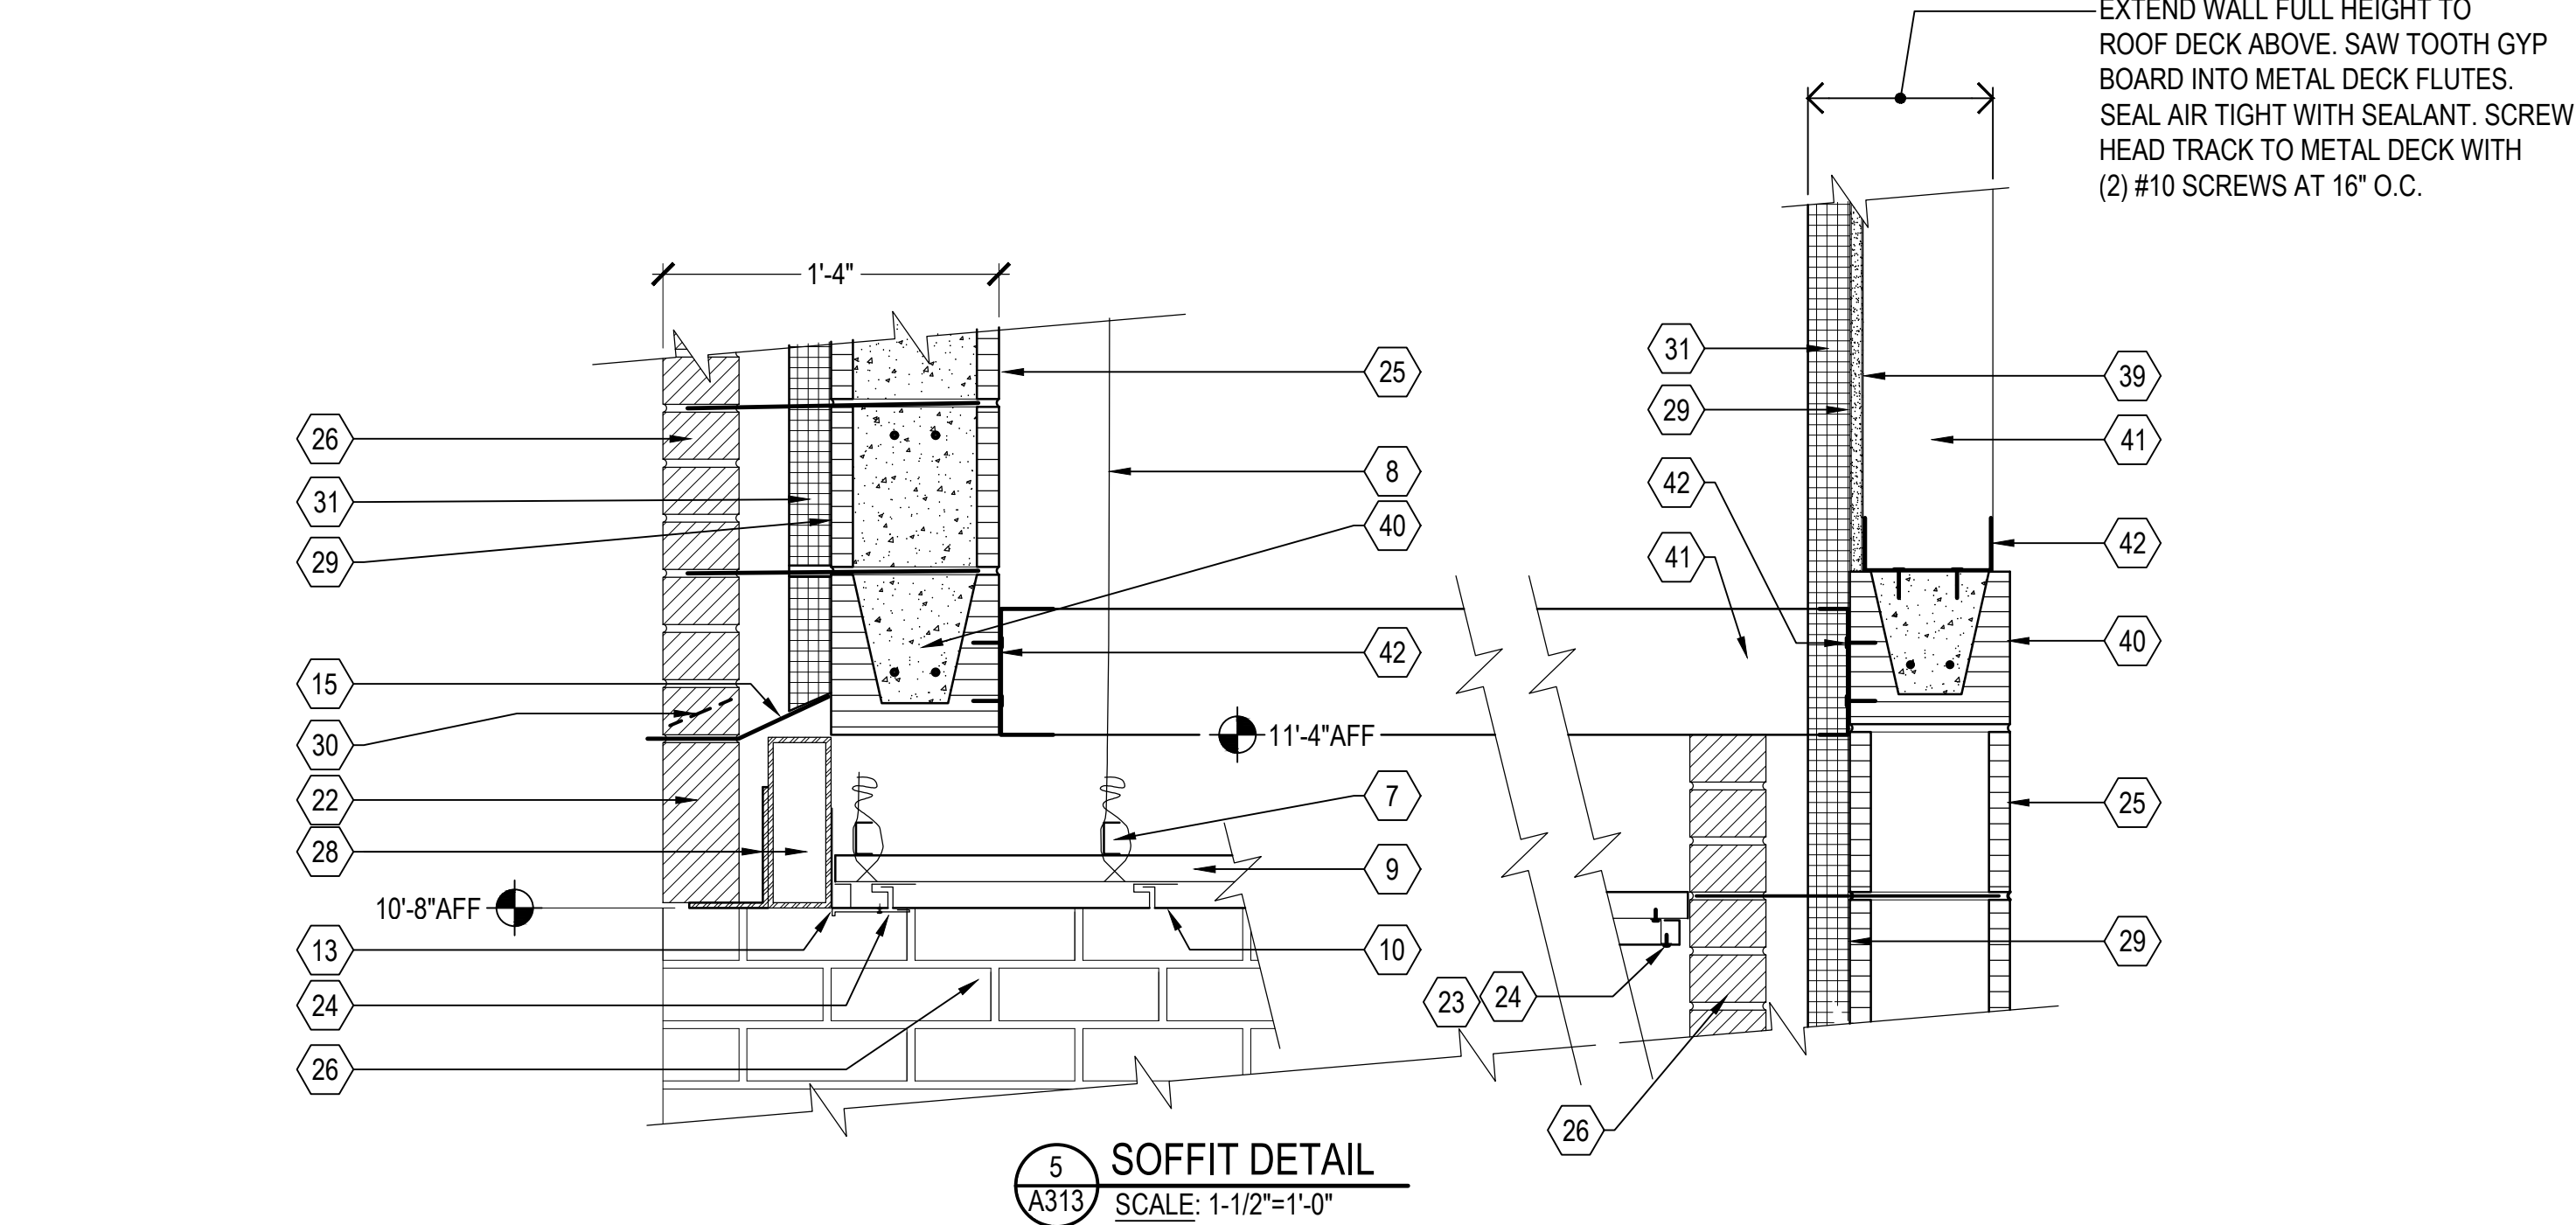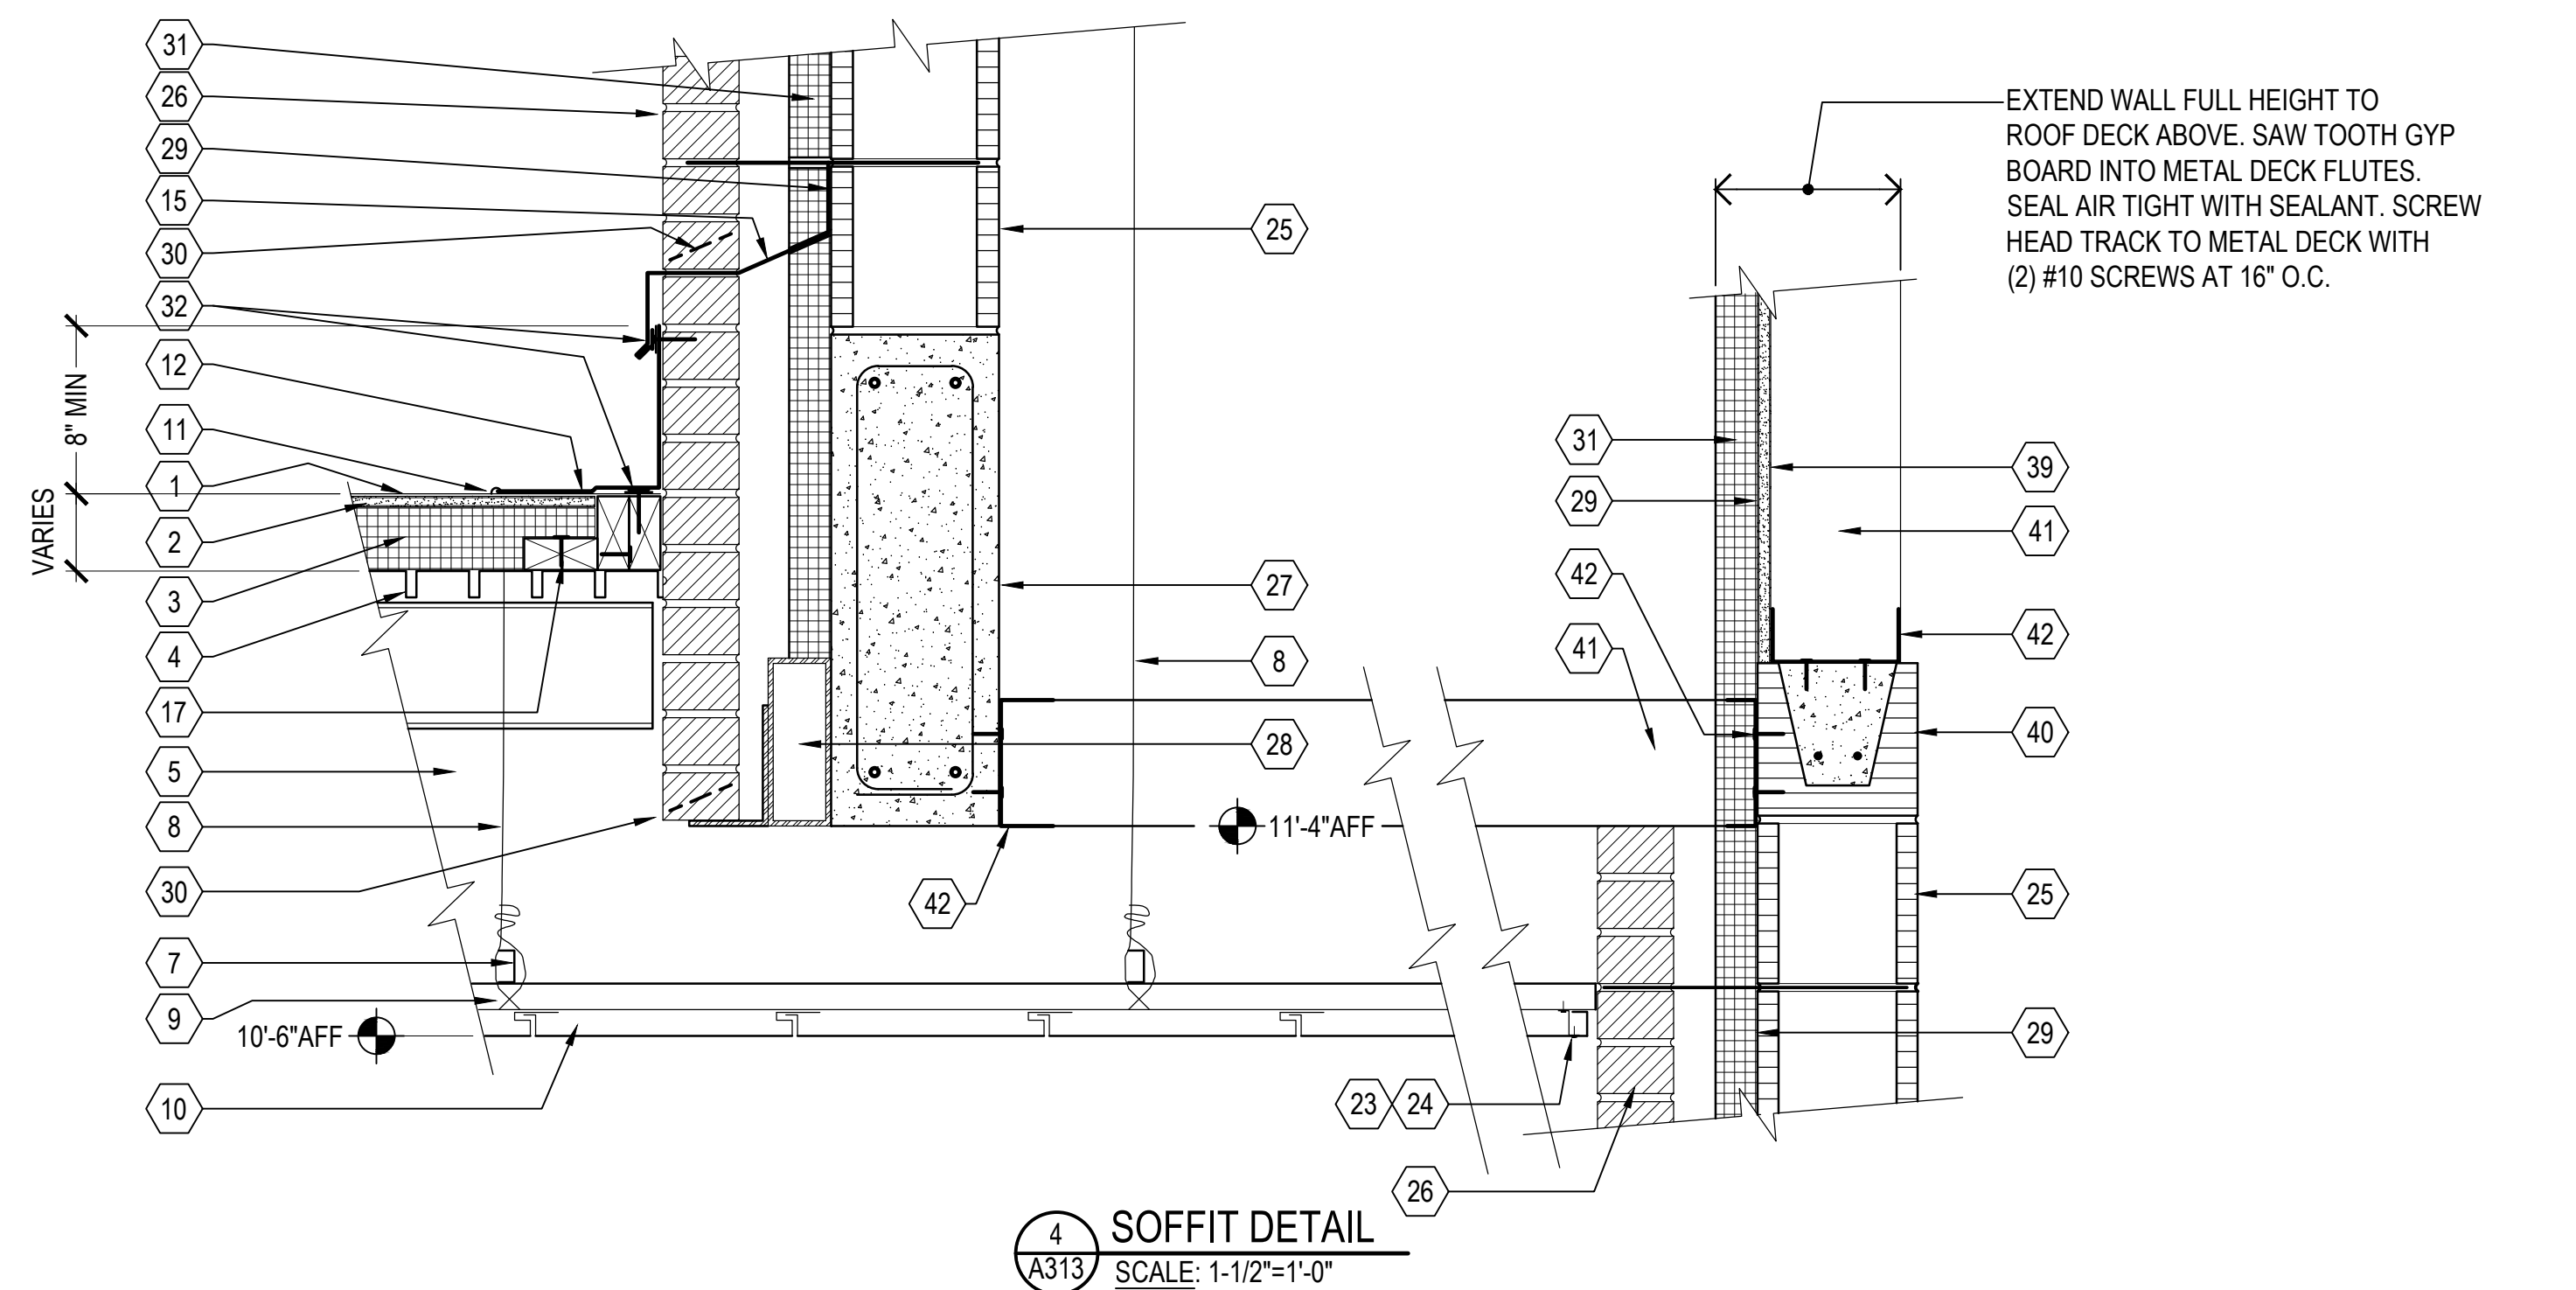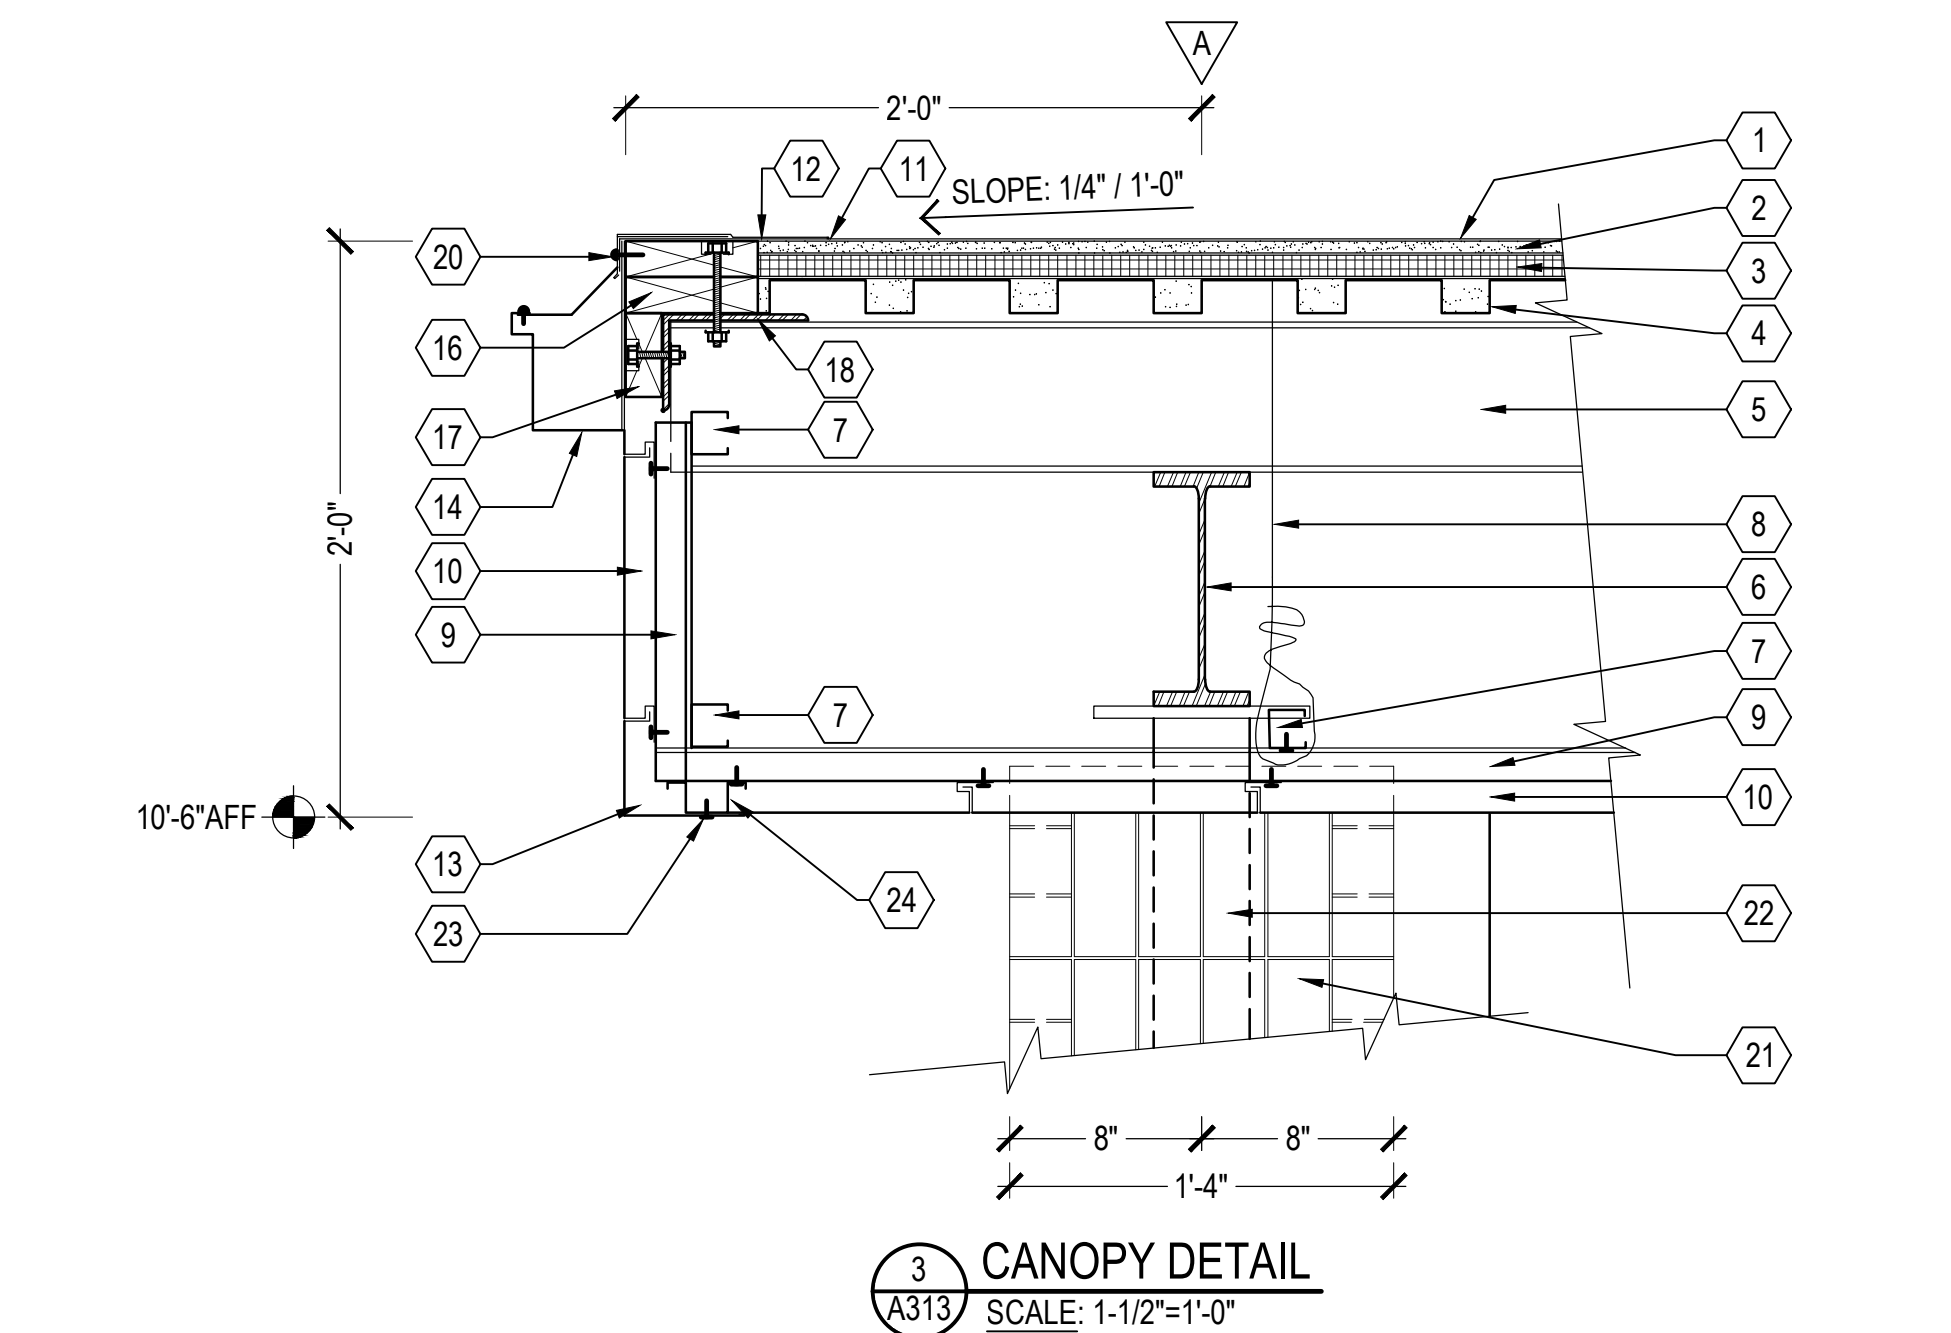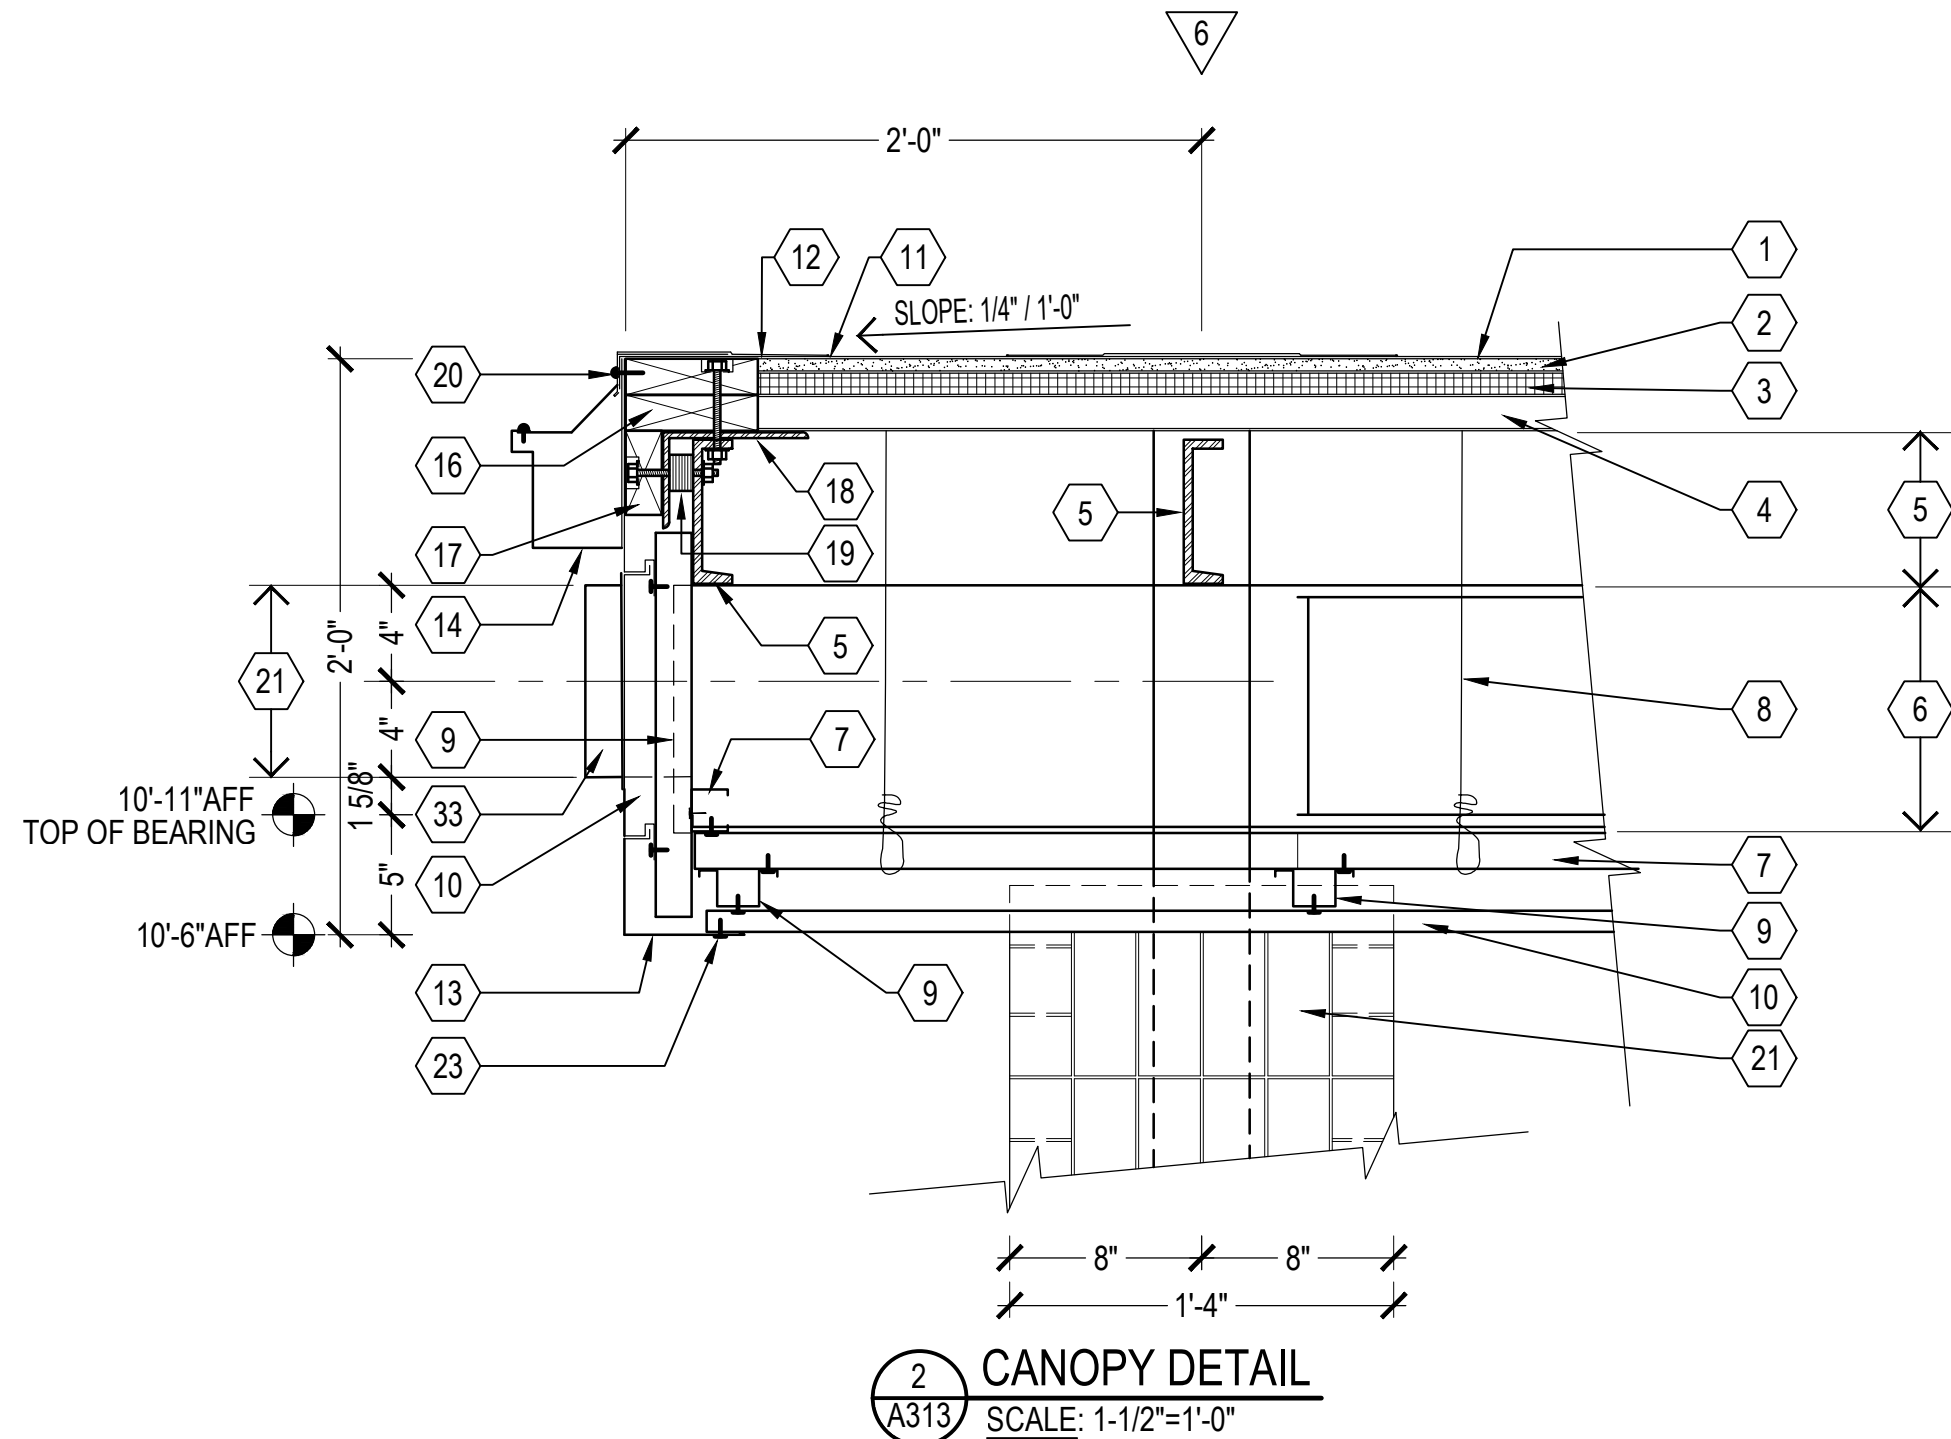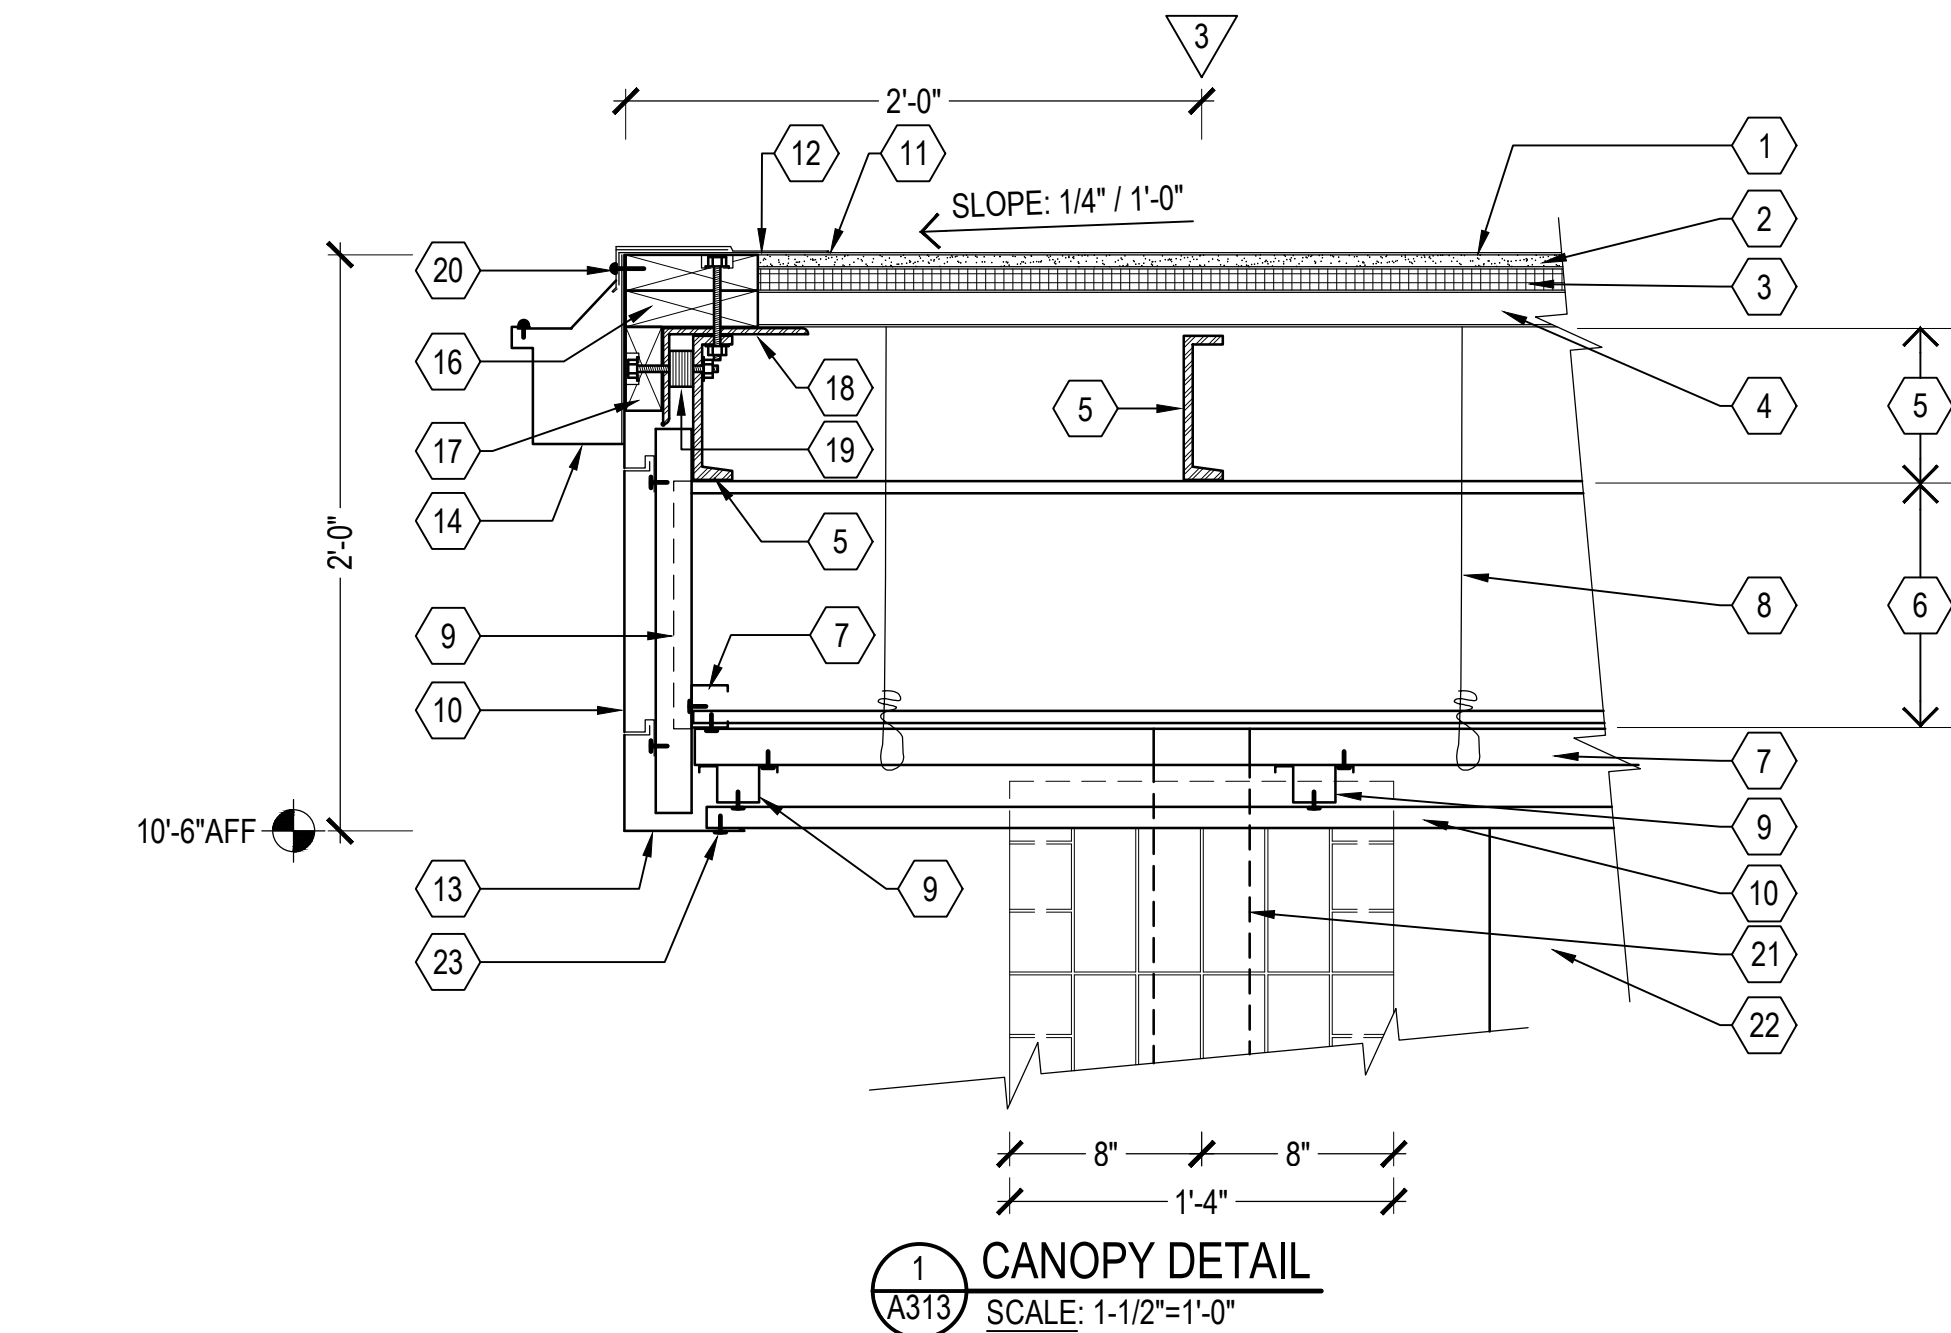

- KEYNOTES**
- 60MIL FLEECE-BACKED, FULLY-ADHERED WHITE PVC ROOF MEMBRANE
 - 1/2" FIBERGLASS-FACED, FULLY-ADHERED EXTERIOR GYPSUM PROTECTION BOARD.
 - RIGID, FULLY-ADHERED, TAPERED ROOF INSULATION
 - 1-1/2" ROOF DECK, SEE STRUCTURAL
 - 6" STEEL CHANNEL RAFTER, SEE STRUCTURAL
 - 10" WIDE FLANGE STEEL BEAM, SEE STRUCTURAL
 - 1-1/2" COLD-ROLLED CHANNEL AT 4'-0" O.C., MAX--OR AS INDICATED
 - #9 WIRE TIE AT 2'-0" O.C., EACH WAY, MAX.
 - 1-1/2" COLD ROLLED HAT CHANNEL AT 2'-0" O.C. MAX, OR AS INDICATED.
 - 24 GA PRE-FINISHED GALVANIZED STEEL 12" WIDE SOFFIT PANEL, SMOOTH WITH CONCEALED FASTENERS. (MBCI "ARTISAN" -- BASIS OF DESIGN)
 - SEALANT
 - 48MIL LAP FLASHING
 - 24GA, PRE-FINISHED, GALVANIZED STEEL BOX SILL WITH SOFFIT TRIM
 - 8"x6"x4" PRE-FINISHED 0.032 ALUMINUM GUTTER WITH BRACKETS @ 4'-0" O.C. MAX, BACK PRIME WITH NON-FIBRATED ASPHALTIC PAINT WHERE IN CONTACT WITH P.T. WOOD, STEEL OR OTHER DISSIMILAR MATERIAL.
 - FLEXIBLE THRU-WALL FLASHING
 - 2"x6" P.T. BLOCKING WITH 1/2" DIA. SST BOLTS AT 2'-0" O.C.
 - 2"x4" P.T. BLOCKING WITH 1/2" DIA. SST BOLTS AT 2'-0" O.C.
 - 6"x4"x1/4" BENT STEEL PLATE. SEE STRUCTURAL. BACK PRIME WITH NON-FIBRATED PAINT WHERE IN CONTACT WITH P.T. WOOD OR OTHER DISSIMILAR MATERIAL.
 - SST BUMPER WASHERS AS SPACER
 - 4"x4"x0.032 PRE-FINISHED COUNTER FLASHING. SCREW TO BLOCKING AT 12" O.C. WITH DOMED, GASKETED SCREWS.
 - TUBE STEEL COLUMN / BEAM, SEE STRUCTURAL
 - SOLDIER COURSE FACE BRICK
 - POP RIVET
 - "Z" FURRING SPACER
 - 8" CMU, WITH HORIZONTAL WIRE REINFORCEMENT AT 2'-0" O.C.
 - FACE BRICK, RUNNING BOND. SEE BUILDING / COLUMN ELEVATION FOR OTHER ORIENTATIONS.
 - CONCRETE BEAM--SEE STRUCTURAL
 - GALVANIZED TUBE-STEEL & ANGLE LINTEL, SEE STRUCTURAL
 - FLUID-APPLIED VAPOR BARRIER
 - WEEP HOLE AT 2'-0" O.C.
 - 2" RIGID WALL INSULATION
 - TERMINATION BAR, SCREW TO SUBSTRATE AT 12" O.C.
 - PRE-FINISHED 24GA GALVANIZED TRIM / FLASHING
 - ADJUSTABLE MASONRY ANCHOR: SPOT WELD OR SCREW TO STEEL COLUMN AT 1'-4" MAX, VERTICAL.
 - SLOPED SILL ROWLOCK BRICK & ROWLOCK BRICK COURSE: CUT BRICK AS REQUIRED.
 - 1/4" GALVANIZED STEEL PLATE CLOSURE: WELD TO TUBE STEEL. PROVIDE HIGH PERFORMANCE COATING.
 - SEALANT AND BACKER ROD.
 - DOWNSPOUT WHERE SHOWN ON DRAWINGS.
 - 5/8" EXTERIOR, FIBERGLASS-FACED GYPSUM SHEATHING
 - 8" CMU BOND BEAM / LINTEL: SEE STRUCTURAL FOR ADDITIONAL INFORMATION.
 - 6"x10GA GALVANIZED STEEL STUDS: SEE STRUCTURAL FOR ADDITIONAL INFORMATION.
 - 6"x18GA GALVANIZED STEEL TRACK, CONTINUOUS, WITH (2) PAF AT 16" O.C.

DETAILS

**MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL**

Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:
A313	
SHEET #	

ROOM FINISH SCHEDULE										ROOM FINISH KEY				
ROOM		FLOOR		WALLS				CEILING		NOTES	ABBR	MATERIAL	NOTES	
#	NAME	FINISH	BASE	North	East	South	West	FINISH	HEIGHT					
101	WAITING SECURE ENTRY	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"	1		FLOORING		
102	WATCH ROOM	LVT-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		CON-1	CONCRETE	POLISHED CONCRETE FLOOR	
103	CORRIDOR	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		CT-1	CERAMIC TILE	3' x 3' CERAMIC TILE	
104	STORAGE	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		CT-2	CERAMIC TILE	12' x 12' CERAMIC TILE	
105	ELECTRICAL	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		EP-1	EPOXY FLOOR	POURED EPOXY FLOOR - MONOLITHIC FINISH	
106	FITNESS	SF-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		LVT-1	LUXURY VINYL TILE	TBD	
107	DAY ROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"		SF-1	SPORTS FLOORING	BASIS OF DESIGN: ROBBINS SPORTS SURFACES; "GALAXY MAT"; COLOR: TBD	
108	DINING	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-0"					
109	KITCHEN	CON-1	RB-1	PTD-2 / SST	PTD-2	PTD-2	PTD-2	ACT-1	10'-0"			BASE		
109A	WATCH PANTRY	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	GYP-1	9'-0"	CB-1	CERAMIC BASE	COVE BASE		
109B	WATCH PANTRY	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	GYP-1	9'-0"	EB-1	EPOXY FLOORING BASE	INTEGRAL EPOXY COVE BASE		
109C	WATCH PANTRY	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	GYP-1	9'-0"	RB-1	RESILIENT BASE	JOHNSONITE TRADITIONAL 4" VINYL COVE BASE. COLOR: TBD		
110	MECHANICAL	CON-1	RB-1	PTD-2	PTD-2	PTD-2	PTD-2	EXP-1	VARIES	3		WALLS		
111	OFFICER'S OFFICE	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"		CWT-1	CERAMIC WALL TILE	12' x 24' CERAMIC TILE	
111A	OFFICER'S BEDROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"		PTD-1	PAINT	PAINTED GWB OR CMU. FINISH: FLAT, COLOR TBD	
112	OFFICER'S BATHROOM	CT-1	CB-1	CWT-1	CWT-1	CWT-1	CWT-1	GYP-1	9'-0"	5.6	PTD-2	PAINT	PAINTED GWB OR CMU. FINISH: SEMI-GLOSS, COLOR TBD	
113	OFFICER'S BATHROOM	CT-1	CB-1	CWT-1	CWT-1	CWT-1	CWT-1	GYP-1	9'-0"	5.6	PTD-3	PAINT	PAINTED GWB OR CMU. FINISH: EPOXY, COLOR TBD	
114	OFFICER'S OFFICE	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"		PTD-4	PAINT	PAINTED 3/4" FR PLYWOOD TO 8'-0" AFF ON GWB: SEE TELE / COM / DATA FOR ADDITIONAL INFORMATION	
114A	OFFICER'S BEDROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"		SST	STAINLESS STEEL	0.040" POLISHED, TYPE 304 STAINLESS STEEL: FULLY ADHERE TO WALL	
115	CORRIDOR	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"					
116	UNISEX RESTROOM	CT-2	CB-1	PTD-2	PTD-2	PTD-2	PTD-2	GYP-1	9'-0"	2.5, 6		CEILING		
117	JANITOR	CON-1	RB-1	PTD-3	PTD-3	PTD-3	PTD-3	GYP-2	9'-0"	2.7	ACT-1	ACOUSTICAL CEILING TILE	ARMSTRONG "CORTEGA", SQUARE LAY-IN, 24x24, 15/16" GRID, WHITE	
118	UNISEX SHOWER	CT-1	CB-1	CWT-1	CWT-1	CWT-1	CWT-1	GYP-1	9'-0"	5.6	GYP-1	GYPSUM BOARD CEILING	PAINTED GWB. FINISH: FLAT, COLOR: TBD	
119	UNISEX SHOWER	CT-1	CB-1	CWT-1	CWT-1	CWT-1	CWT-1	GYP-1	9'-0"	5.6	GYP-2	GYPSUM BOARD CEILING	PAINTED GWB. FINISH: SEMI-GLOSS, COLOR TBD	
120	LAUNDRY WORKROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	10'-2"		EXP-1	EXPOSED	EXPOSED STRUCTURE, PAINT SATIN AS NOTED	
121	CER/RADIO EQUIP. ROOM	CON-1	RB-1	PTD-4	PTD-4	PTD-4	PTD-4	ACT-1	10'-0"		EXP-2	EXPOSED	PRE-FINISH EXPOSED ACOUSTICAL METAL DECK, PAINT STRUCTURAL TRUSSES & JOIST	
122	BUNK ROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"					
123	BUNK ROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"					
124	BUNK ROOM	CON-1	RB-1	PTD-1	PTD-1	PTD-1	PTD-1	ACT-1	9'-0"			FINISH NOTES		
125	APPARATUS BAY	CON-1	---	PTD-2	PTD-2	PTD-2	PTD-2	EXP-2	VARIES	4	1. PROVIDE ADA COMPLIANT METAL EDGE TRIM WHERE DISIMILAR FLOOR MATERIALS MEET.			
125A	WORK ALCOVE	CON-1	---	PTD-2	PTD-2	PTD-2	PTD-2	EXP-1	VARIES	3				
126	MECH. & ELECTRICAL	CON-1	---	PTD-2	PTD-2	PTD-2	PTD-2	EXP-1	VARIES	3				
127	DECONTAMINATION ROOM	EP-1	EB-1	PTD-3	PTD-3	PTD-3	PTD-3	GYP-2	9'-0"	2				
128	DECONTAMINATION SHOWER	CT-1	CB-1	CWT-1	CWT-1	CWT-1	CWT-1	GYP-1	9'-0"	5.6				
129	TURNOUT GEAR LOCKERS	CON-1	RB-1	PTD-2	PTD-2	PTD-2	PTD-2	GYP-1	9'-0"					
130	MEDICAL SUPPLY STOCK	CON-1	RB-1	PTD-2	PTD-2	PTD-2	PTD-2	GYP-1	9'-0"					
131	GENERAL STORAGE	CON-1	RB-1	PTD-2	PTD-2	PTD-2	PTD-2	GYP-1	9'-0"					
132	CORRIDOR	CON-1	RB-1	PTD-2	PTD-2	PTD-2	PTD-2	GYP-2	10'-0"					

7"

SOLID SURFACE CAP





SEALANT






SEALANT

NOTES:

- PROIDE SAFETY GLASS MIRRORS ON SOUTH AND EAST WALL FROM 18" AFF TO 88" AFF.
- PROVIDE 4'-0" HIGH WAINSCOT OF .040 PVC WALL PANEL, SOLID COLOR, FULLY ADHERED ON ALL WALLS, WITH ALL TRIM, CAPS & ACCESSORIES
- PAINT EXPOSED BAR JOIST & METAL DECK
- PAINT EXPOSED STRUCTURE
- PROVIDE SCHLUTER "DITRA" WATERPROOF UNCOUPLING AT CERAMIC TILE FLOORING & UNDER SHOWER PAN.
- PROVIDE CEMENTITIOUS BACKER BOARD, FULL HEIGHT, AT SHOWER, PROVIDE GLASS MAT GYPSUM BOARD AT OTHER LOCATIONS IN SHOWER/TOILET ROOM. AT CONTRACTOR'S OPTION: SUBSTITUTE SCHLUTER "KERDI" BOARD FOR TILE SUBSTRATE
- PROVIDE IMPACT RESISTANT GYPSUM BOARD.

GENERAL NOTES		WALL LABELING / IDENTIFICATION	
1) SEE FINISH SCHEDULE FOR OTHER APPLIED FINISHES.		STENCIL FIRE PARTITIONS ABOVE CEILING IN ACCORDANCE WITH FBC 703.7. LOCATE WITHIN 15 FEET OF END OF EACH WALL AND AY MOT LESS THAN 30 FOOT INTERVALS. LETTERING SHALL BE NOT LESS THAN 3" HIGH WITH A MIN. 3/8" STROKE IN CONTRASTING COLOR	
2) SEE SHEETS A801 & A802 FOR TYPICAL PENETRATION DETAILS.		AT 1/2 HOUR WALL - "ONE HALF HOUR FIRE PARTITION - PROTECT ALL OPENINGS"	
		AT 1 HOUR - "ONE HOUR FIRE PARTITION - PROTECT ALL OPENINGS"	

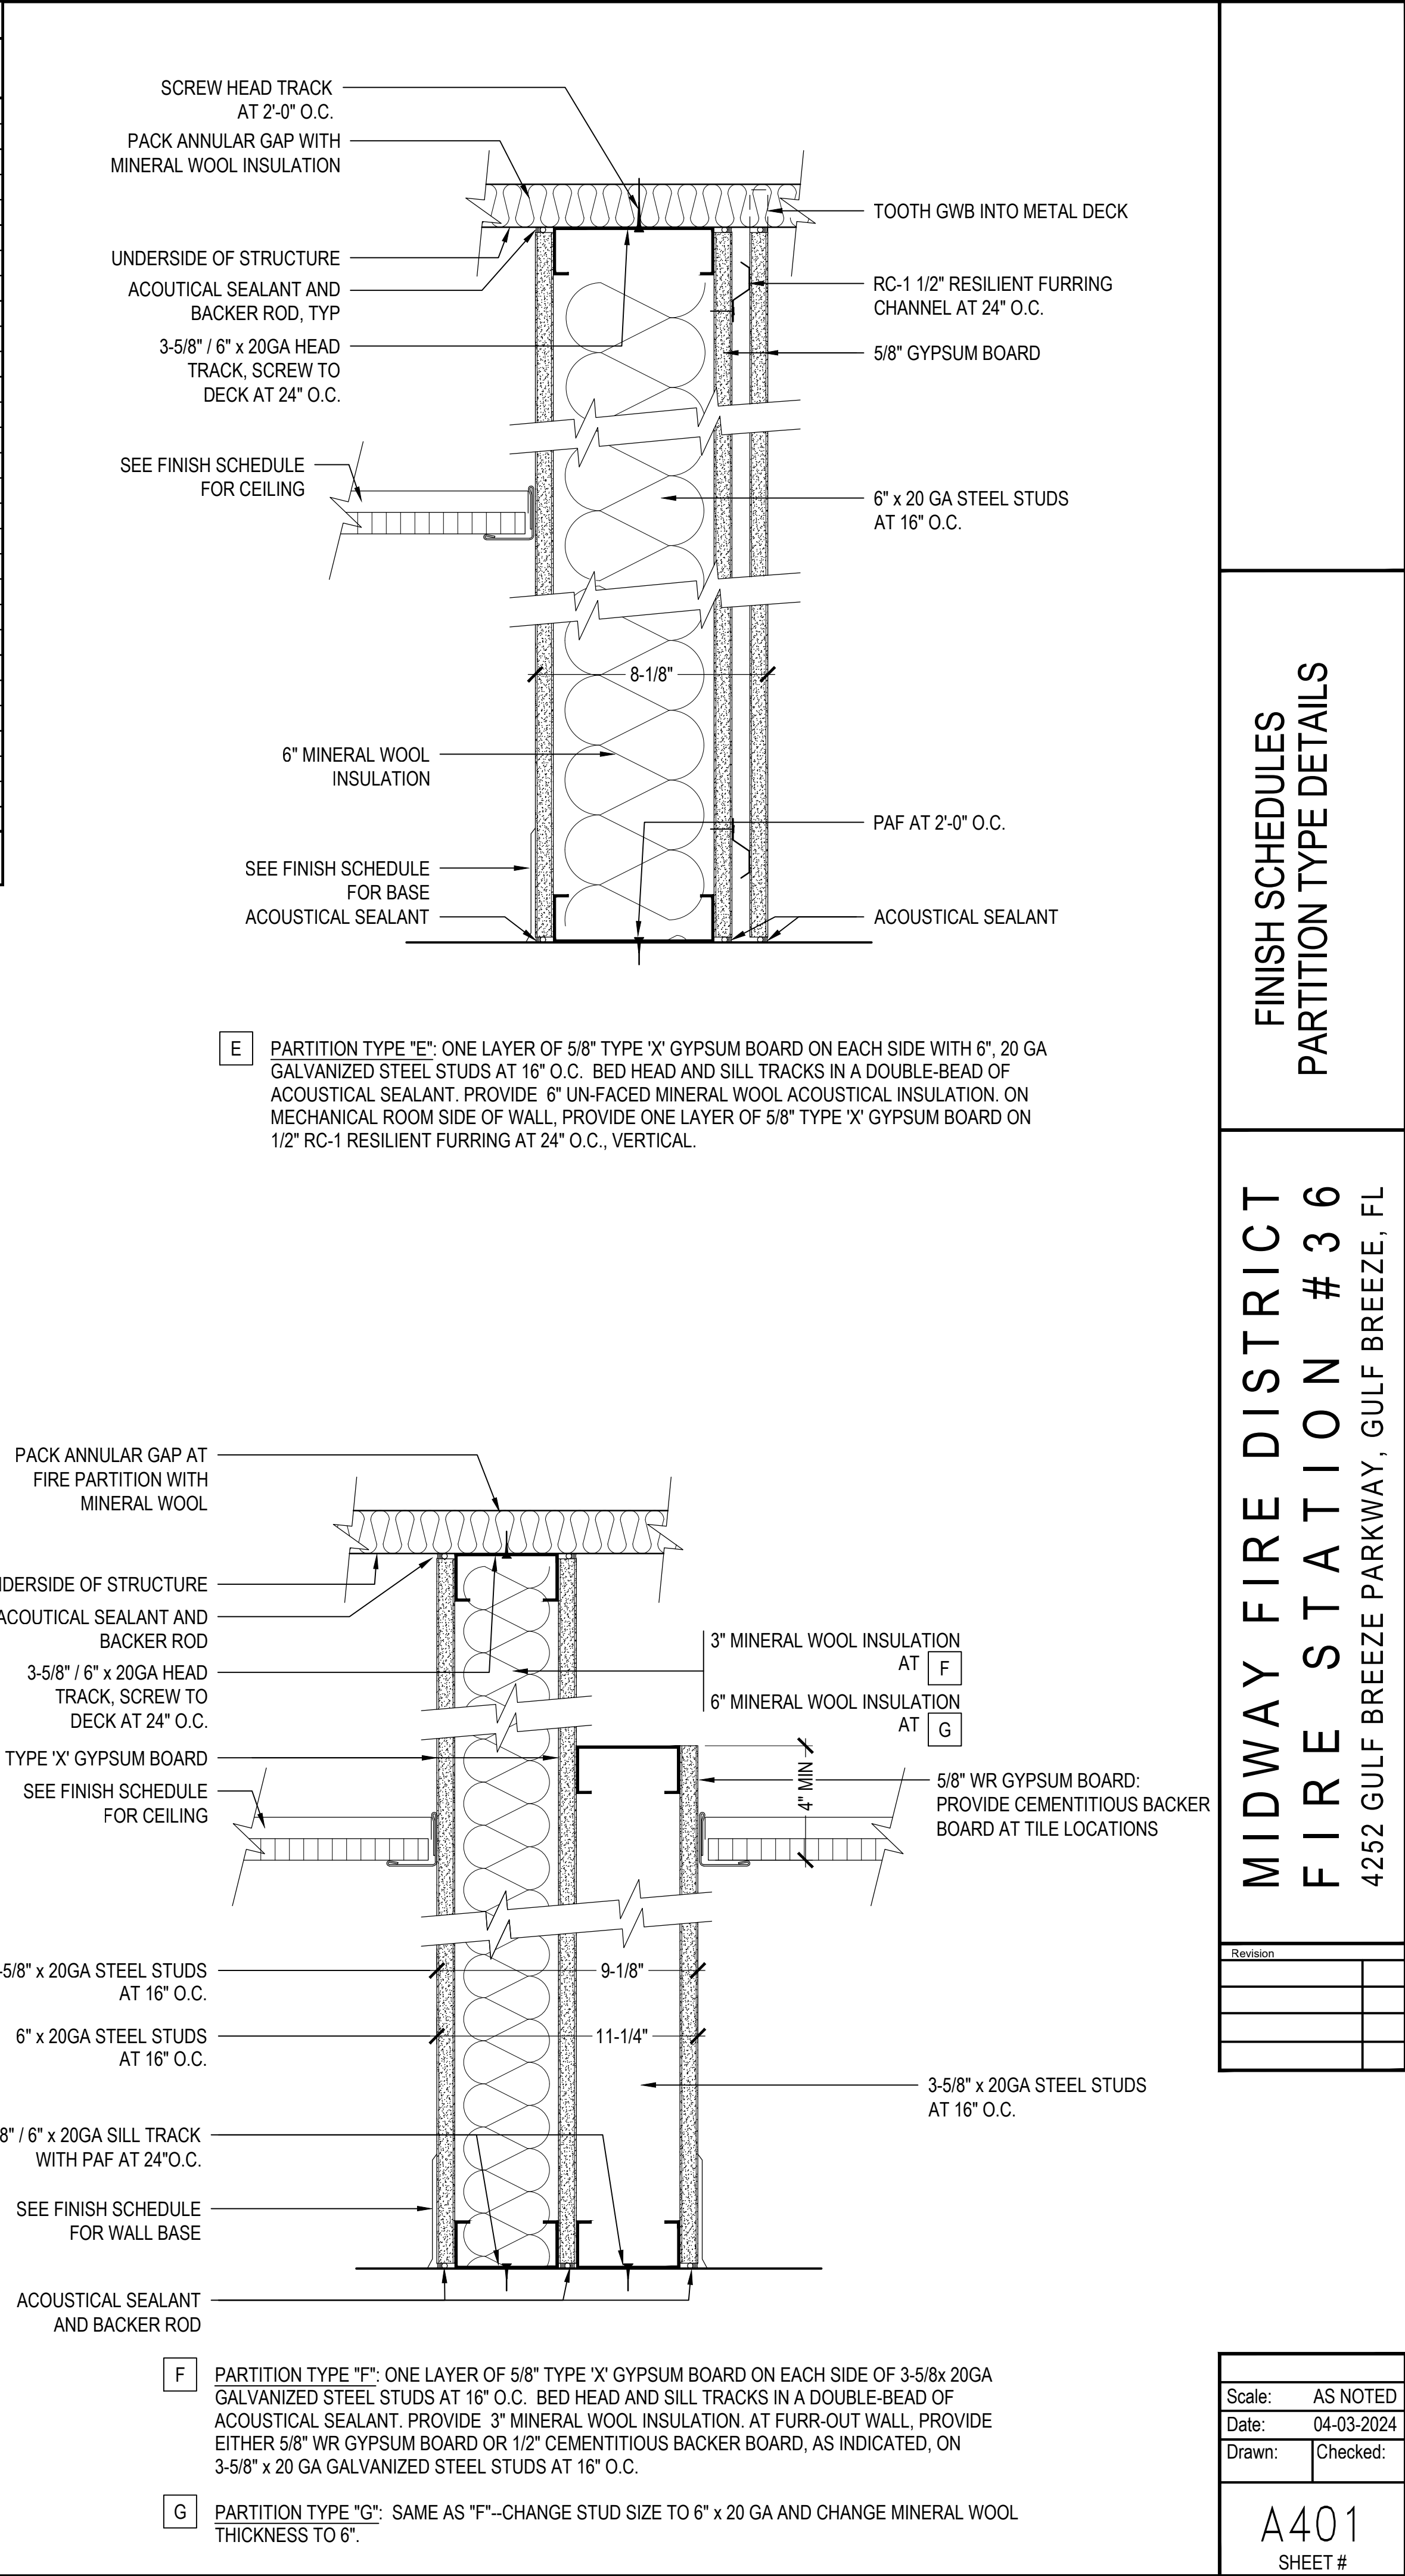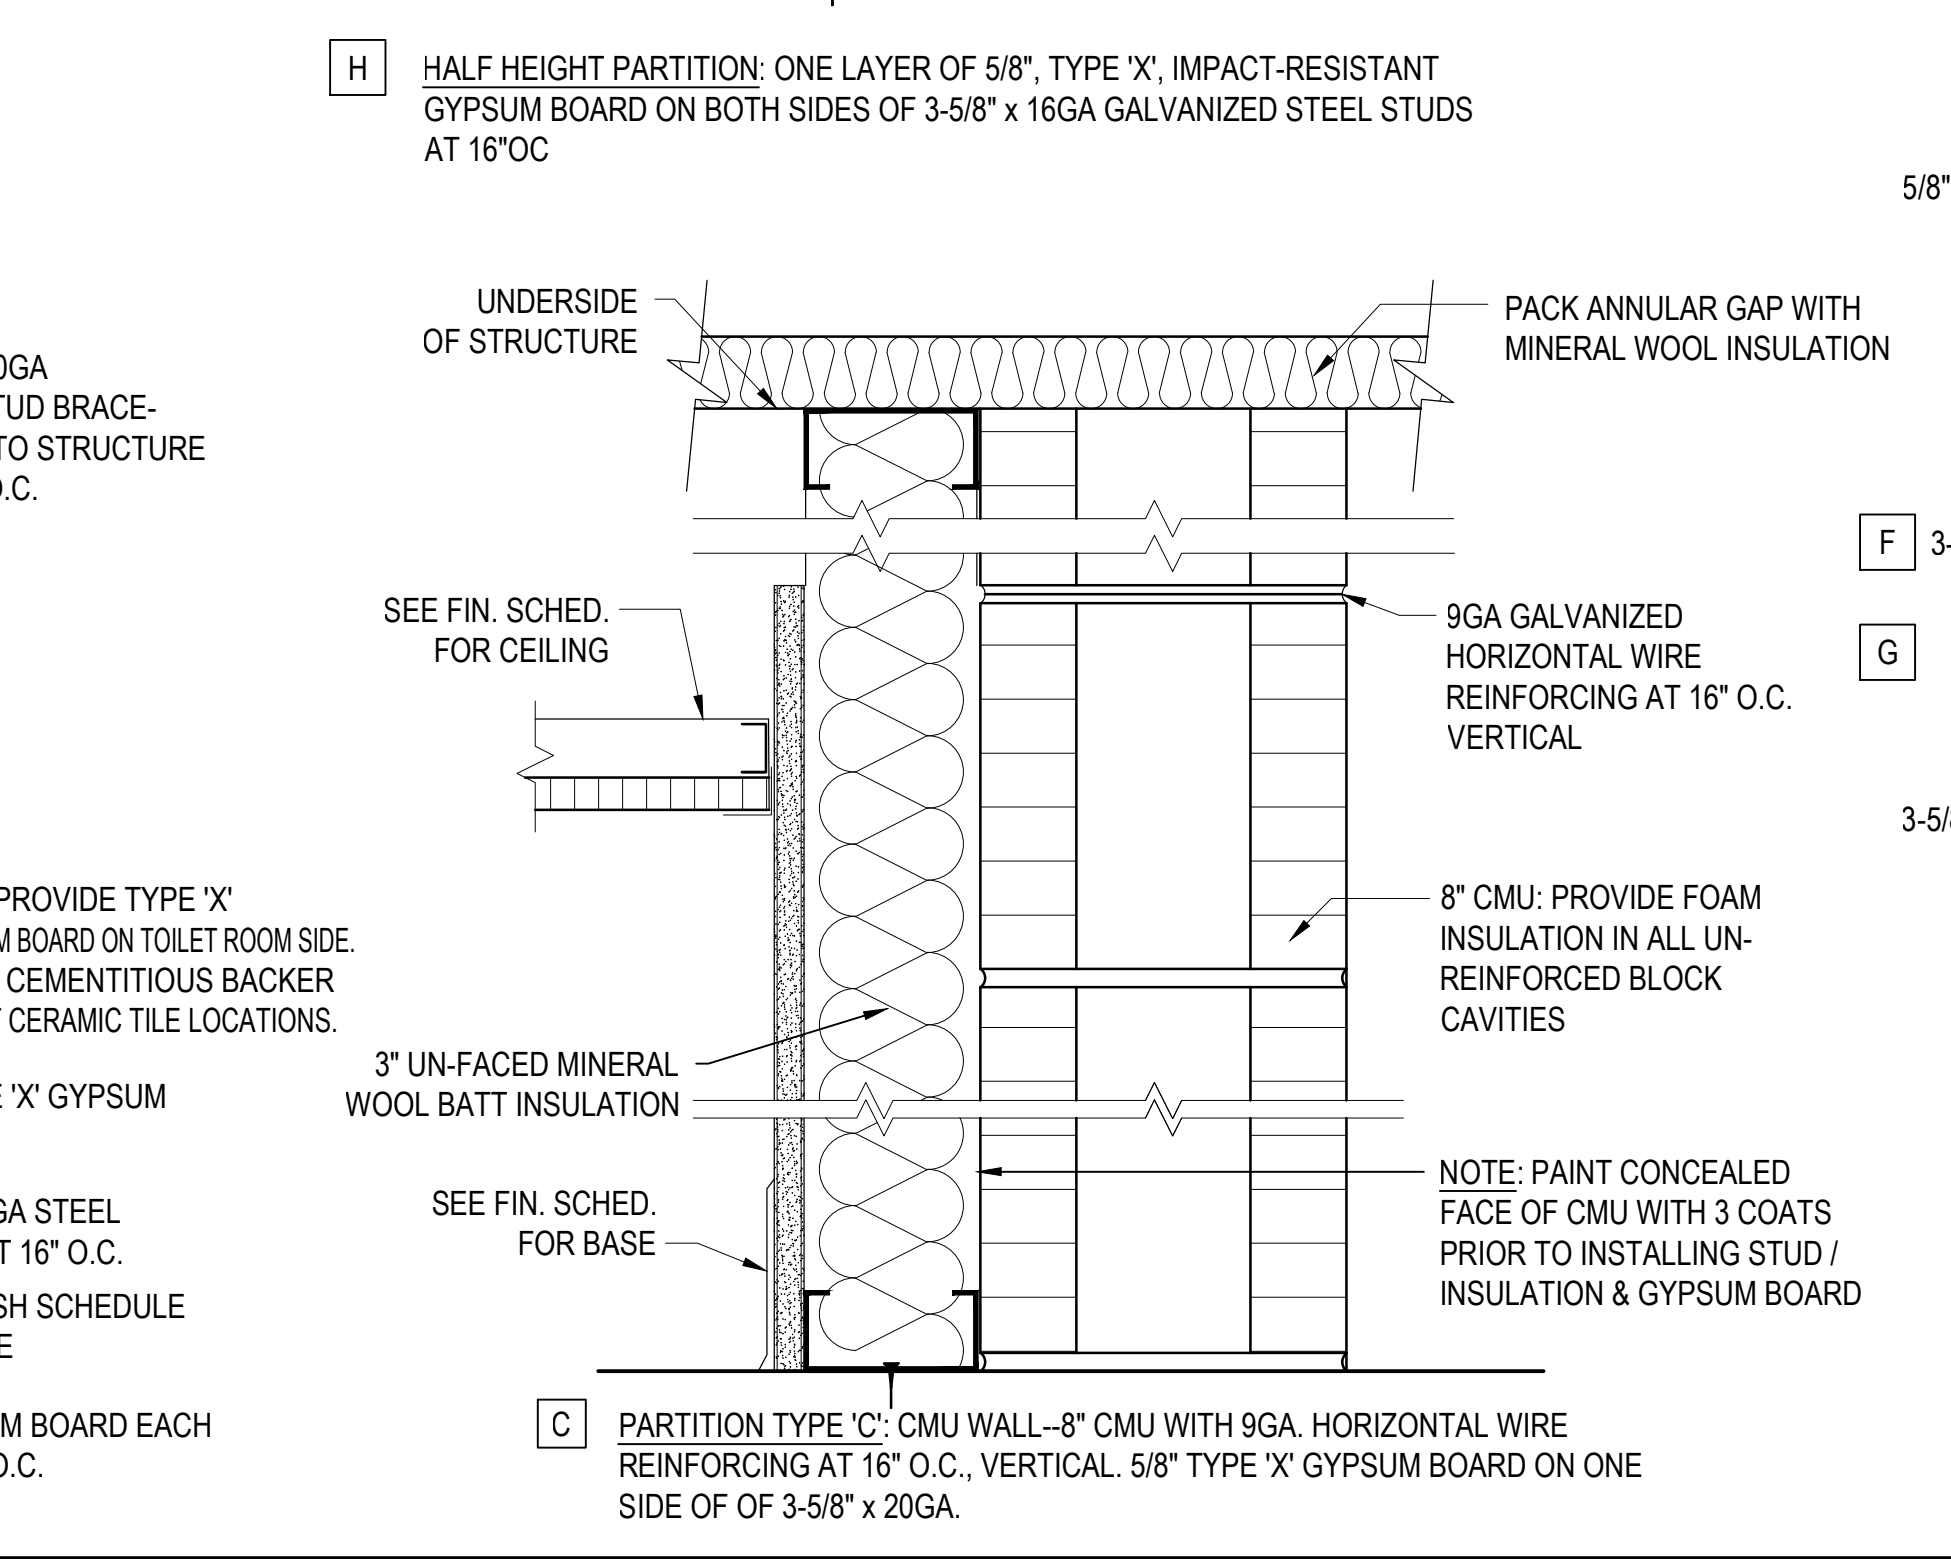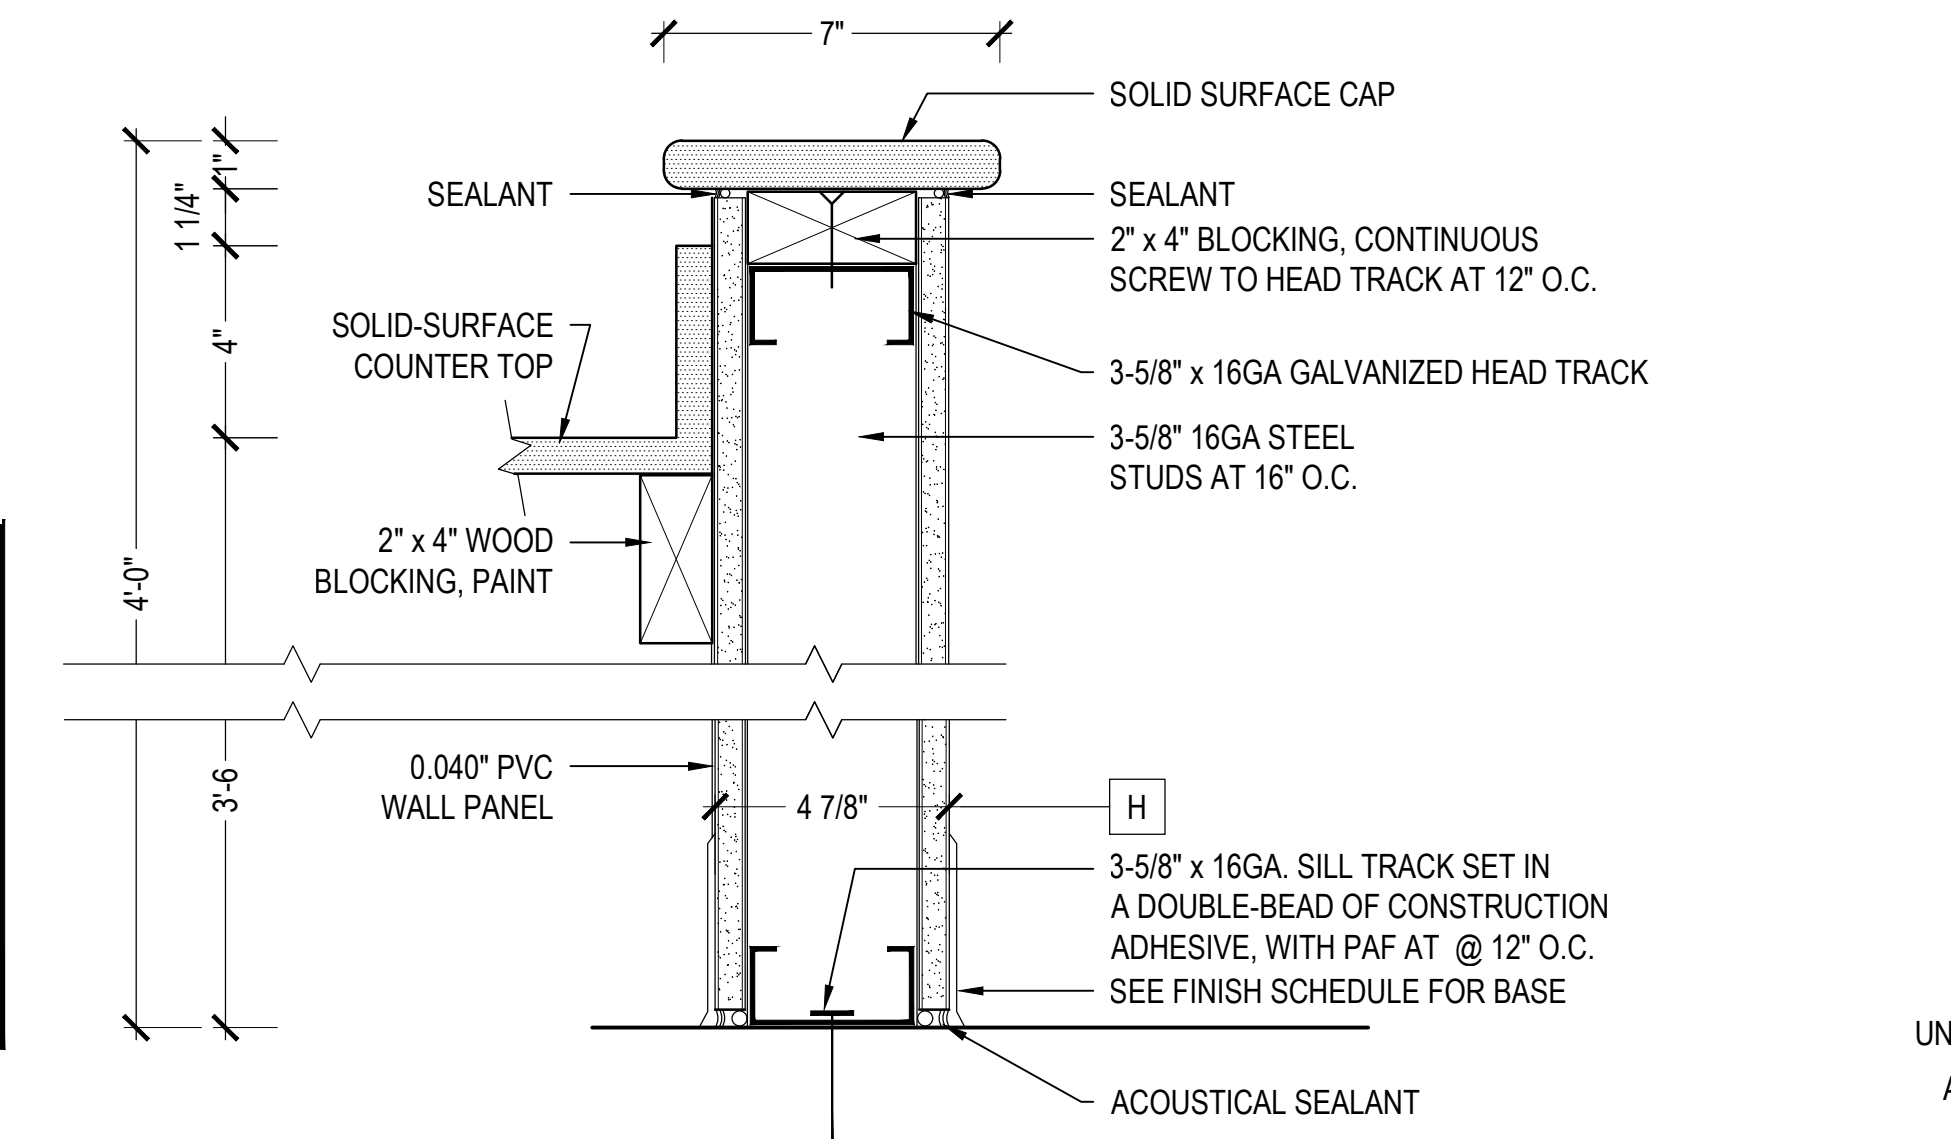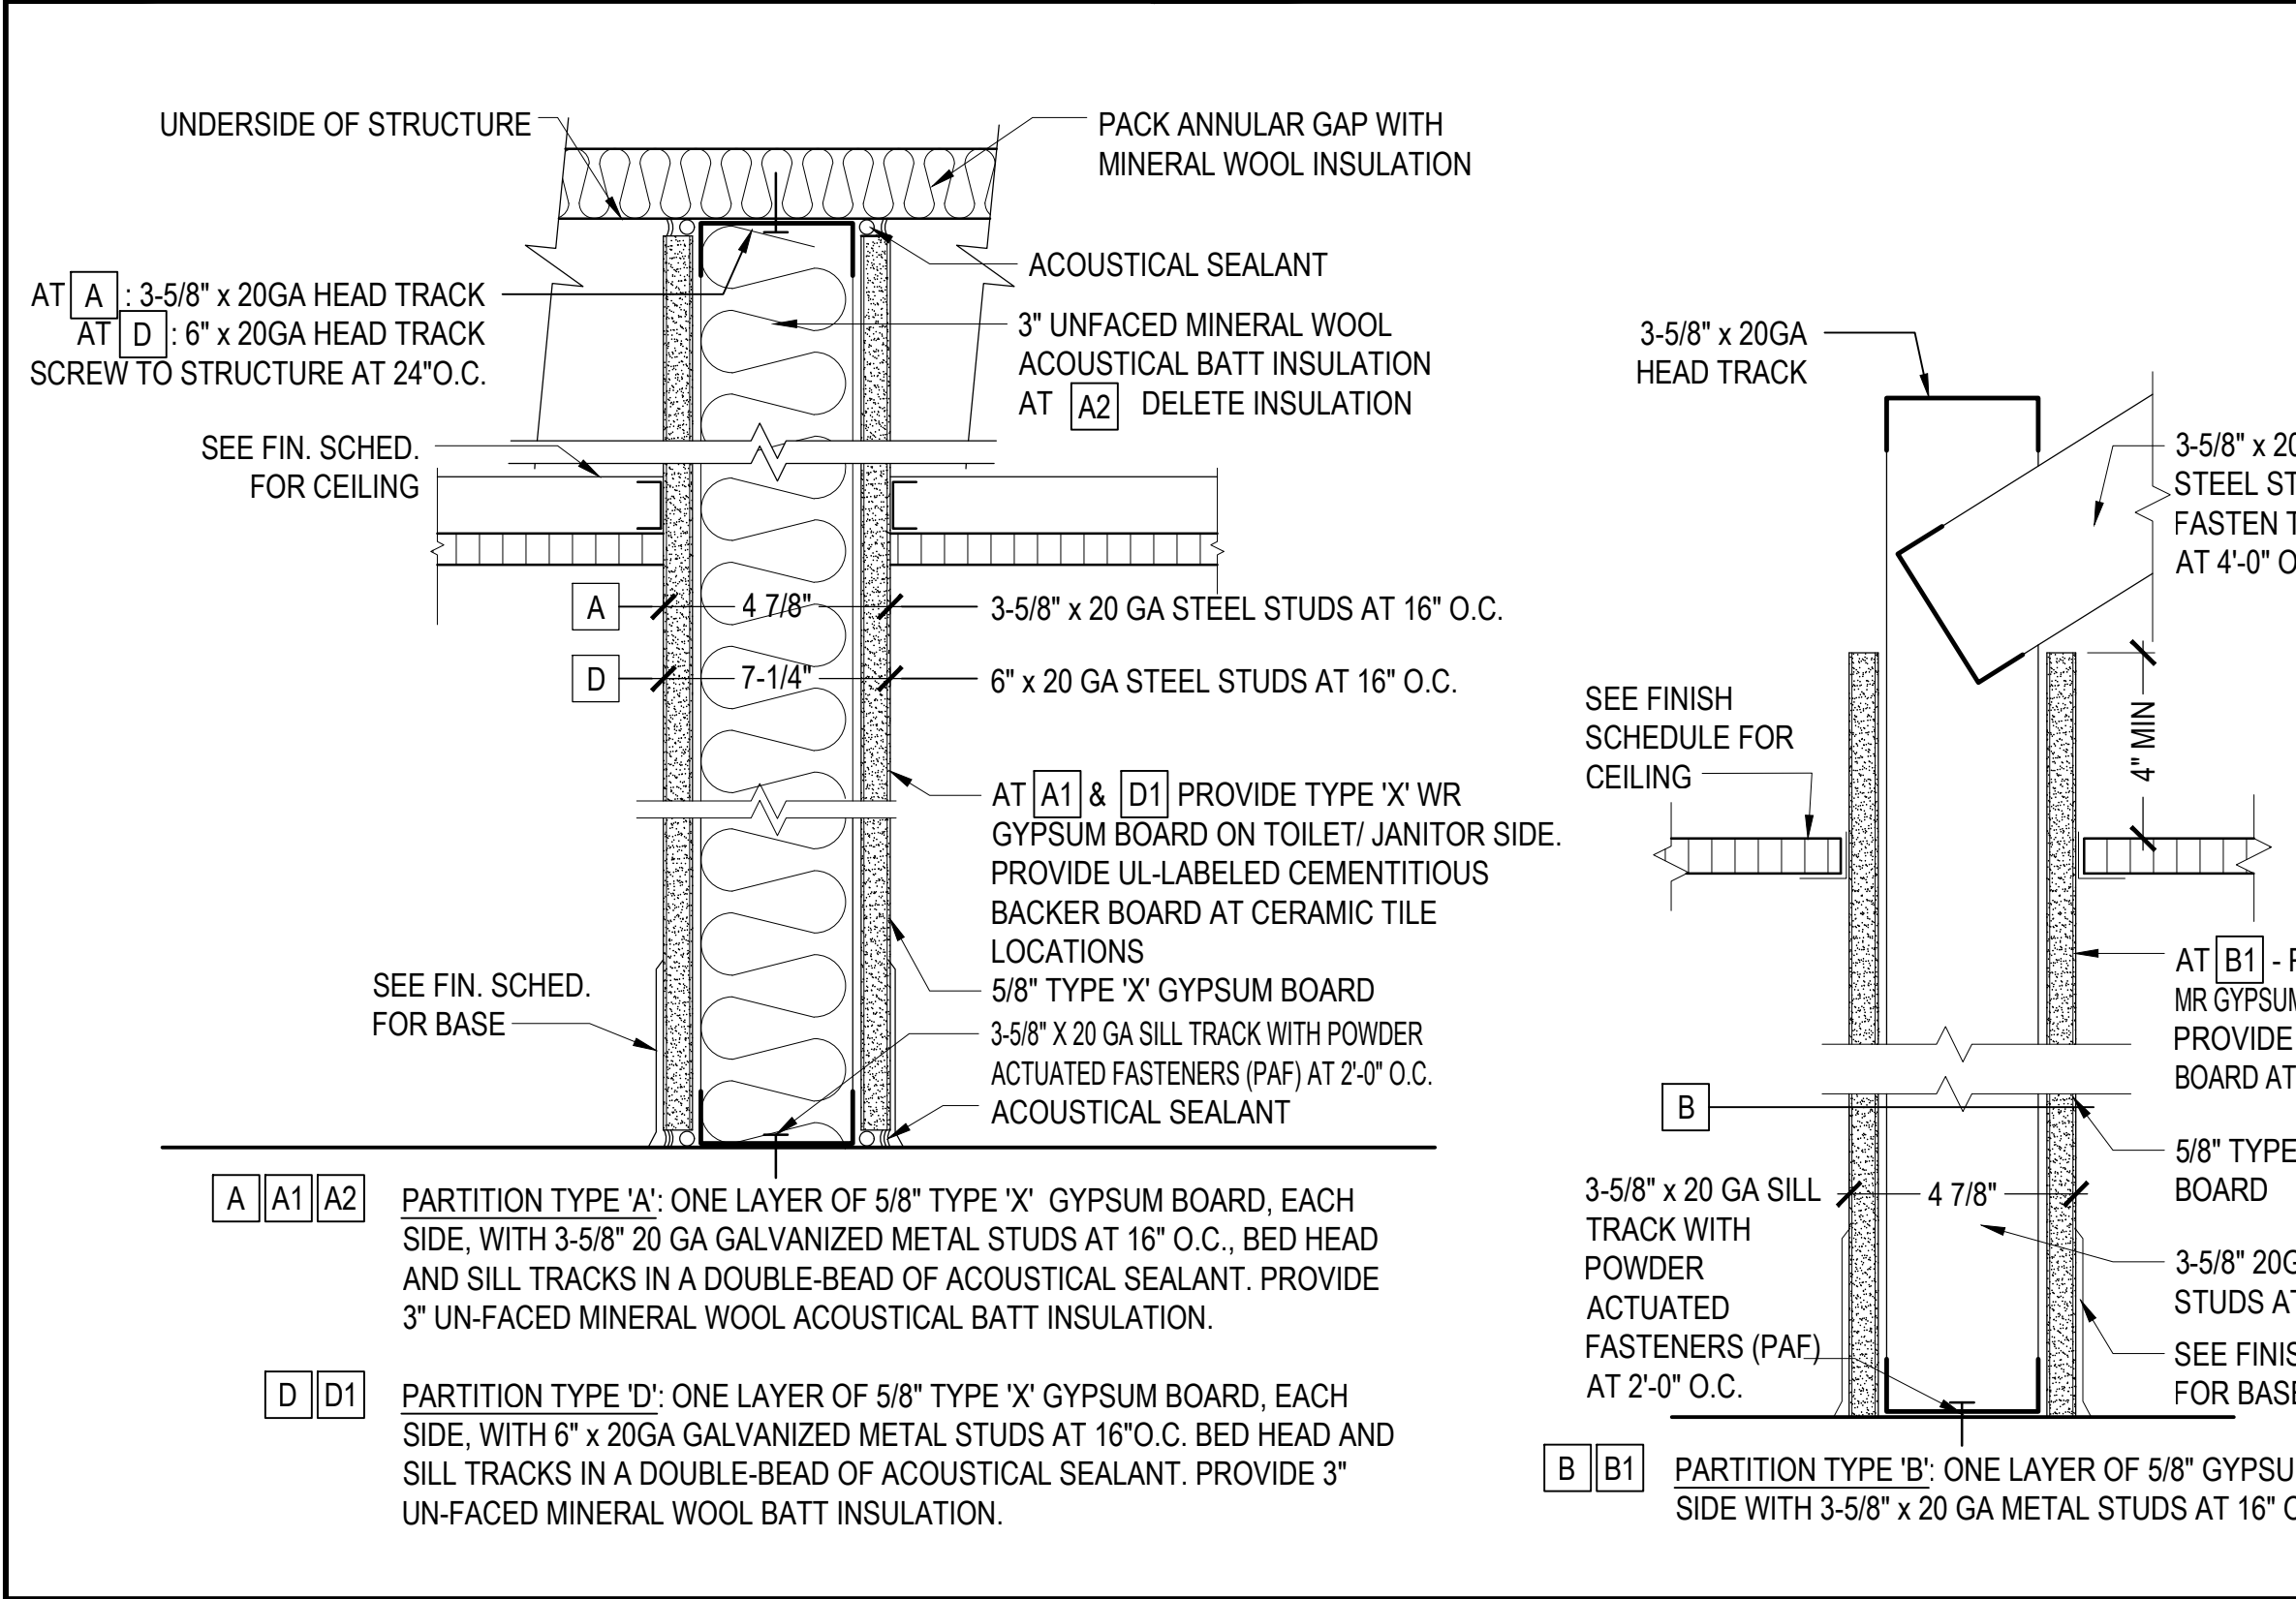

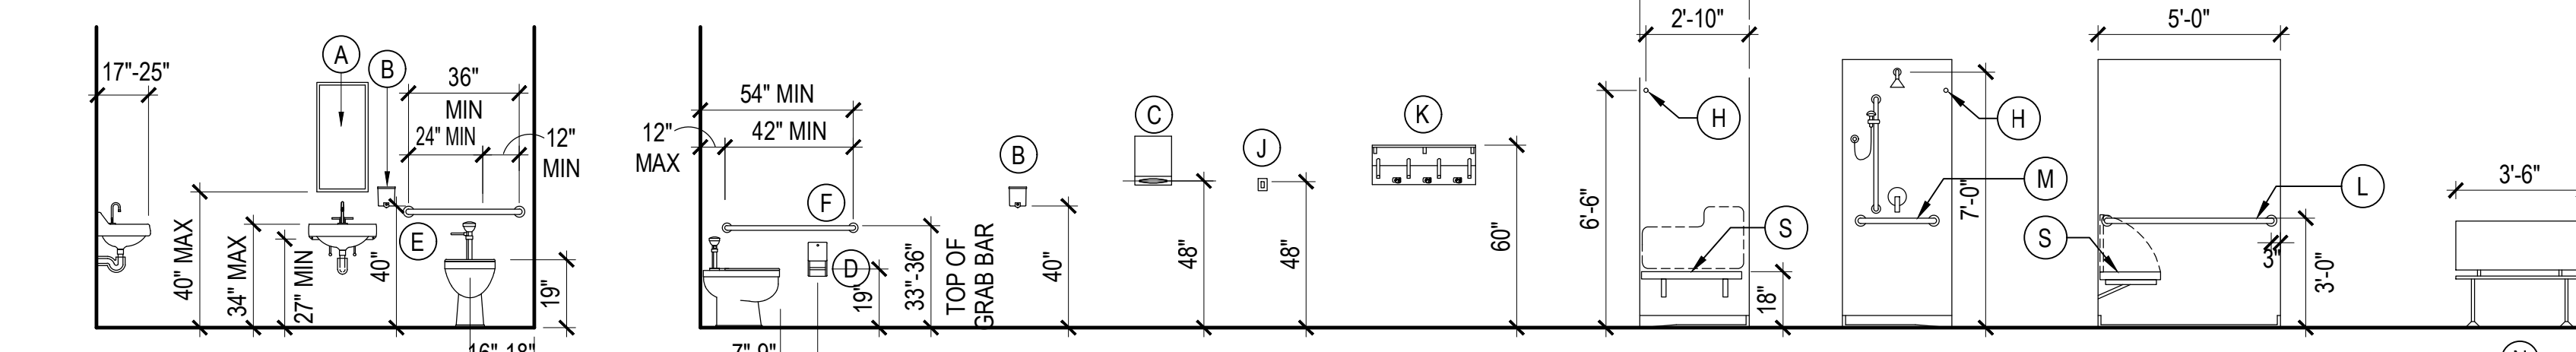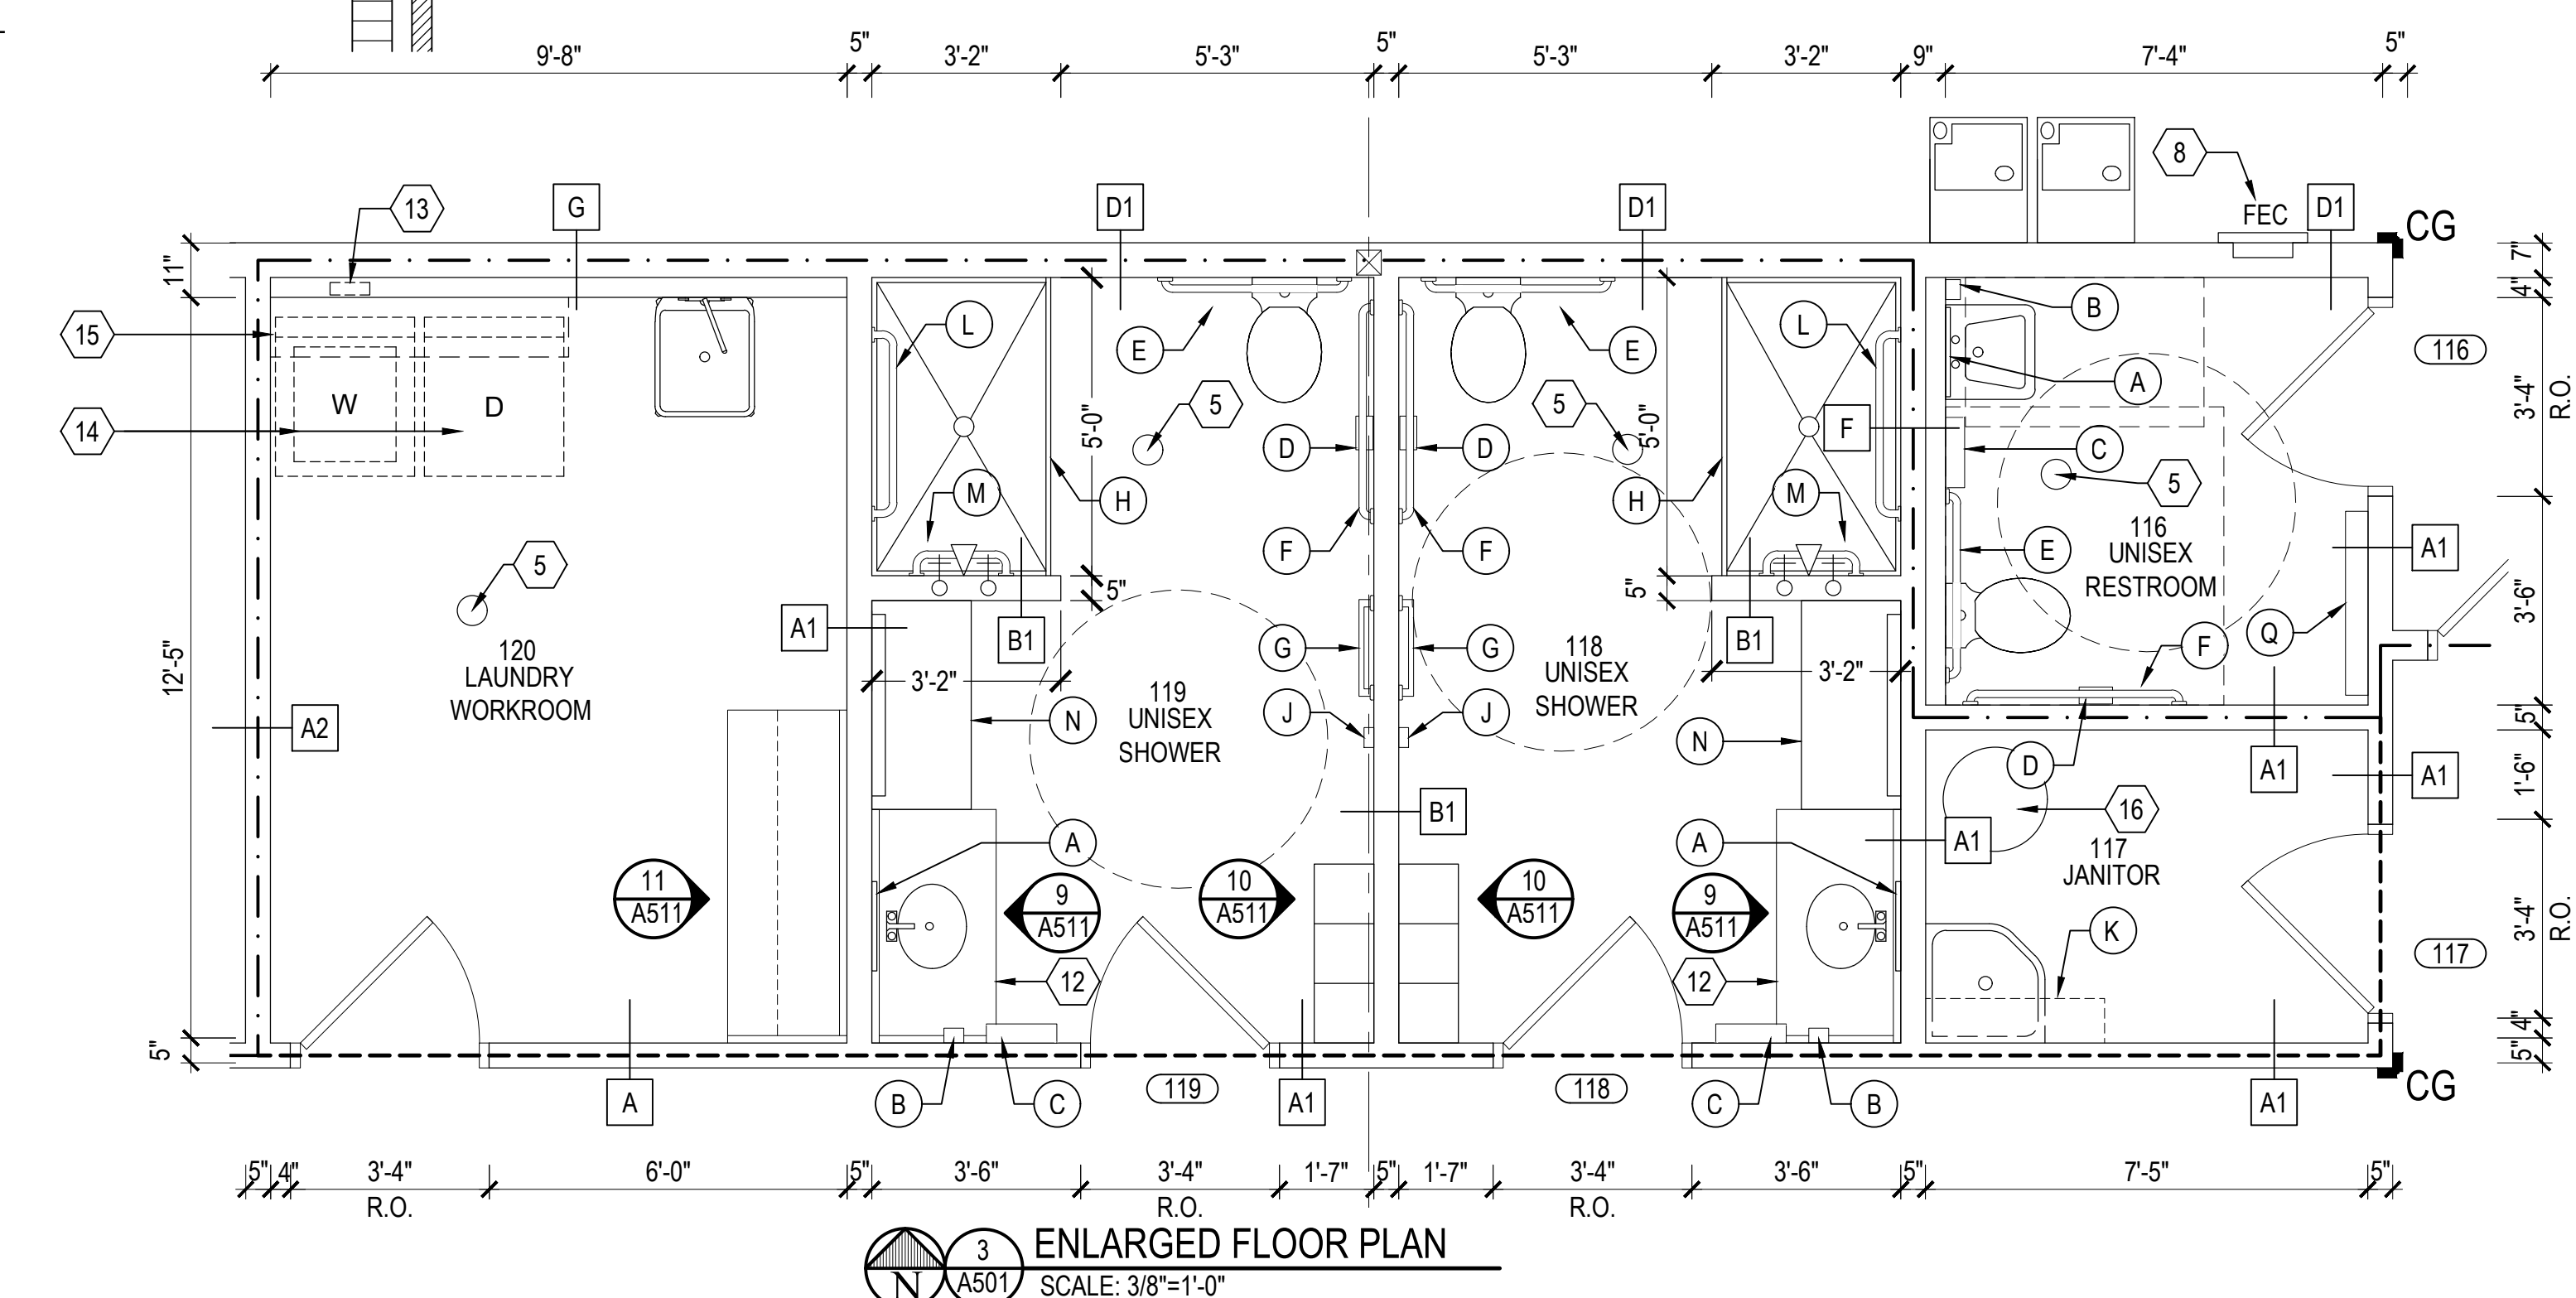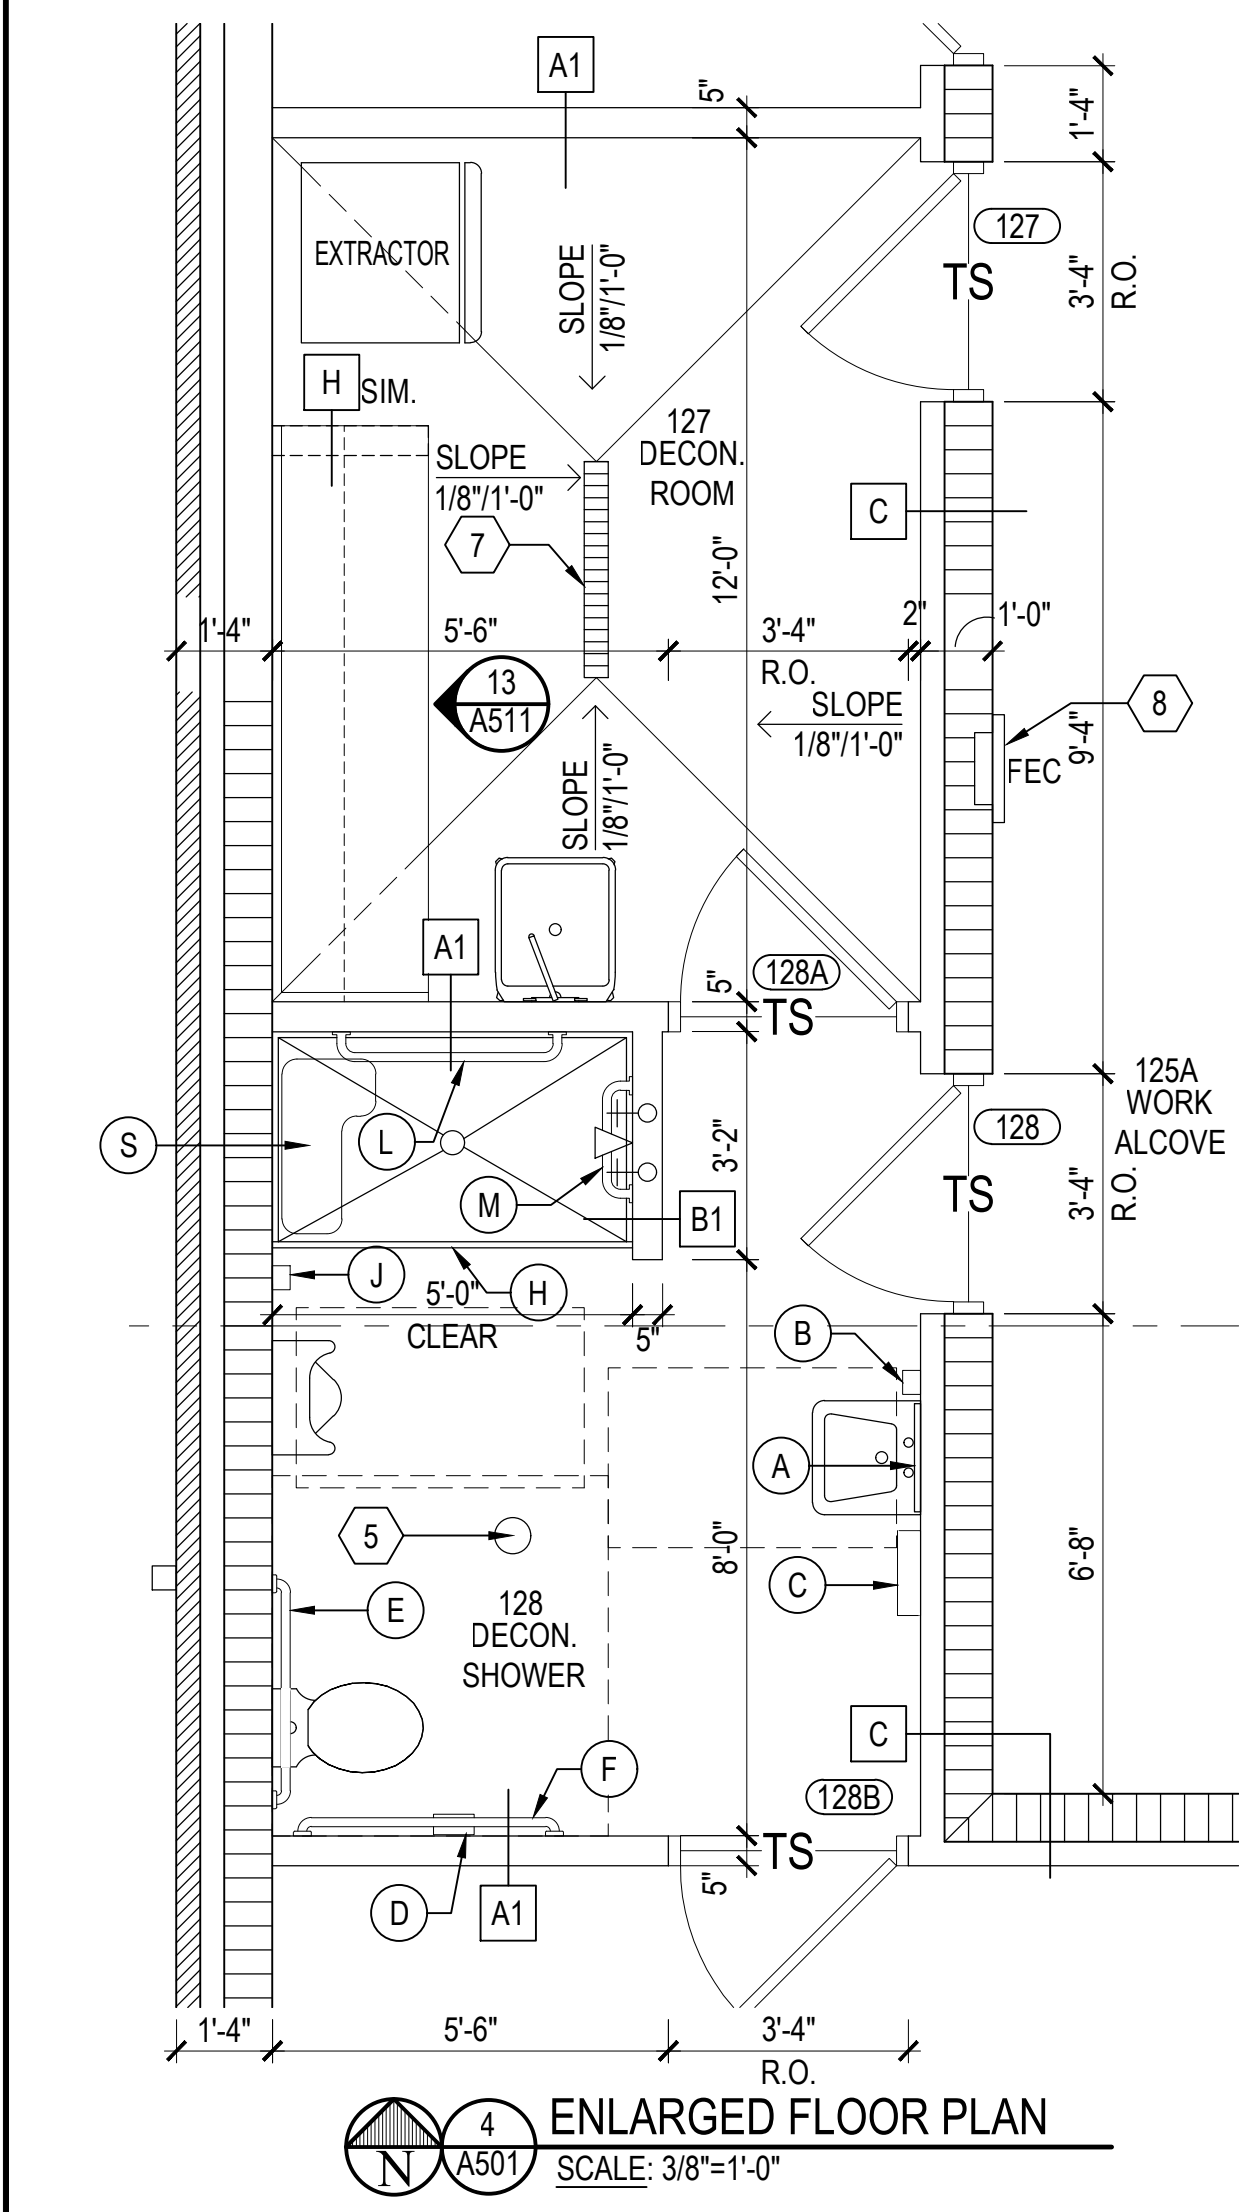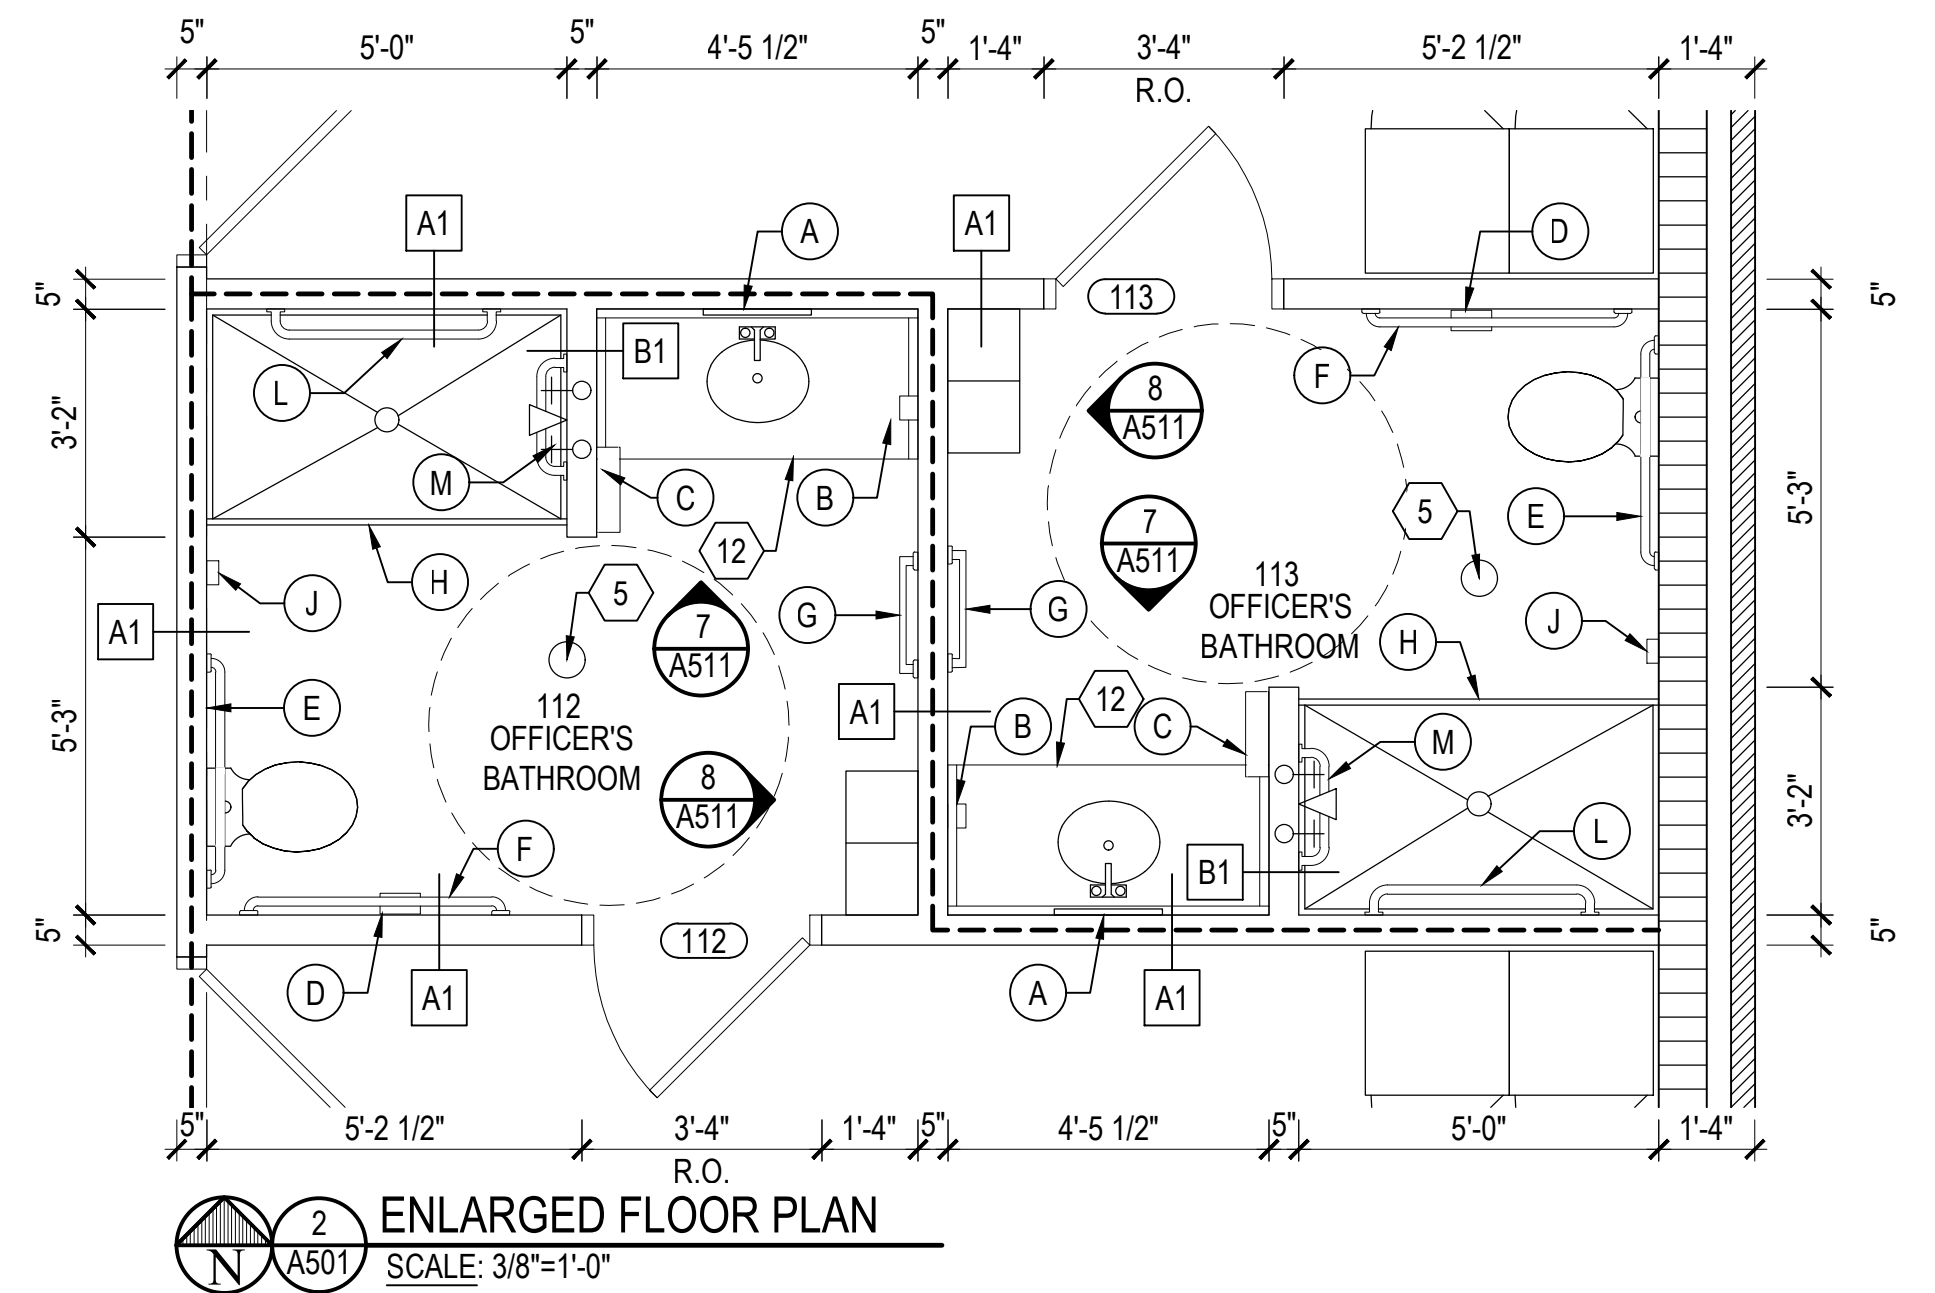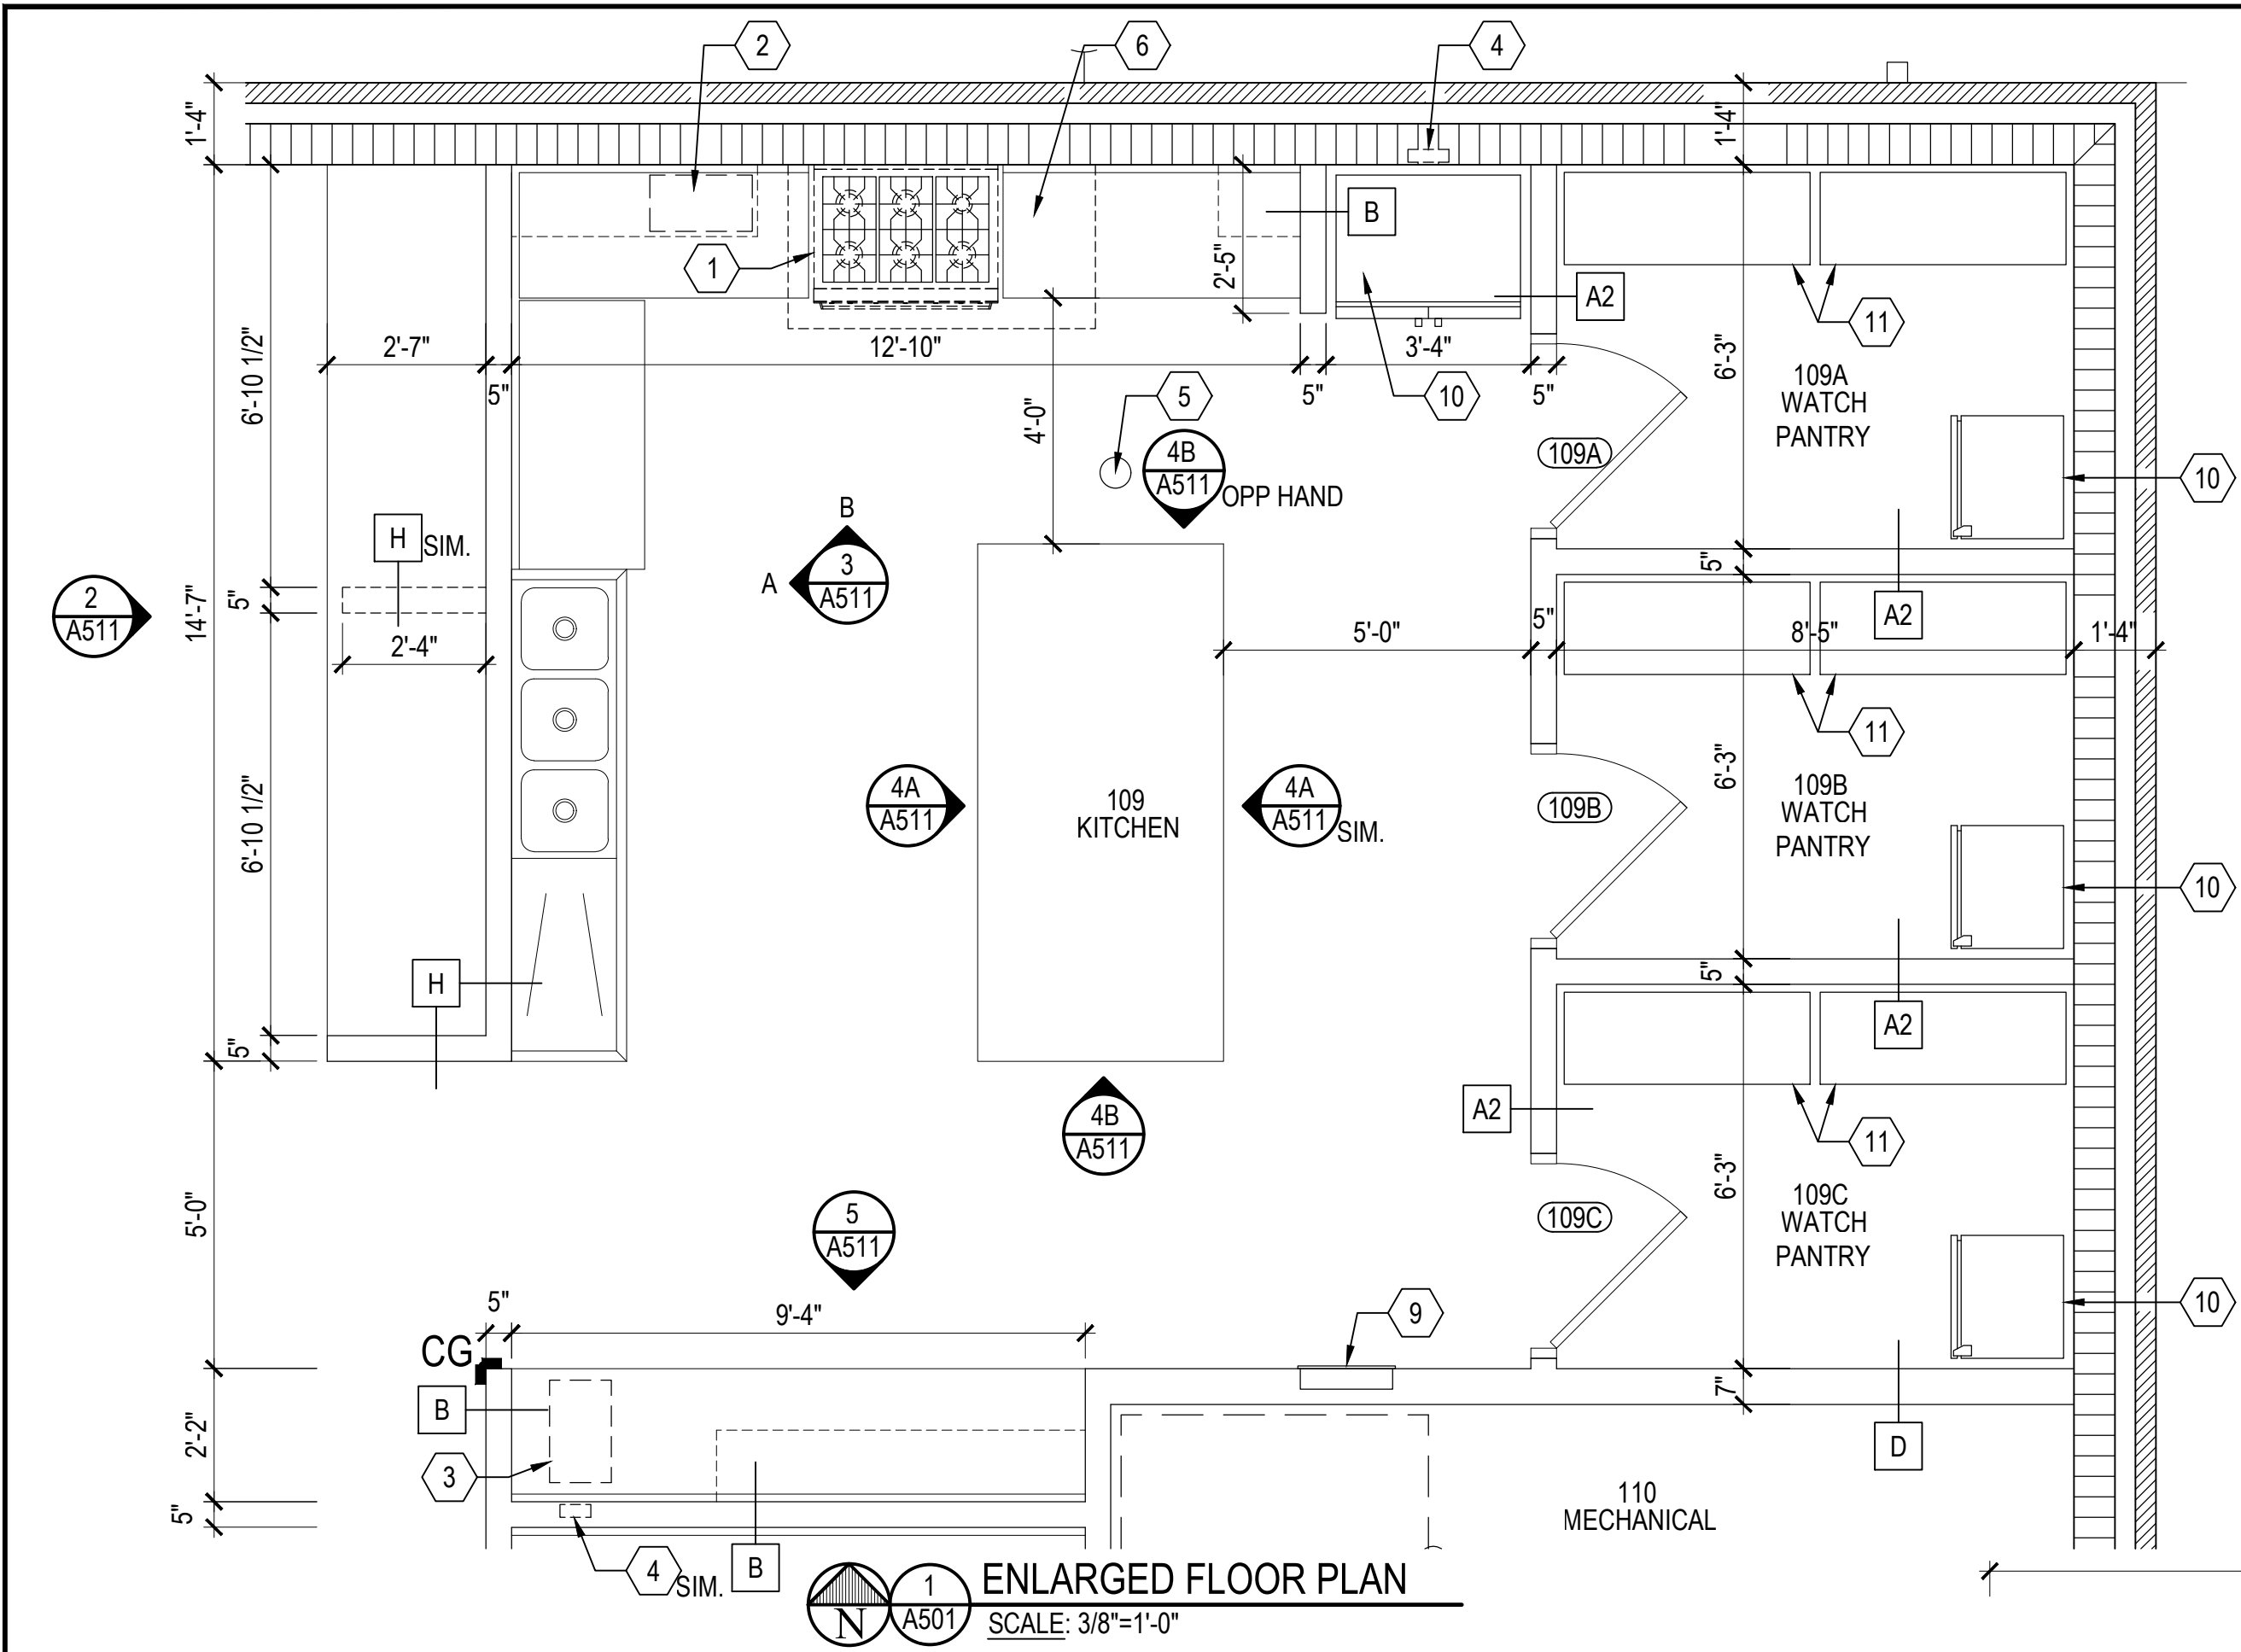

ADA PLUMBING AND ACCESSORY MOUNTING LOCATIONS

- (A) 18" X 36" MIRROR WITH SST FRAME DIMENSION AFF TO REFLECTIVE EDGE
- (B) SURFACE MOUNT SOAP DISPENSER - OF/CI
- (C) SURFACE MOUNT PAPER TOWEL DISPENSER - OF/CI
- (D) SURFACE MOUNT TOILET PAPER DISPENSER MULTIROLL - OF/CI
- (E) GRAB BAR: 36" X 1 1/2" DIA.
- (F) GRAB BAR: 42" X 1 1/2" DIA.
- (G) 18" TOWEL BAR
- (H) CURTAIN ROD AND CURTAIN
- (J) ROBE HOOK
- (K) STAINLESS STEEL SHELF WITH MOP AND BROOM HOLDERS AND HOOKS
- (L) 48" X 1-1/2" DIA. GRAB BAR
- (M) 24" X 1-1/2" DIA. GRAB BAR
- (N) 42" X 24" X 17" H WOOD BENCH WITH SST PEDESTALS & BACK REST--ADA COMPLIANT
- (P) 12" X 12" X 18" H DOUBLE STACK STEEL LOCKERS, ON COUNTER TOP
- (Q) FOLDING DIAPER CHANGING STATION, WALL MOUNT
- (R) 24" X 72" VANITY MIRROR, WALL MOUNT
- (S) FOLDING SHOWER SEAT

LEGEND

- 1-HOUR FIRE BARRIER
- 1/2-HOUR FIRE BARRIER

KEYNOTES

- 1 OFCI 6-BURNER GAS RANGE
- 2 OFCI MICROWAVE OVEN
- 3 OFCI COFFEE MACHINE, PROVIDE WATER SUPPLY, SEE PLUMBING
- 4 REFRIGERATOR UTILITY BOX WITH WATER SUPPLY, SEE PLUMBING
- 5 FLOOR DRAIN - SEE PLUMBING
- 6 KITCHEN HOOD EXHAUST - SEE MECHANICAL, EXTEND MIN. 6" BEYOND RANGE.
- 7 TRENCH DRAIN, SEE PLUMBING.
- 8 RECESSED FIRE EXTINGUISHER CABINET WITH ONE - 10 LBS. ABC EXTINGUISHER.
- 9 RECESSED CIRCUIT BREAKER PANEL, SEE ELECTRICAL.
- 10 OFCI REFRIGERATOR.
- 11 OFOI 48"x18" METAL SHELVING RACKS, ON CASTERS.
- 12 SOLID-SURFACE COUNTER TOP AND BACK SPLASH: SEE CASEWORK DETAILS.
- 13 LAUNDRY UTILITY BOX, SEE MECHANICAL.
- 14 OFCI CLOTHES WASHER AND DRYER.
- 15 ENAMELED STEEL ADJUSTABLE WIRE SHELVES ON HEAVY DUTY ENAMELED STEEL BRACKETS AND STANDARDS - 12" X 5'-0" - PROVIDE 2 ROWS OF SHELVES AND 3 ROWS OF STANDARDS AT ROOM 120. SEE ELEVATION 13/A511 FOR ROOM 127.
- 16 WATER HEATER WITH CIRCULATING PUMP, SEE PLUMBING AND ELECTRICAL.


NOTES:

- 1. PROVIDE UNDER LAVATORY PIPE GUARDS FOR ALL LAVATORY LOCATIONS
- 2. CONTRACTOR TO PROVIDE BLOCKING FOR ALL TOILET ACCESSORIES, INCLUDING FUTURE ACCESSORIES IN SHOWERS, WHERE SEATS ARE NOT SHOWN.
- 3. WATER CLOSET FLUSH CONTROLS SHALL BE LOCATED ON OPEN SIDE OF WATER CLOSET.


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision		


Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

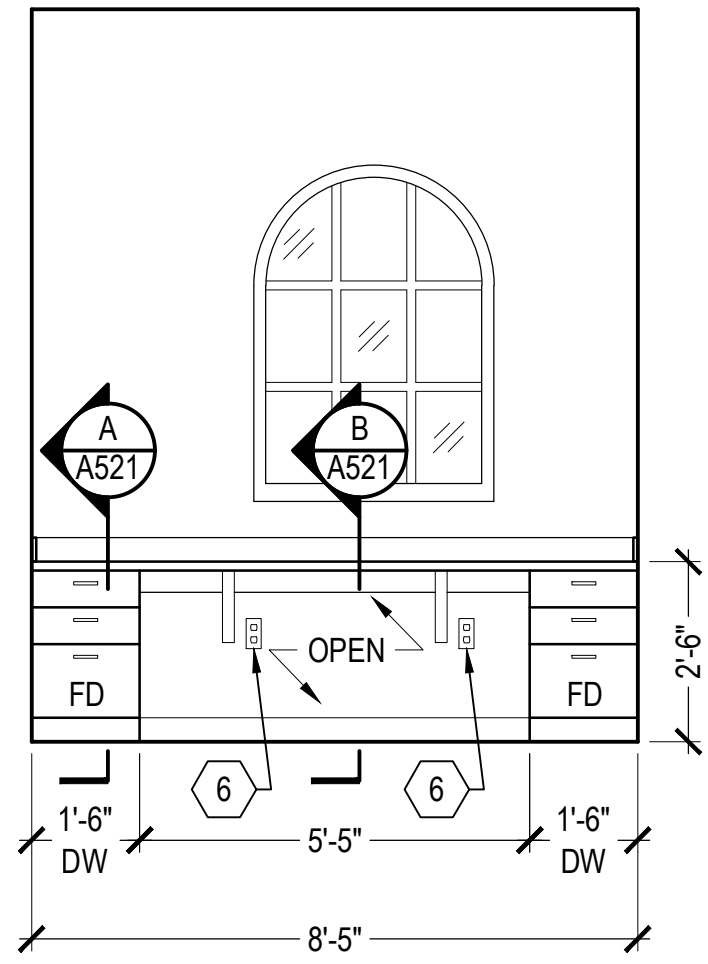


1 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

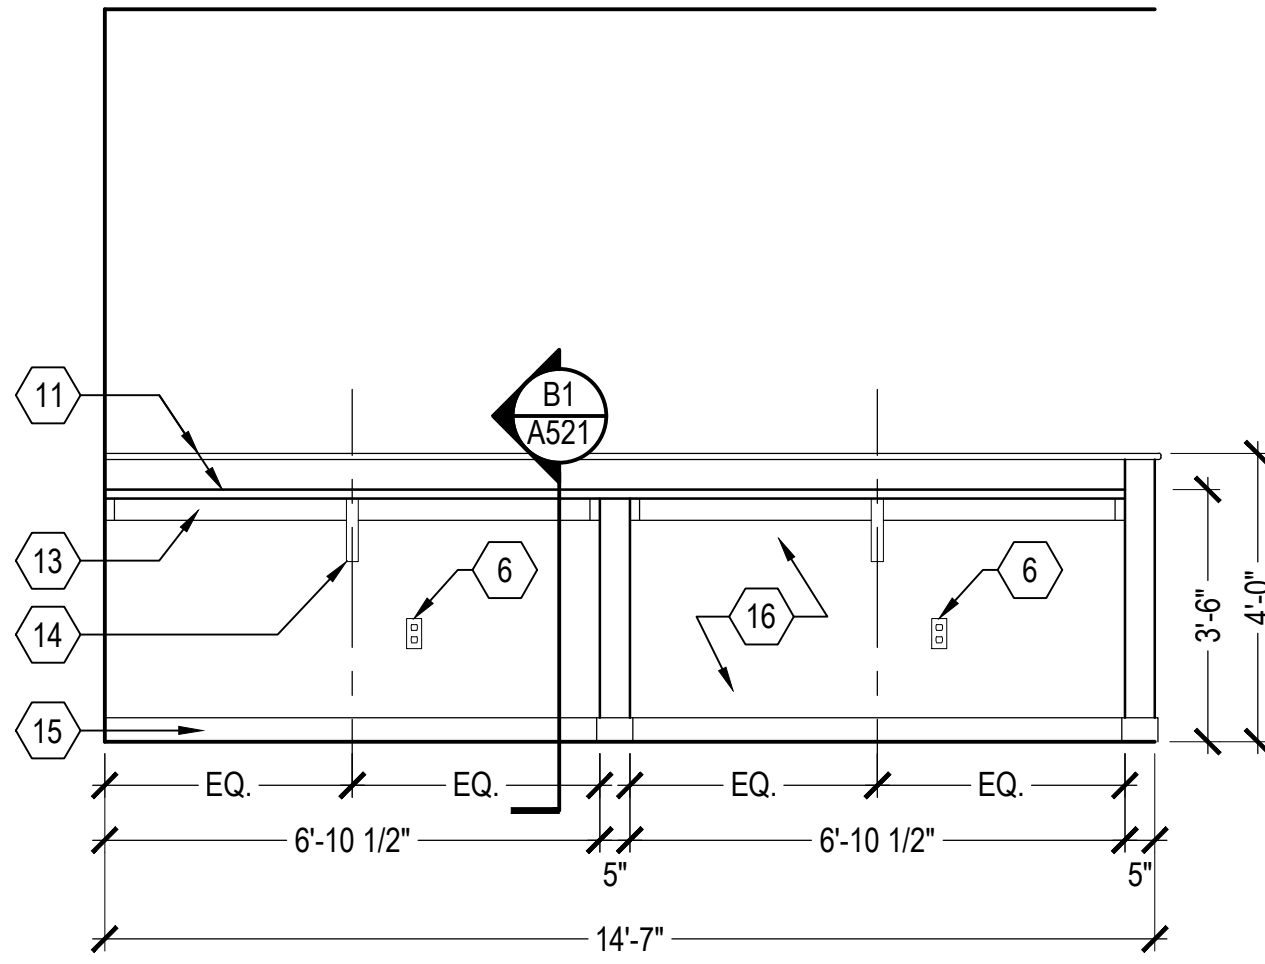


2 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

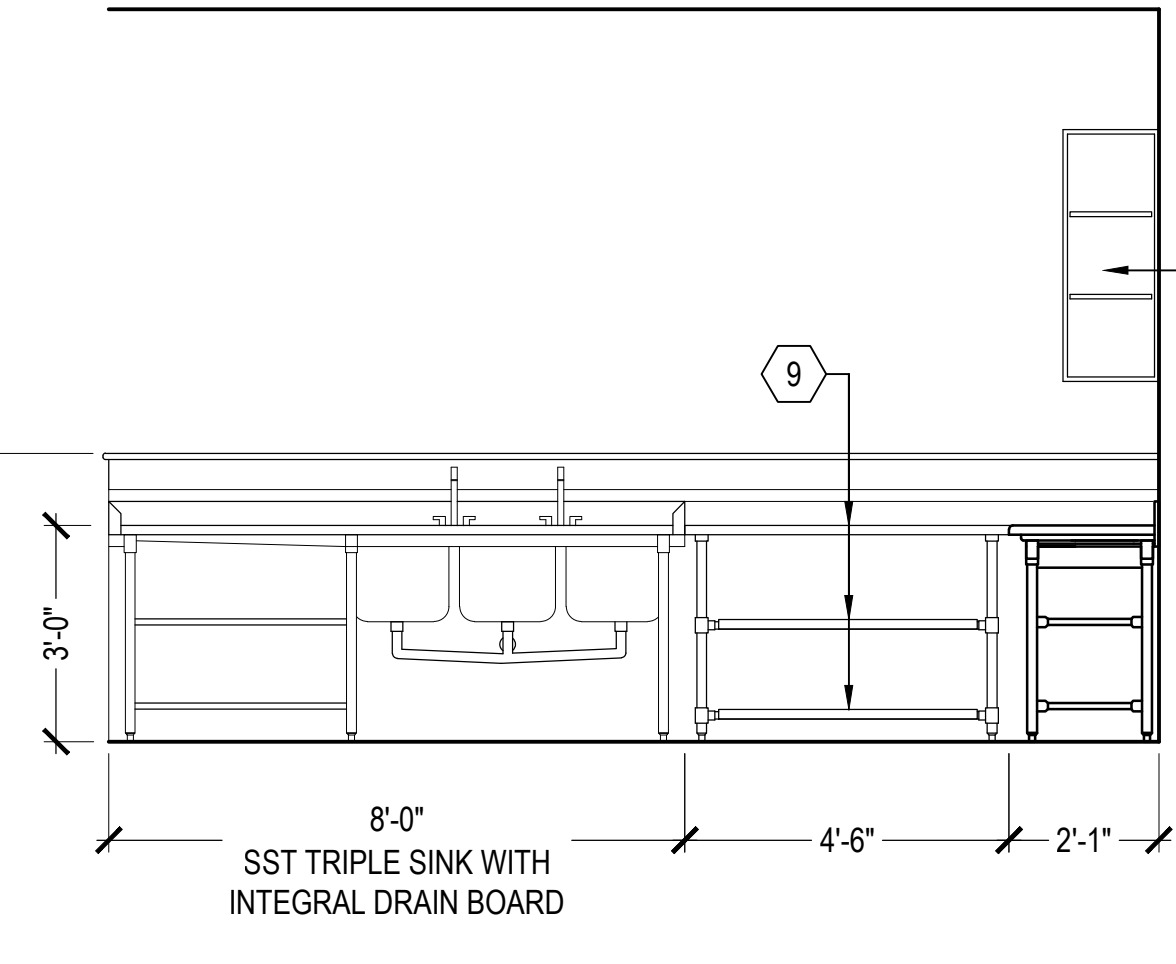


3A CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

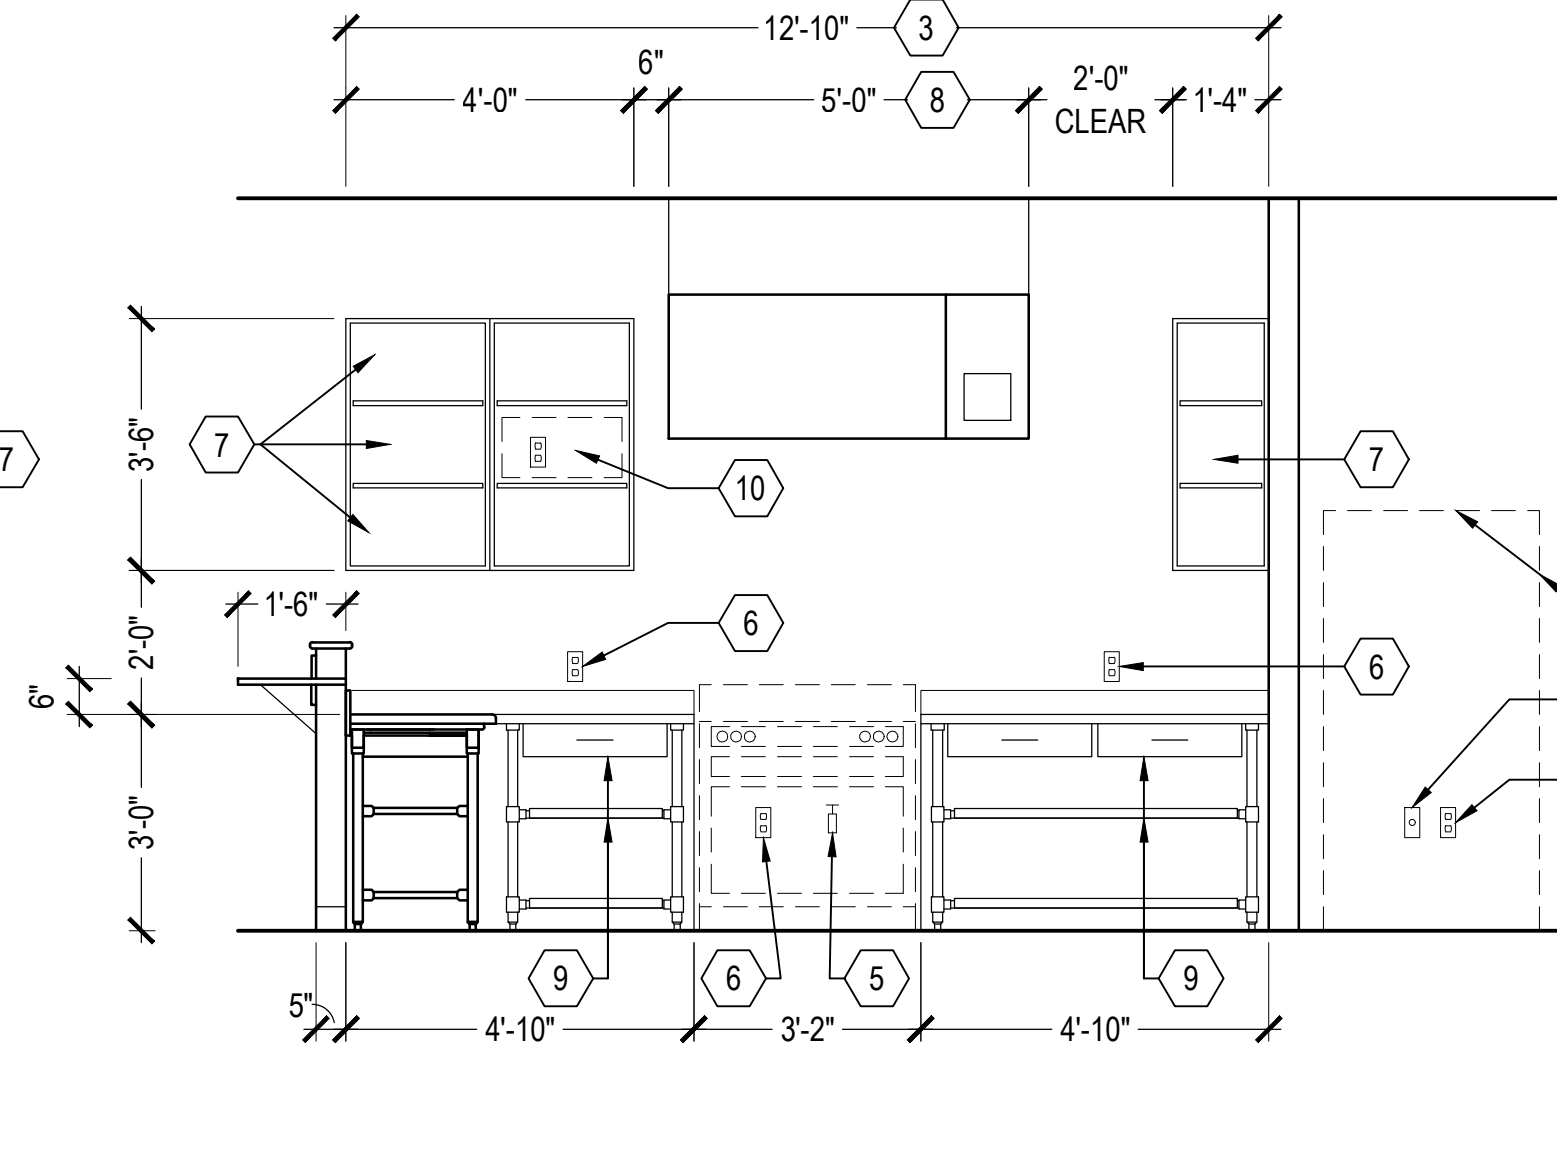


3B CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

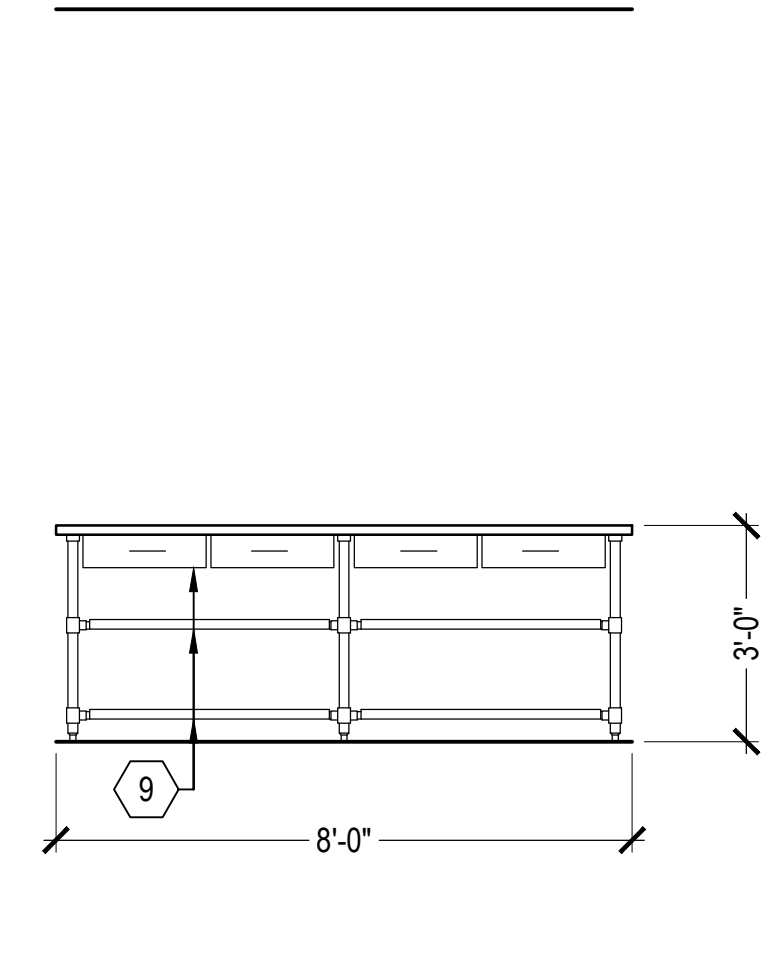


4A CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

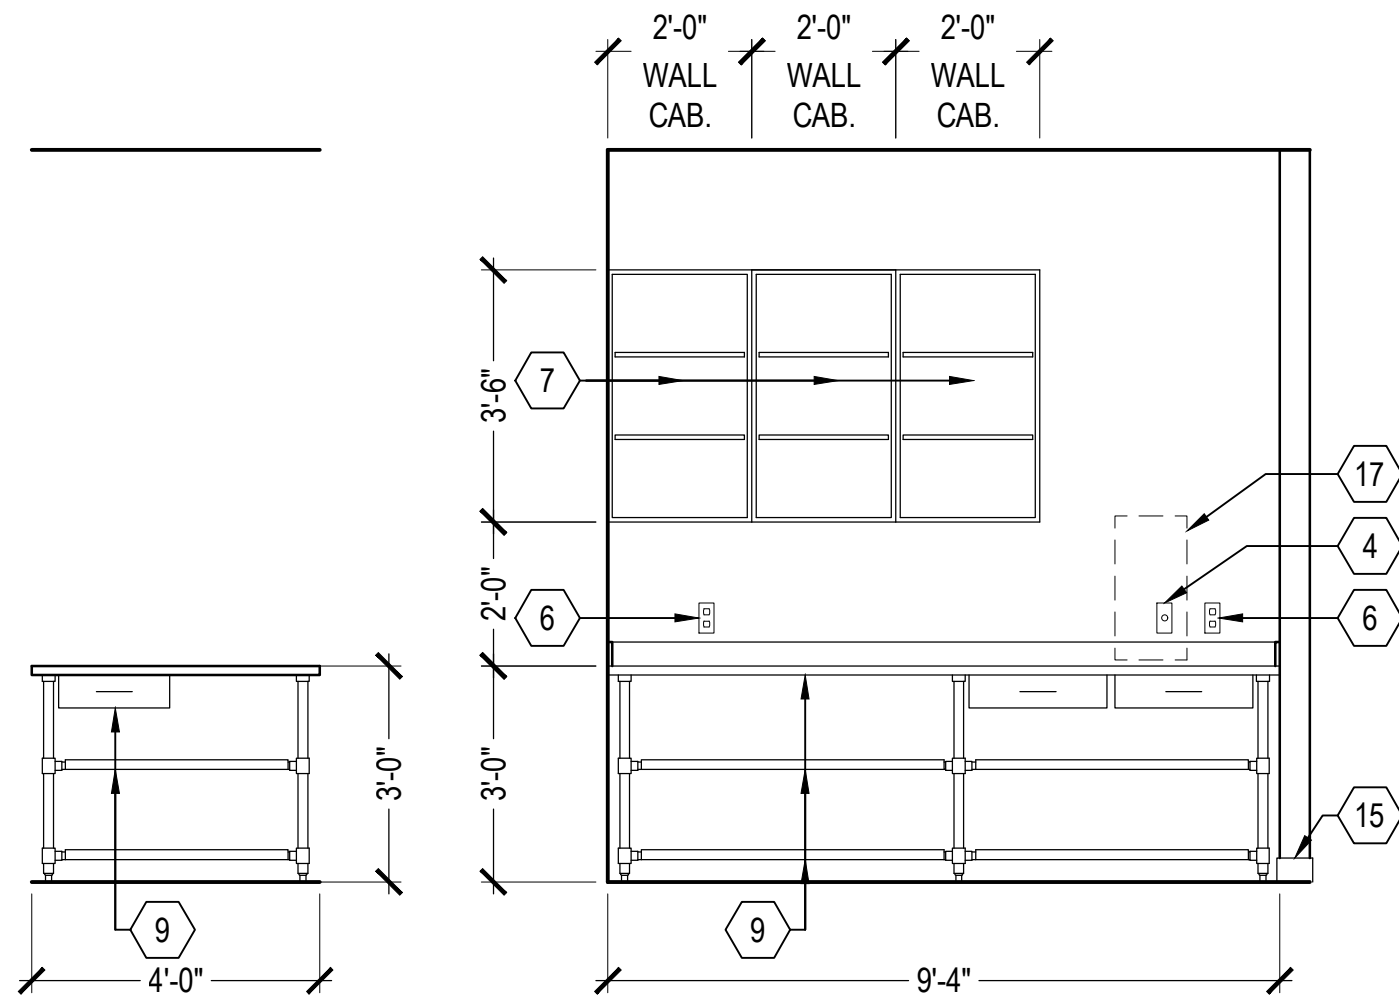


4B CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

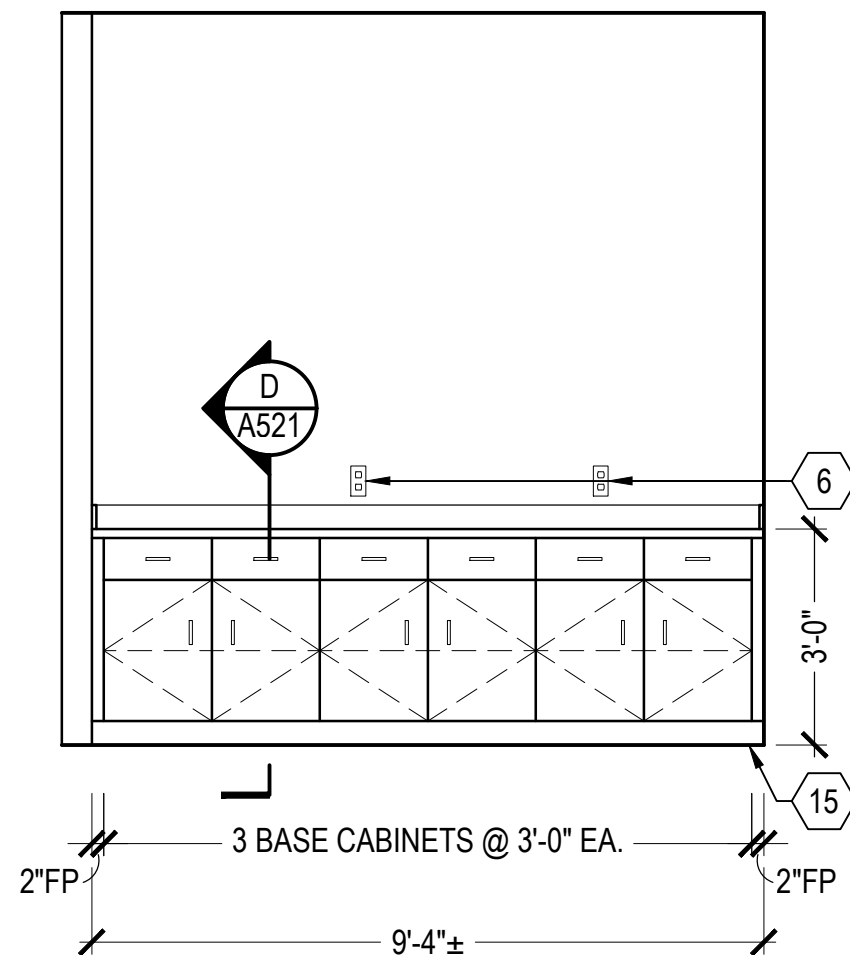


5 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

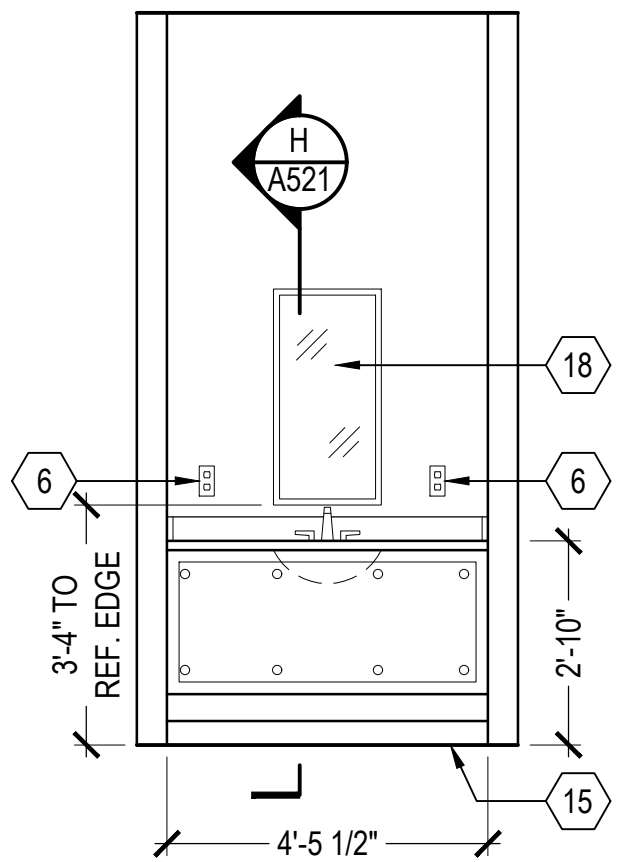


6 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

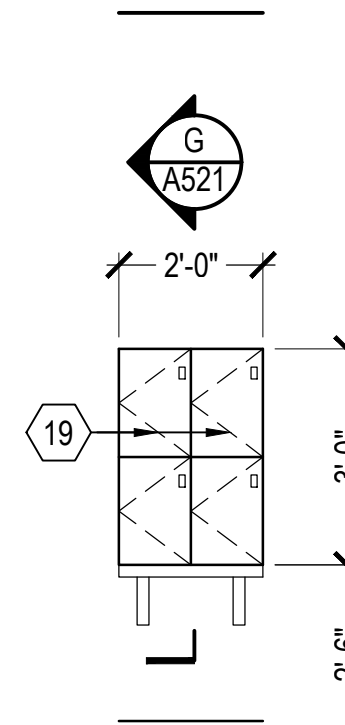


7 CASEWORK ELEV.
A511 SCALE: 3/8"=1'-0"

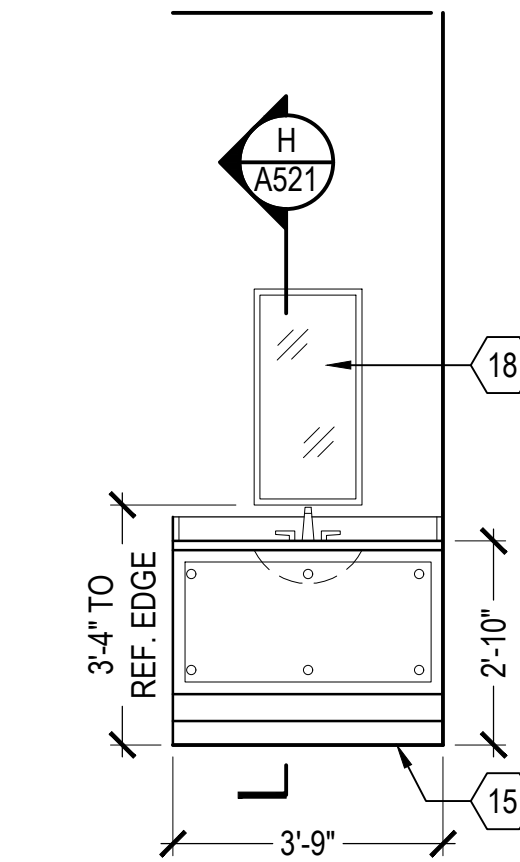


8 CASEWORK ELEV.
A511 SCALE: 3/8"=1'-0"

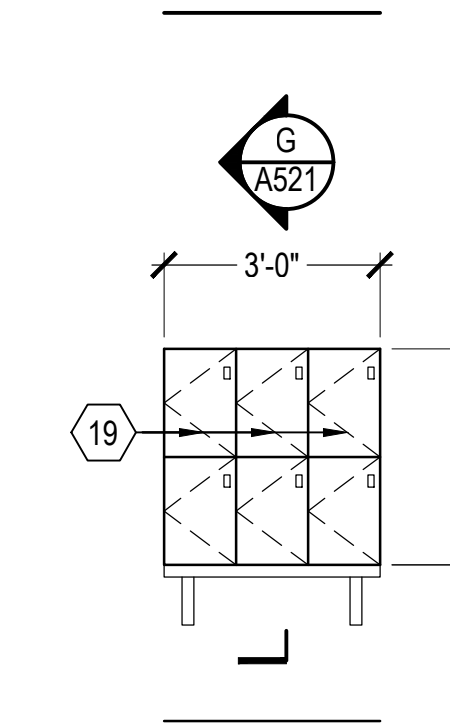

9 CASEWORK ELEV.
A511 SCALE: 3/8"=1'-0"

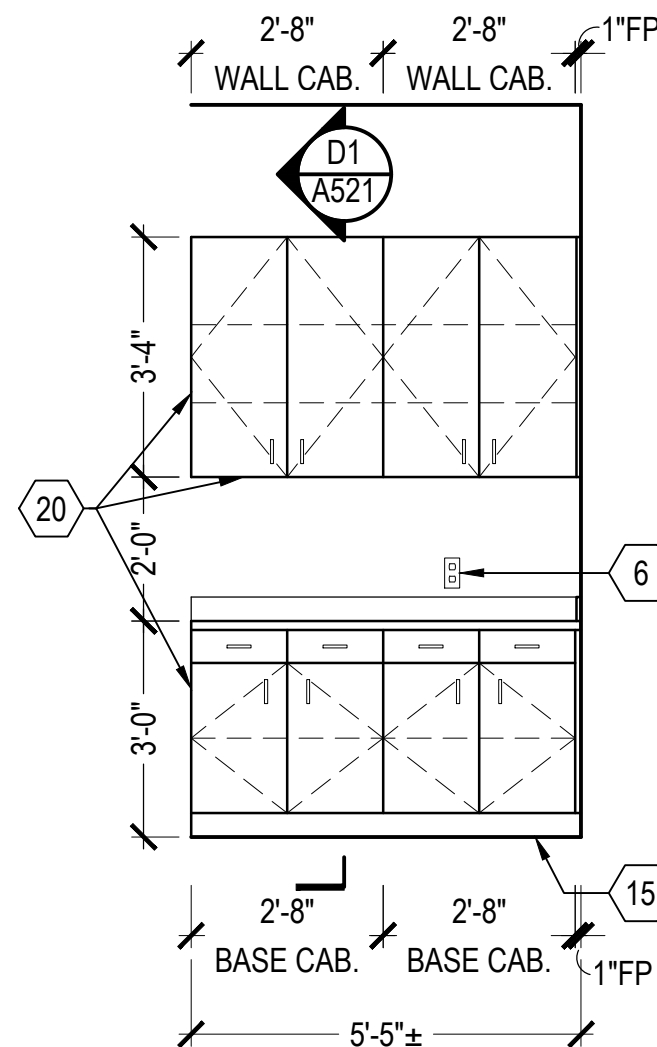


10 CASEWORK ELEV.
A511 SCALE: 3/8"=1'-0"

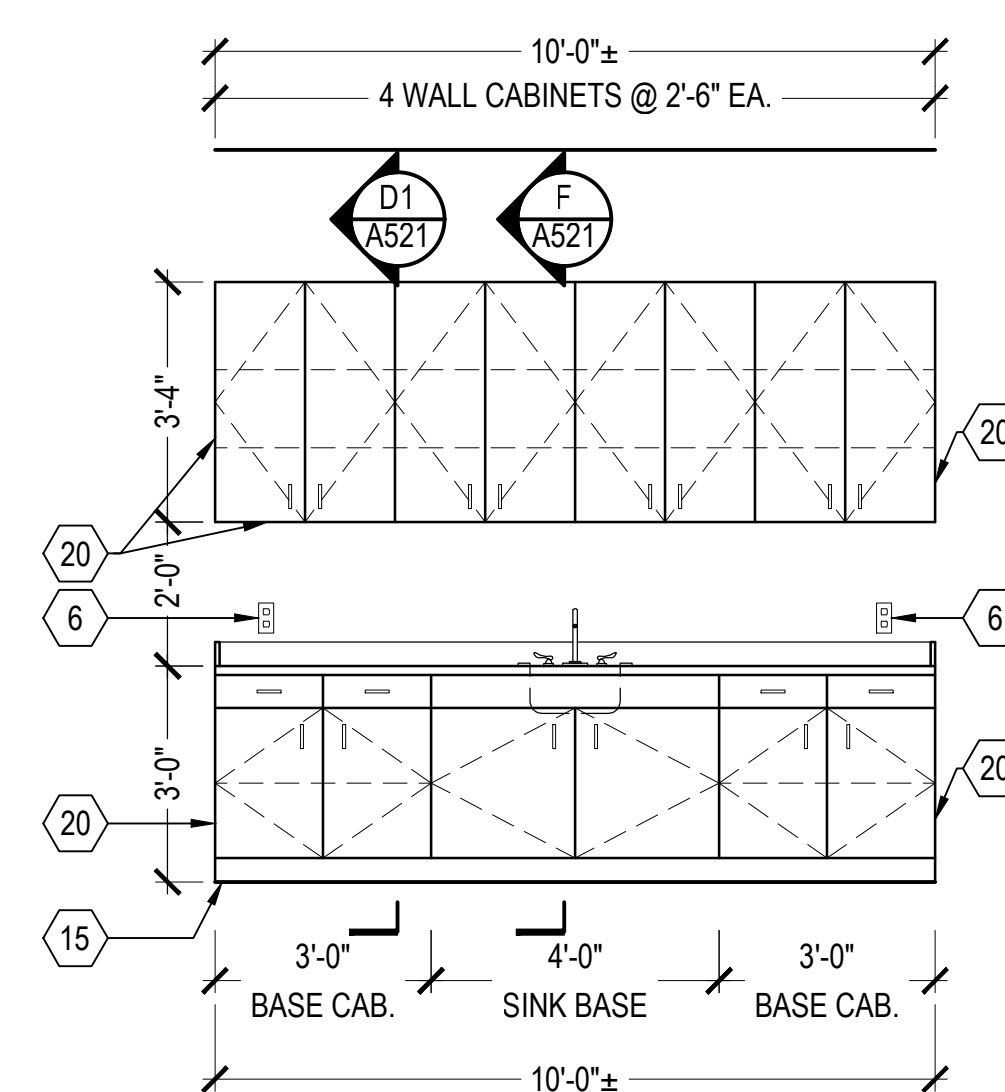

11 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

12 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"

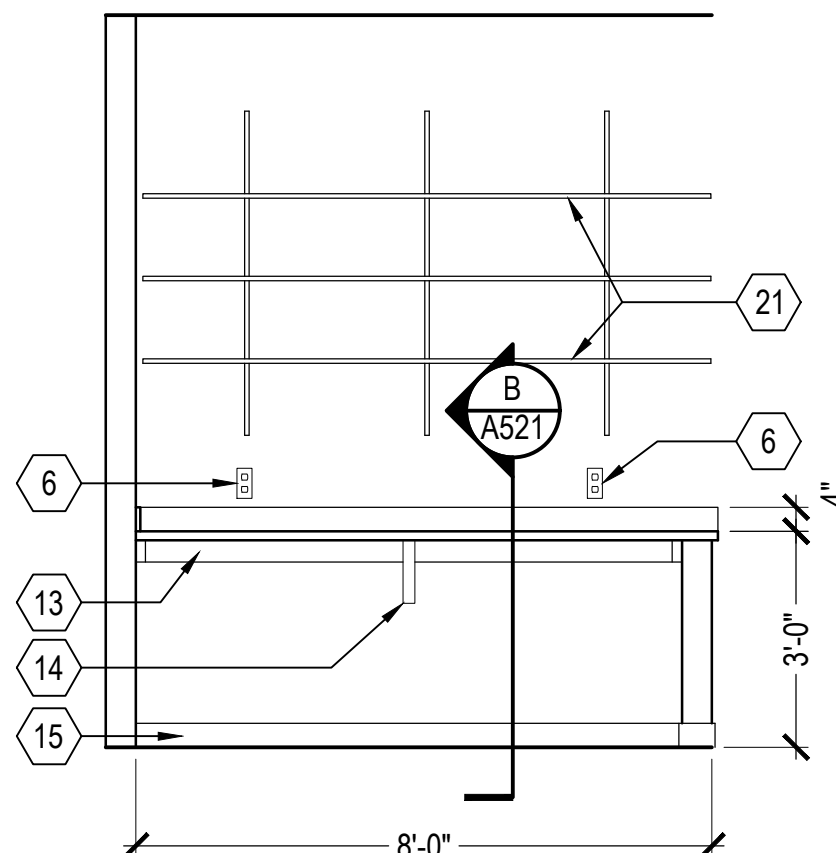

13 CASEWORK ELEVATION
A511 SCALE: 3/8"=1'-0"


KEYNOTES	
1 OFCI REFRIGERATOR WITH ICE MACHINE	12 4" SOLID SURFACE BACK SPLASH.
2 OFCI 36" GAS RANGE	13 2x4 WOOD BLOCKING, CONTINUOUS, PAINT.
3 24 GAUGE, TYPE 304 POLISHED STAINLESS STEEL, FULLY ADHERE TO CMU, FULL HEIGHT.	14 HEAVY DUTY STEEL COUNTERTOP BRACKET, PROVIDE WOOD BLOCKING IN WALL.
4 ICE MAKER / COFFEE MAKER / REFRIGERATOR UTILITY BOX, SEE PLUMBING DRAWING	15 4" RESILIENT BASE.
5 GAS COCK, SEE PLUMBING	16 0.040 VINYL WALL PANEL, FULLY ADHERE TO WALL.
6 ELECTRICAL DUPLEX OUTLET, SEE ELECTRICAL	17 COFFEE MAKER - OFCI.
7 STAINLESS STEEL OPEN SHELVE, 12" DEEP WITH 2 ADJUSTABLE SHELVES, EACH. (NO DOORS)	18 18x36" MIRROR IN STAINLESS STEEL FRAME.
8 STAINLESS STEEL KITCHEN EXHAUST HOOD, PROVIDE WITH STAINLESS STEEL SHROUD THROUGH FINISH CEILING, SEE MECHANICAL.	19 12"x18" DOUBLE TIER STEEL LOCKERS.
9 STAINLESS STEEL TABLE ON CASTERS WITH ONE ADJUSTABLE SHELF AND ONE FIXED LOWER SHELF. PROVIDE 4" DEEP DRAWER(S) WHERE SHOWN, PROVIDE 4" HIGH BACK SPLASH WHERE INDICATED.	20 PROVIDE PLASTIC LAMINATE ON ALL EXPOSED SURFACES.
10 OFOI MICROWAVE OVEN	21 ENAMELED STEEL WIRE RACK ADJUSTABLE SHELVES ON HEAVY DUTY ENAMELED STEEL BRACKET AND STANDARDS.
11 SOLID SURFACE TOP ON 3/4" PLYWOOD, BULLNOSE EXPOSED EDGES.	

CASEWORK ELEVATIONS


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:
A511 SHEET #	

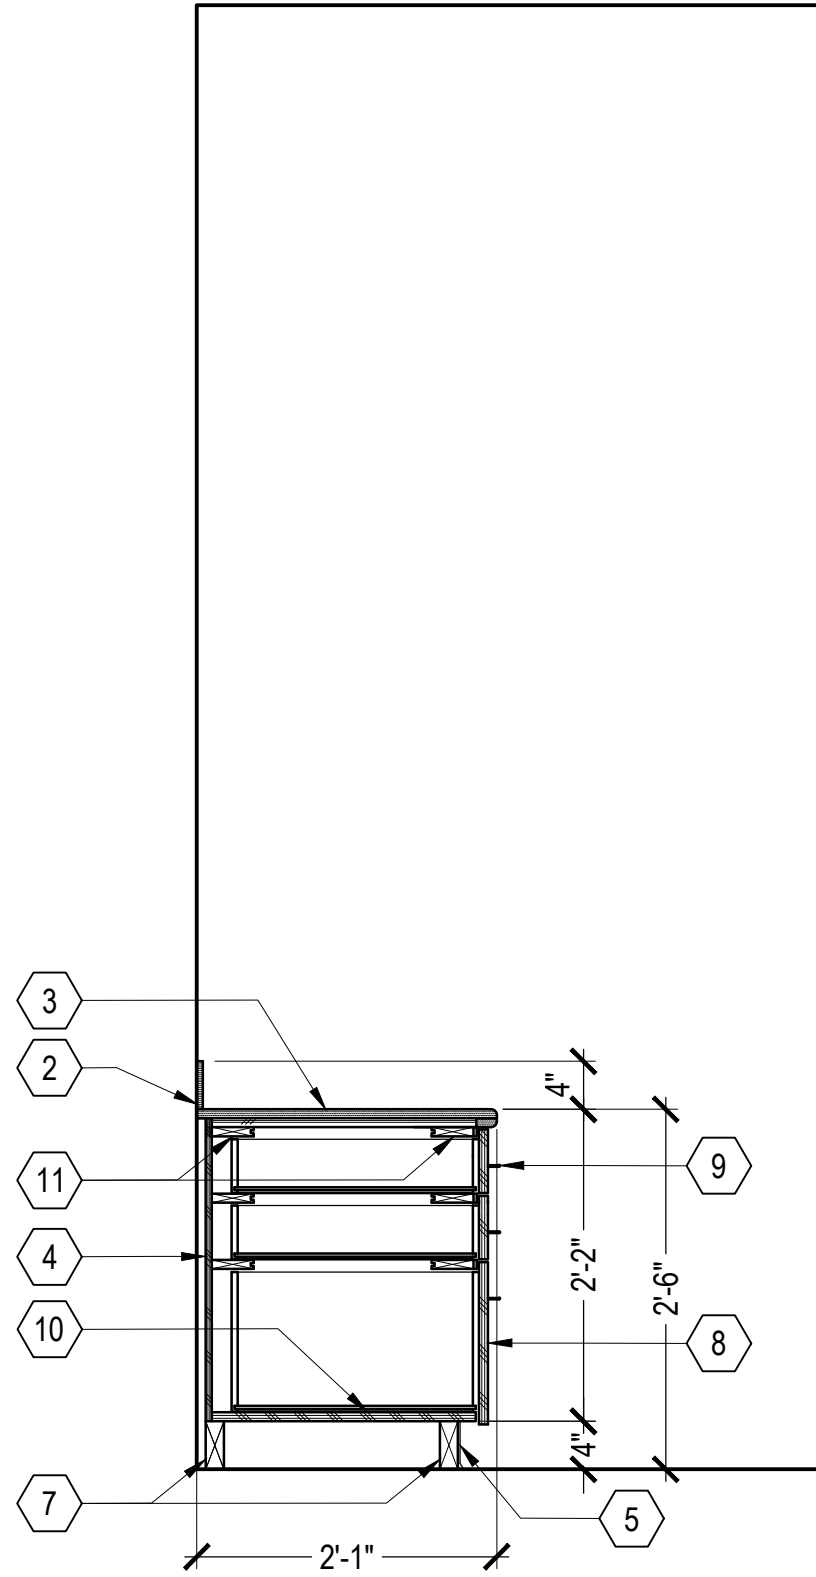


A CASEWORK SECTION
SCALE: 3/4"=1'-0"

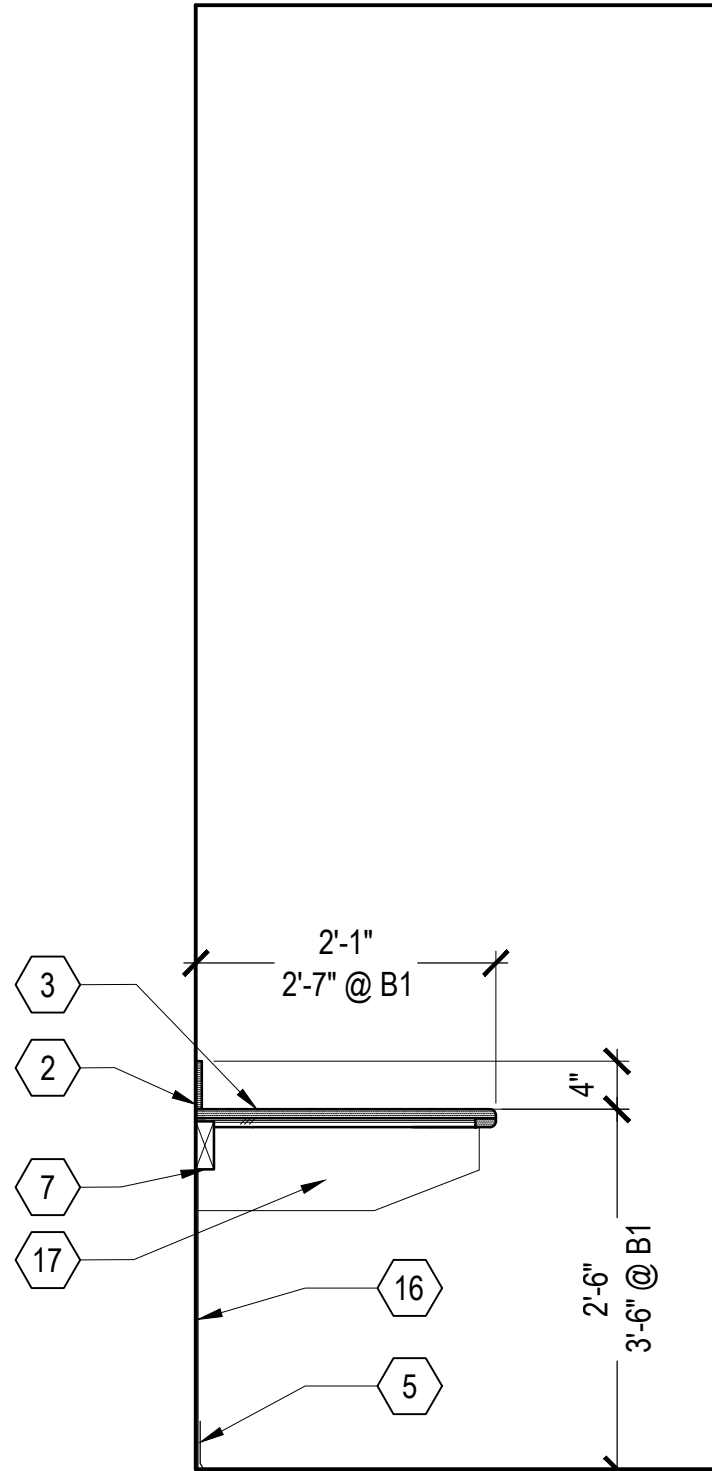


B **B1** CASEWORK SECTION
SCALE: 3/4"=1'-0"


C NOT USED
SCALE: 3/4"=1'-0"

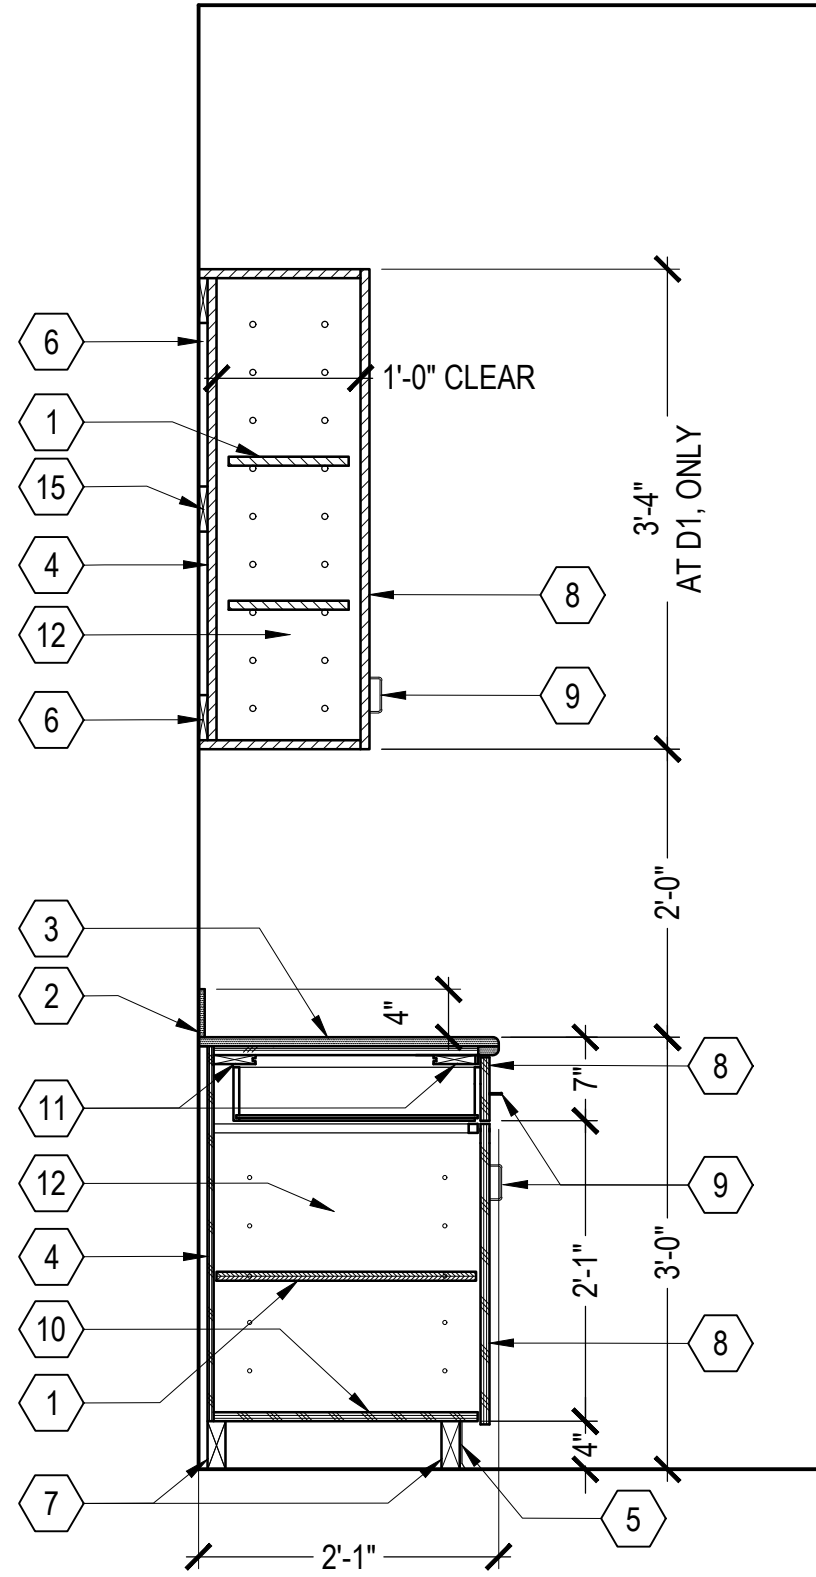


D **D1** CASEWORK SECTION
SCALE: 3/4"=1'-0"

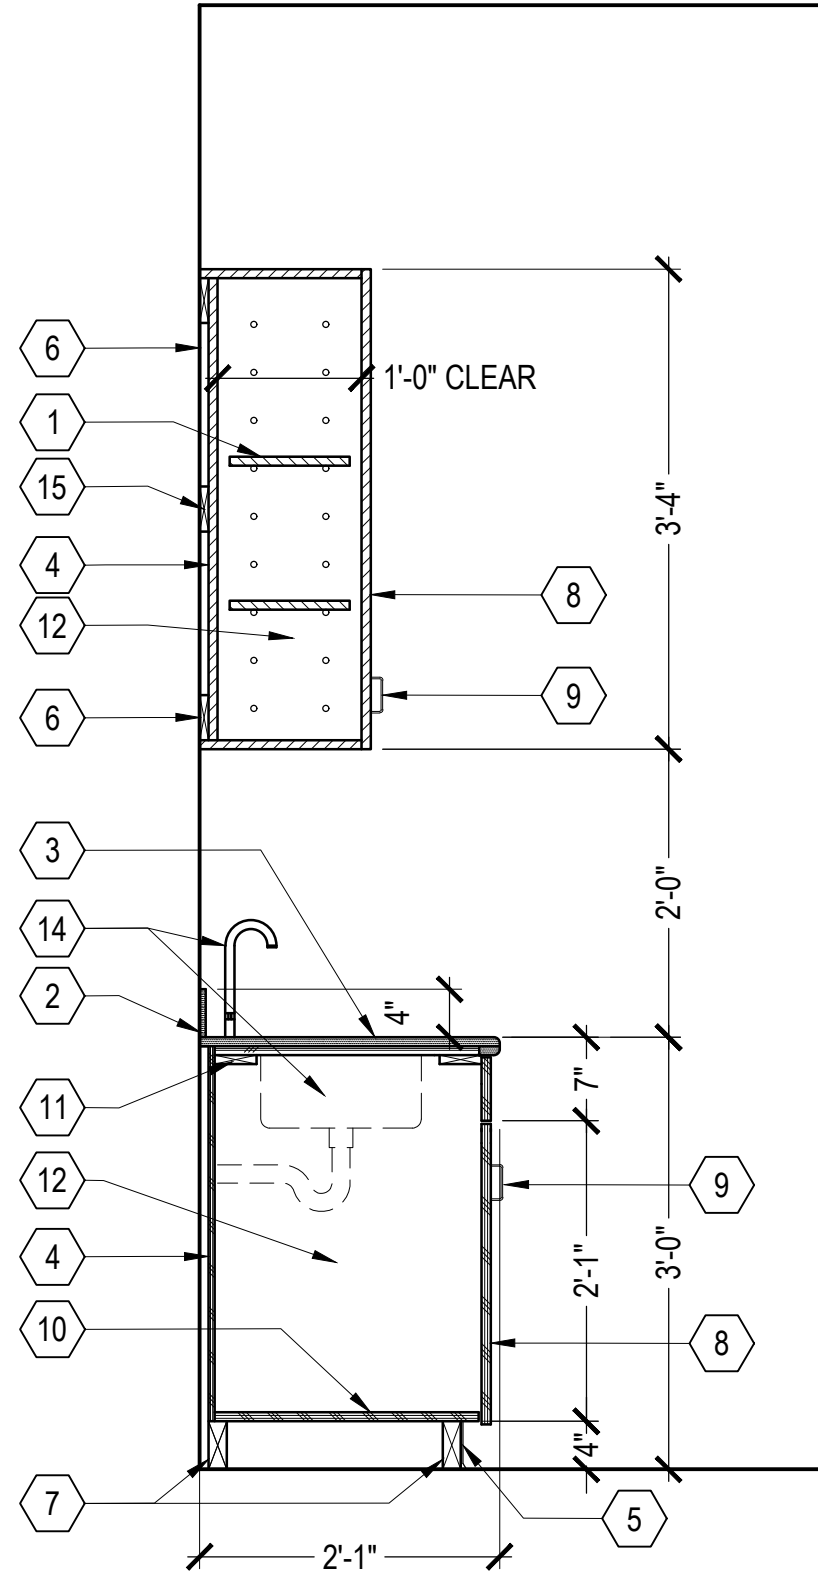

F CASEWORK SECTION
SCALE: 3/4"=1'-0"

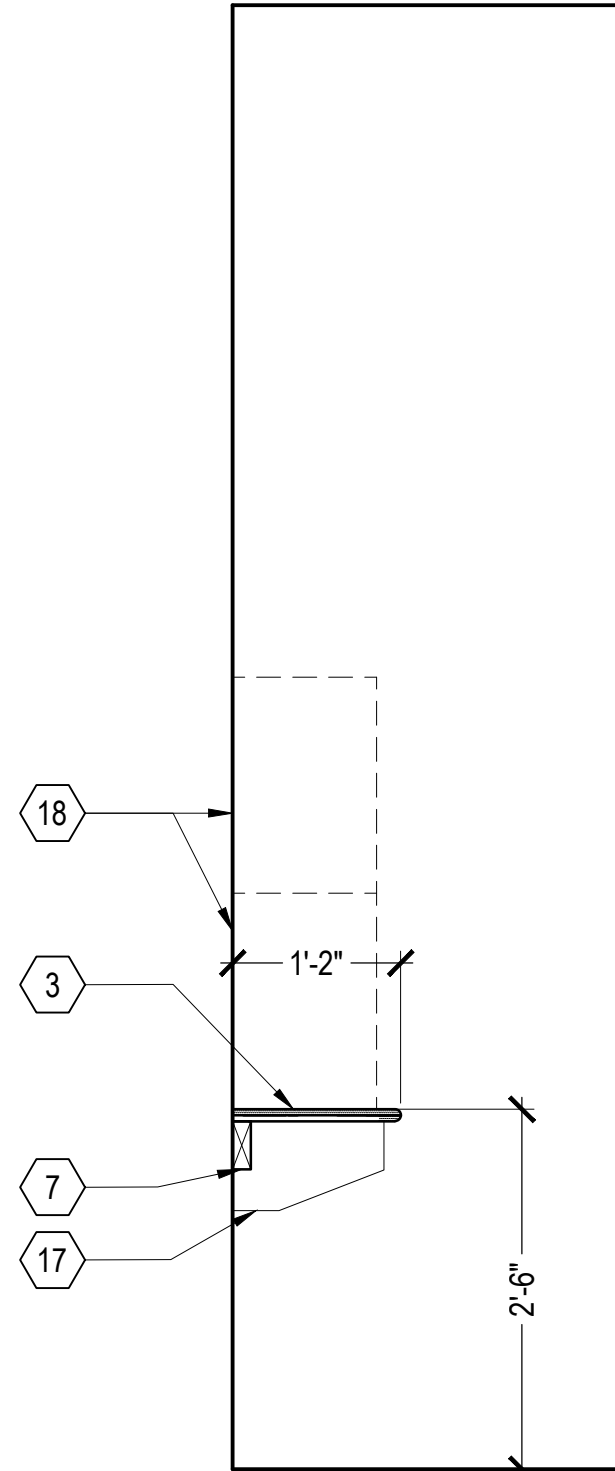

G CASEWORK SECTION
SCALE: 3/4"=1'-0"

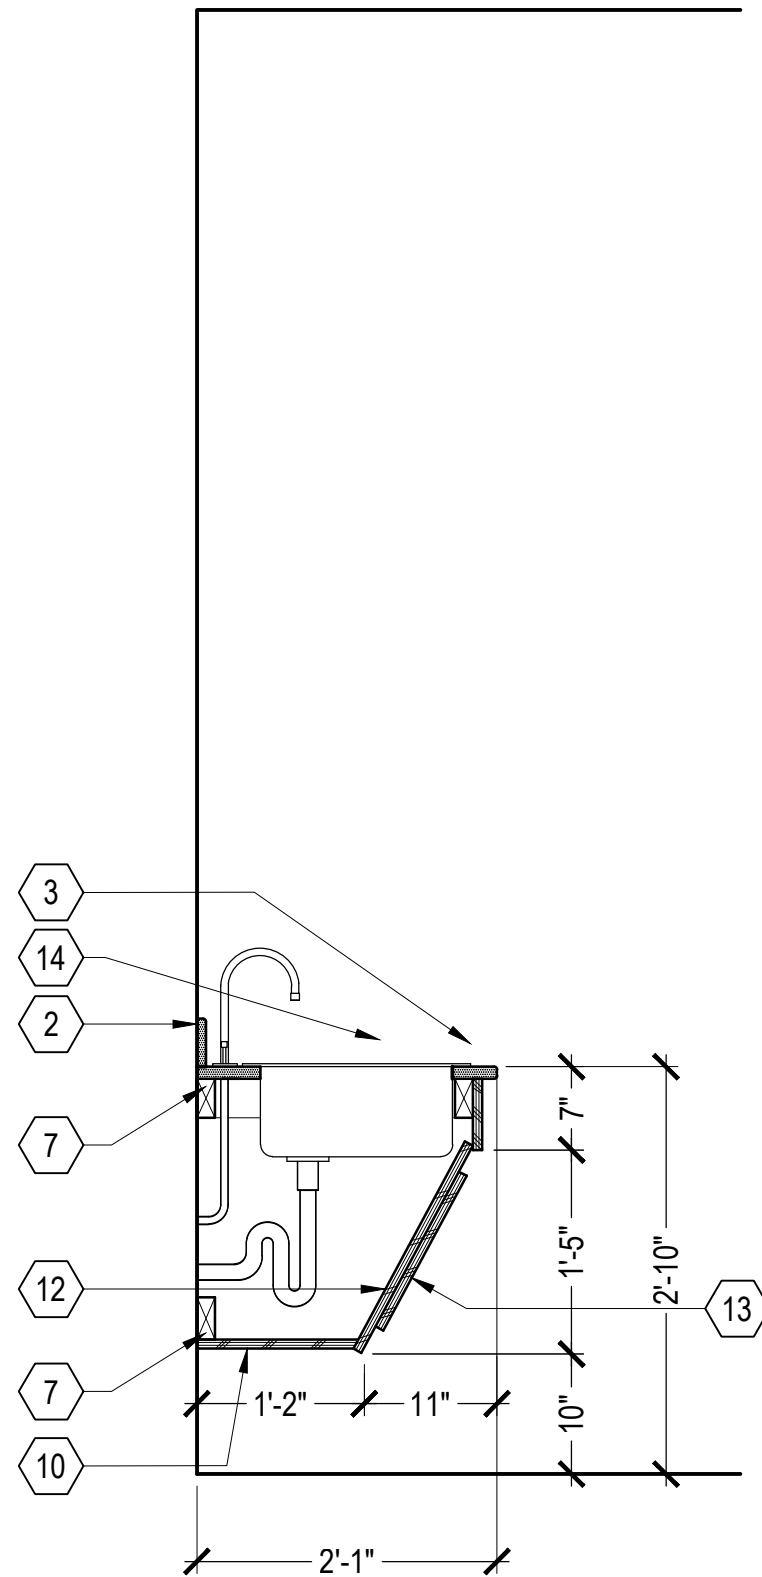

H CASEWORK SECTION
SCALE: 3/4"=1'-0"


- KEYNOTES
- ALL NOTES TYPICAL FOR SIMILAR COMPONENTS AT ALL CASEWORK
- 1 PLASTIC LAMINATE CLAD 32 MM ADJUSTABLE SHELF SYSTEM ON 3/4" THICK PLYWOOD. SHELF OR SHELVES WITH 3 MM PVC EDGE BAND.
 - 2 4"H SOLID-SURFACE BACKSPLASH - MATERIAL TO MATCH COUNTERTOP
 - 3 SOLID SURFACE COUNTERTOP WITH BULLNOSE EDGE ON 3/4" PLYWOOD--USE MOISTURE-RESISTANT PLYWOOD AT SINKS
 - 4 1/2" THICK PARTICLE BOARD PLASTIC LAMINATE CLAD BACK PANEL
 - 5 RESILIENT WALL BASE - AS PER FINISH SCHEDULE
 - 6 1" x4", TYP
 - 7 2X4 WOOD BLOCKING, CONTINUOUS, PAINT EXPOSED WOOD.
 - 8 3/4" PLASTIC LAMINATE CLAD 3/4" PLYWOOD DOOR / DRAWER FRONT WITH 3MM PVC EDGE BANDING.
 - 9 WIRE PULLS FOR ALL DOORS AND DRAWERS
 - 10 PLASTIC LAMINATE CLAD PLYWOOD CABINET BOTTOM WITH 3MM PVC EDGE BANDING
 - 11 1" x 4" SOLID WOOD REINFORCING
 - 12 3/4" PLASTIC LAMINATE CLAD PLYWOOD PANELS, FINISH ALL EXPOSED SURFACES. PROVIDE 3 MM PVC EDGE BAND AT ALL EXPOSED EDGES
 - 13 3/4" PLASTIC LAMINATE CLAD PARTICLE BOARD REMOVABLE ACCESS PANEL, WITH 3MM PVC EDGE BANDING
 - 14 SINK, SEE PLUMBING. INSULATE ALL EXPOSED PIPES
 - 15 PROVIDE BLOCKING FOR WALL CABINETS
 - 16 0.040 FULLY ADHERED VINYL WALL PANEL.
 - 17 HEAVY DUTY METAL ANGLED SUPPORT BRACKET, 48" MAX SPACING
 - 18 12" x 12" x 18" H DOUBLE TIER STEEL LOCKERS

CASEWORK
SECTIONS


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	


DOOR AND FRAME SCHEDULE																
NO.	TYPE	WIDTH	DOOR				FRAME					FIRE RATING	HDW SET	NOTES		
			HGT	THK	MTL	FIN	GLAZ	TYPE	MTL	FIN	HEAD				JAMB	SILL
101	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	IL	2	HM	PTD	1 / A602	2 / A602	3 / A602	--	1	1, 2, 3, 4
101A	VP	3'-0"	7'-0"	1-3/4"	SCWD	STN	L	1	HM	PTD	1 / A601	2 / A601	--	--	5	--
102	VP	3'-0"	7'-0"	1-3/4"	SCWD	STN	L	1	HM	PTD	1 / A601	2 / A601	--	--	5	--
103	VP	3'-0"	7'-0"	1-3/4"	SCWD	STN	FR	1	HM	PTD	1 / A601	2 / A601	--	C-LABEL	7	--
104	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	--
105	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	--
106	VP	3'-0"	7'-0"	1-3/4"	SCWD	STN	L	1	HM	PTD	1 / A601	2 / A601	--	--	4	--
106A	FF	3'-0" 3'-0"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	1 / A602	2 / A602	3 / A602	--	8	1, 2, 3, 4
108	F	3'-0"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	1 / A602	2 / A602	3 / A602	--	1	1, 2, 3, 4
109A	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	--
109B	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	--
109C	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	--
110	F	3'-6"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	6	3, 6
111	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	7	--
112	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	2	5
113	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	2	5
114	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	7	--
115	VP	3'-0"	7'-0"	1-3/4"	SCWD	STN	FR	1	HM	PTD	1 / A601	2 / A601	--	C-LABEL	7	--
115A	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	IL	2	HM	PTD	1 / A602	2 / A602	3 / A602	--	1	1, 2, 3, 4
116	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	2	5
117	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	6	5
118	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	2	--
119	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	2	--
120	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	2	--
121	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	5	--
122	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	7	--
123	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	7	--
124	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	1/2 HOUR	7	--
125A	HG	3'-0"	7'-0"	1-3/4"	HM	PTD	IL	2	HM	PTD	1 / A602	2 / A602	3 / A602	--	1	1, 2, 3, 4
125B	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
125C	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
125D	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
125E	HG	3'-0"	7'-0"	1-3/4"	HM	PTD	IL	2	HM	PTD	10 / A602	11 / A602	3 / A602 SIM	--	1	1, 2, 3, 4
125F	VPVP	3'-0" 3'-0"	7'-0"	1-3/4"	HM	PTD	FR	2	HM	PTD	8 / A602	9 / A602	--	C-LABEL	10	3, 4
125G	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	FR	2	HM	PTD	8A / A602	9A / A602	--	C-LABEL	1	3, 4
125H	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	FR	2	HM	PTD	8A / A602	9A / A602	--	C-LABEL	1	3, 4
125I	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	FR	2	HM	PTD	8 / A602	9 / A602	--	C-LABEL	1	3, 4
125J	HG	3'-0"	7'-0"	1-3/4"	HM	PTD	IL	2	HM	PTD	10 / A602	11 / A602	3 / A602 SIM	--	1	1, 2, 3, 4
125K	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
125L	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
125M	OHCD	14'-0"	14'-0"	--	STL	PTD	--	--	STL	PTD	4 / A602	5 / A602	--	--	9	1, 2, 3, 4
126	F	3'-0"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	6 / A602	7 / A602	--	--	4	3, 4
127	VP	3'-0"	7'-0"	1-3/4"	HM	PTD	L	2	HM	PTD	6 / A602	7 / A602	--	--	4	3, 4
128	F	3'-0"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	6 / A602	7 / A602	--	--	2	3, 4
128A	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	2	--
128B	F	3'-0"	7'-0"	1-3/4"	SCWD	STN	--	1	HM	PTD	1 / A601	2 / A601	--	--	2	--
129	F	3'-6"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	8 / A602	9 / A602	--	--	11	3, 4
130	F	3'-6"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	8 / A602	9 / A602	--	--	5	3, 4
131	F	3'-6"	7'-0"	1-3/4"	HM	PTD	--	2	HM	PTD	8 / A602	9 / A602	--	--	11	3, 4

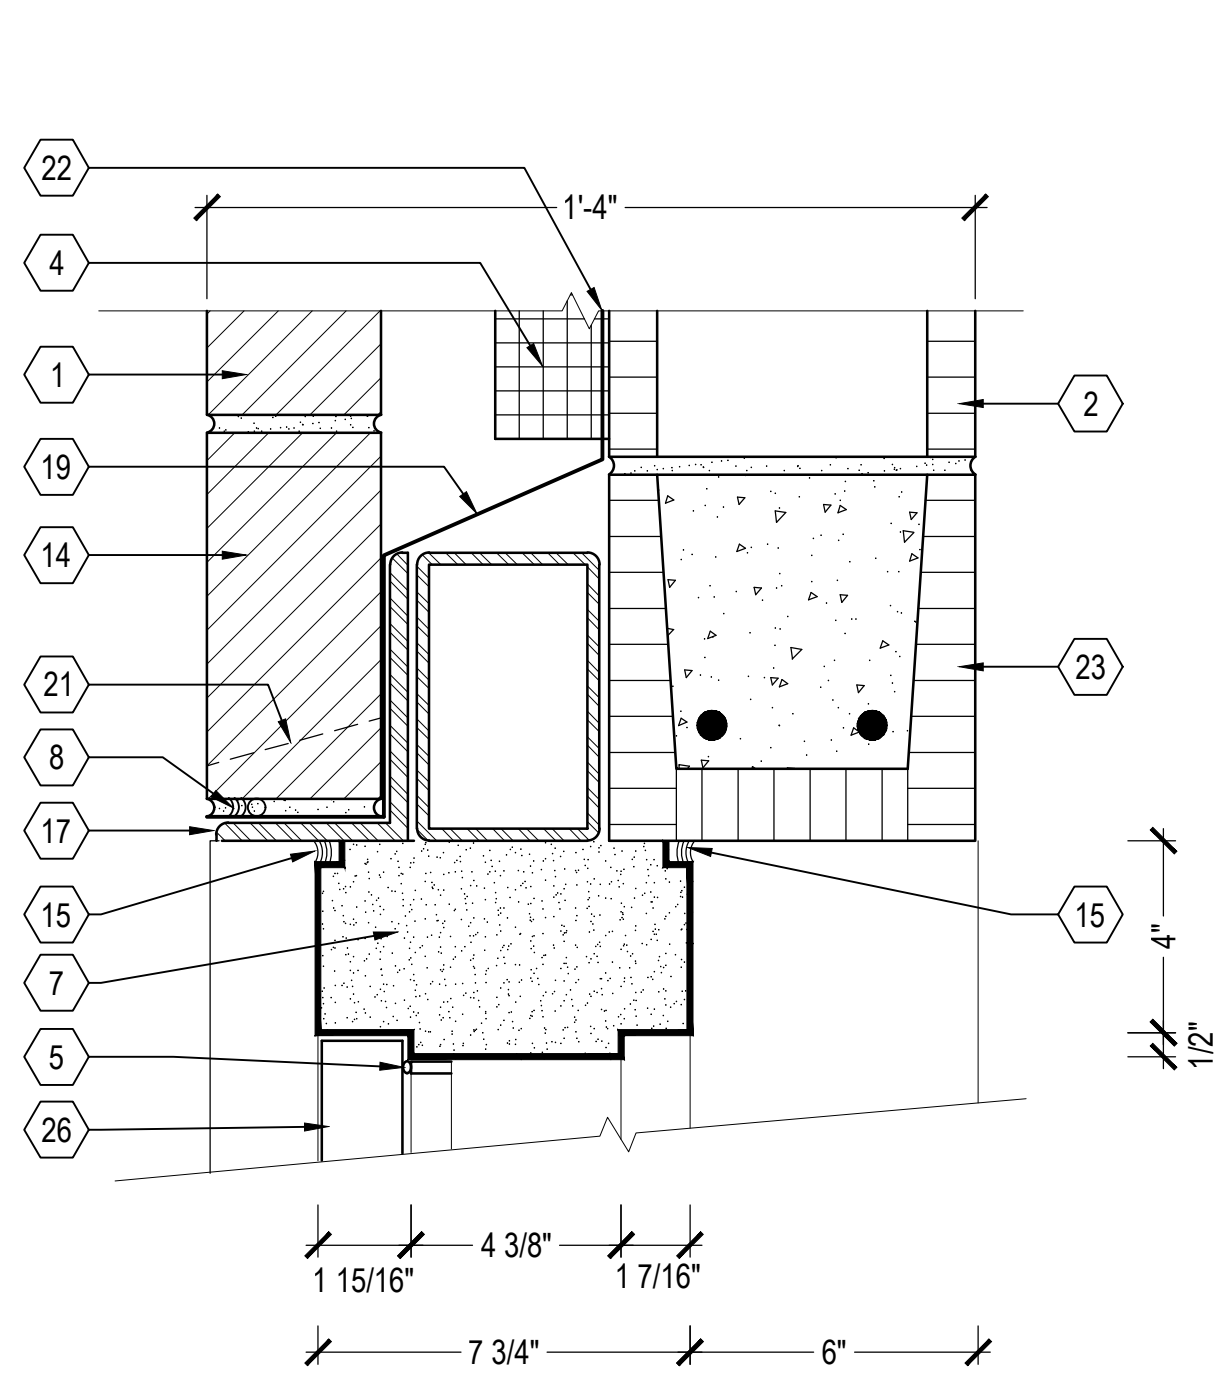


1 HEAD DETAIL
SCALE: 3"=1'-0"

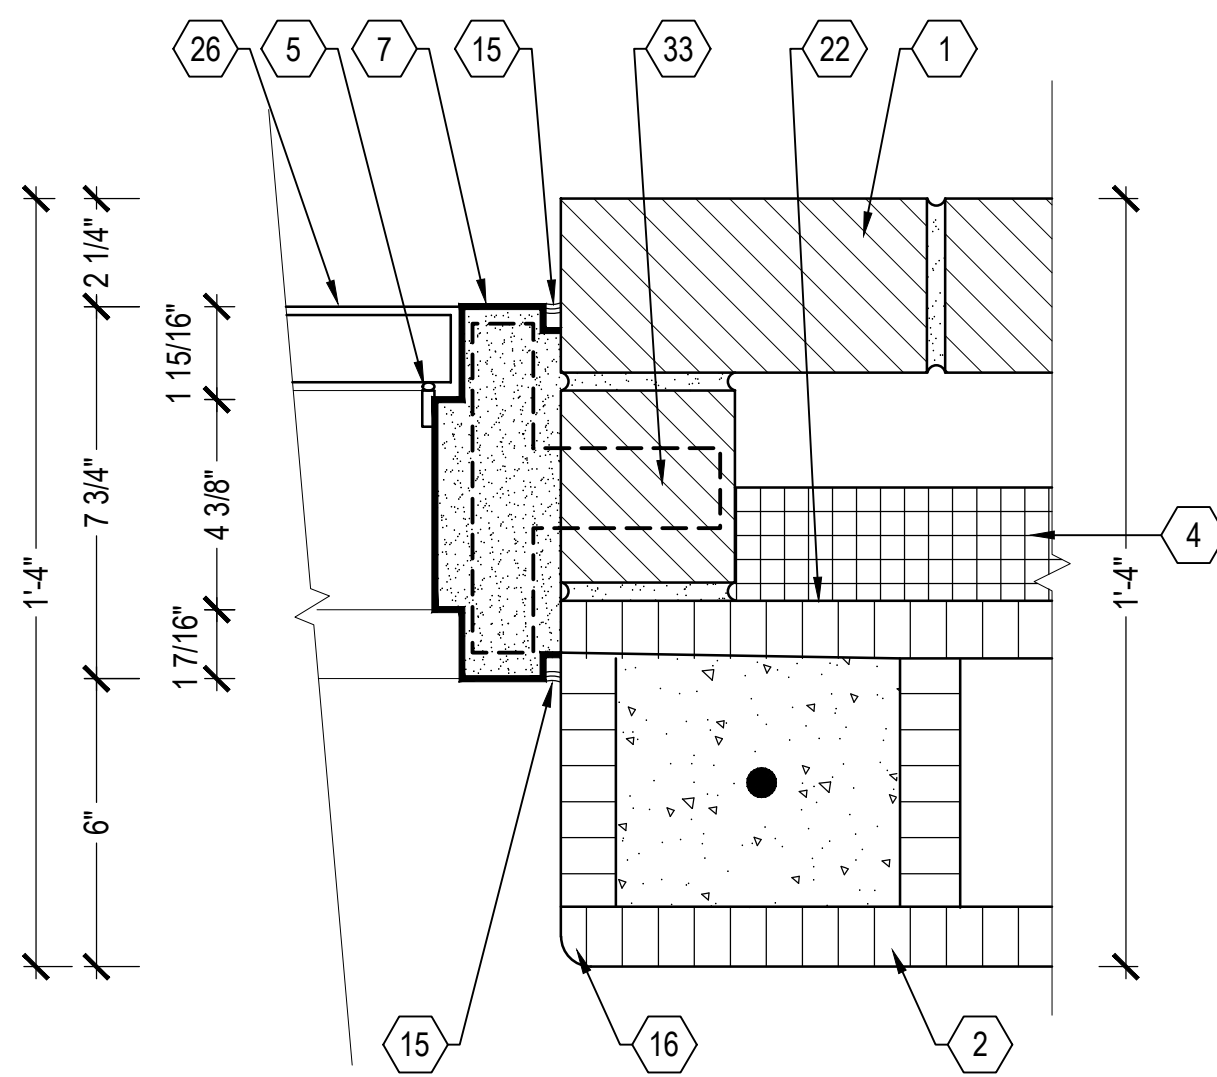


2 JAMB DETAIL
SCALE: 3"=1'-0"

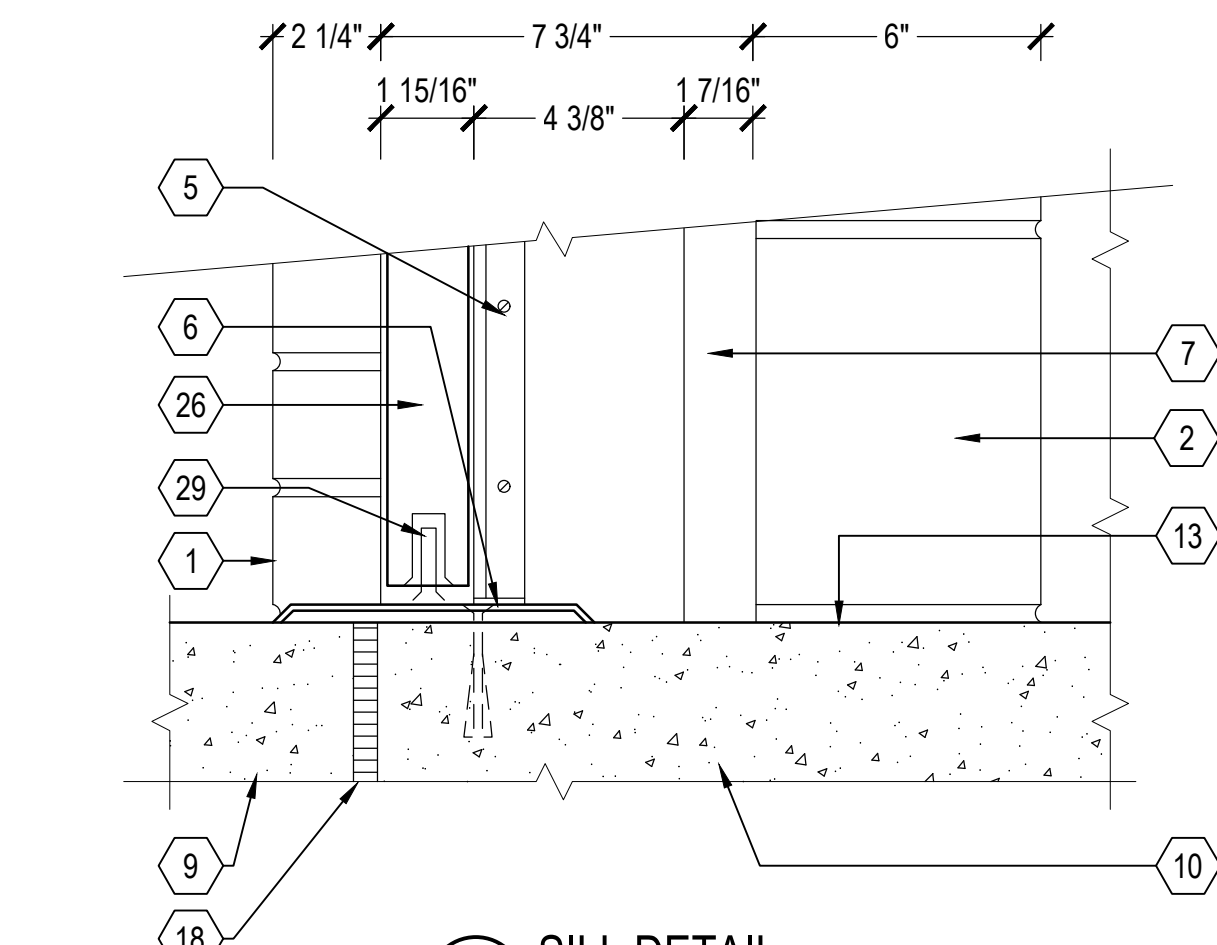


3 SILL DETAIL
SCALE: 3"=1'-0"

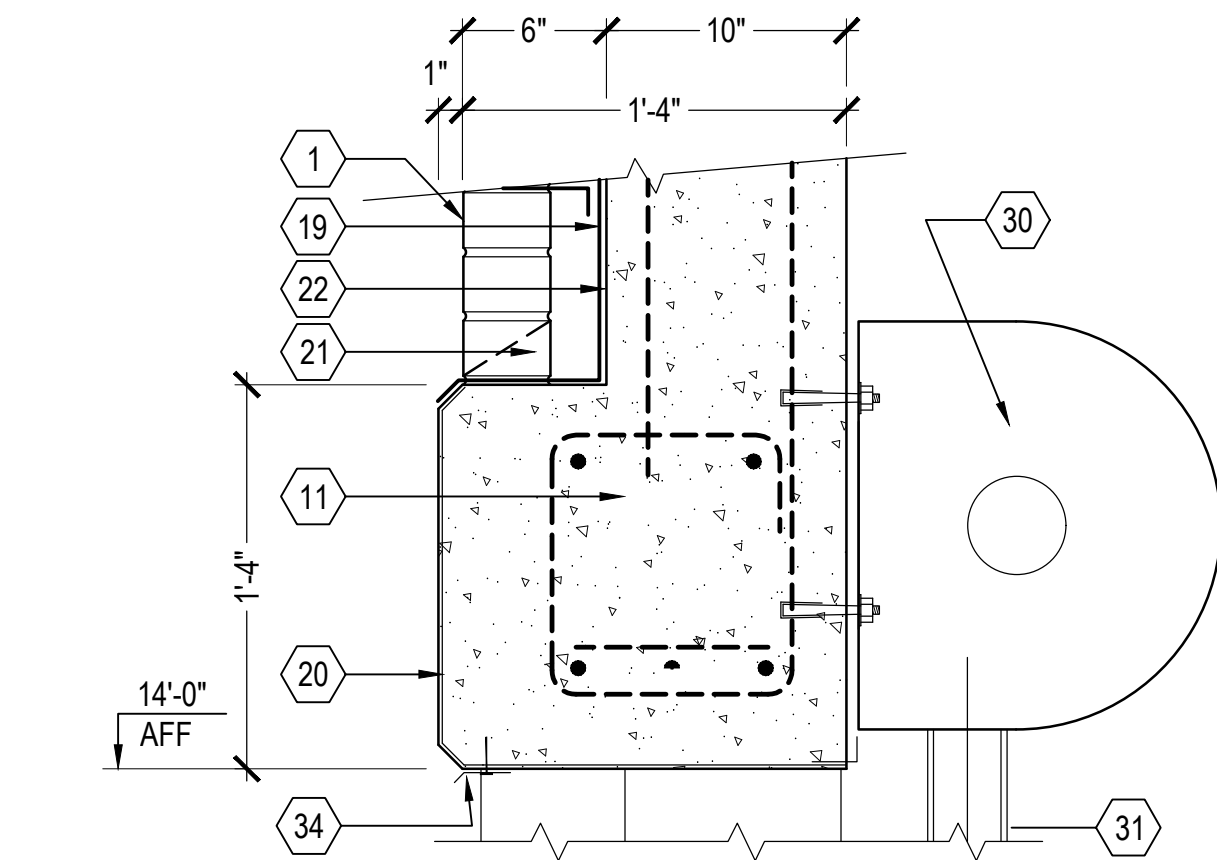


4 HEAD DETAIL
SCALE: 1-1/2"=1'-0"

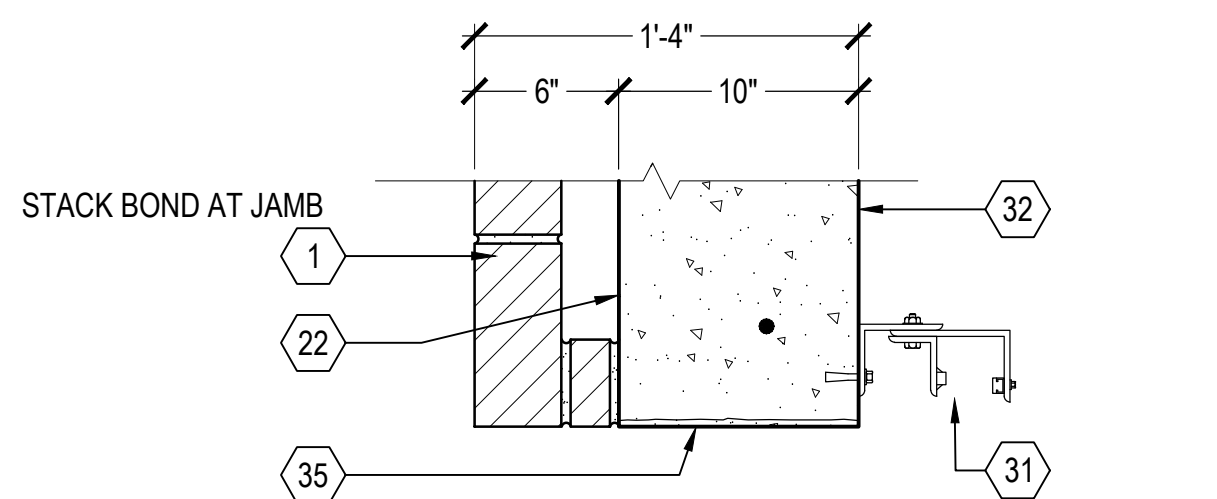


5 JAMB DETAIL
SCALE: 1-1/2"=1'-0"

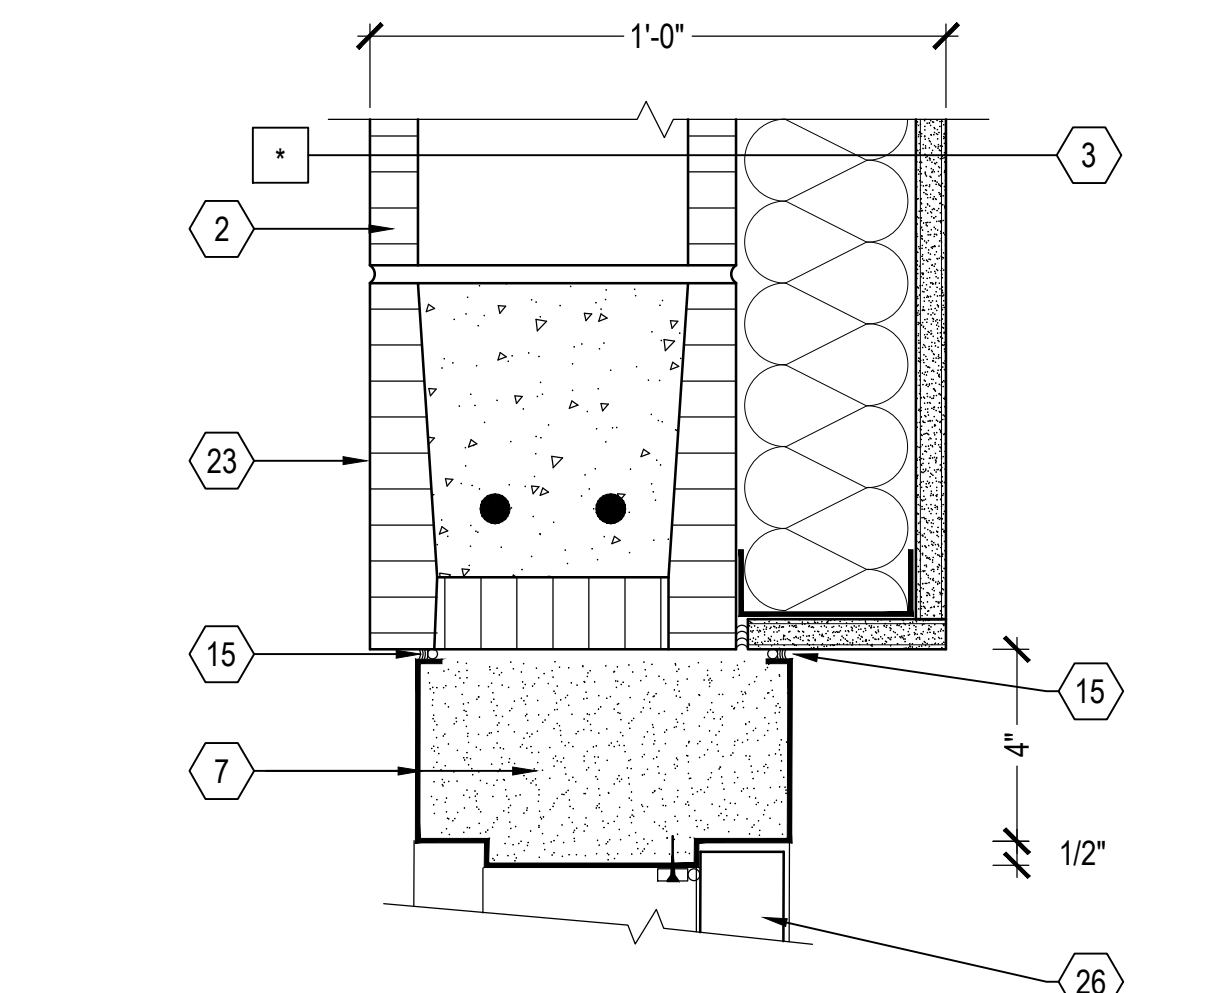

6 HEAD DETAIL
SCALE: 1-1/2"=1'-0"

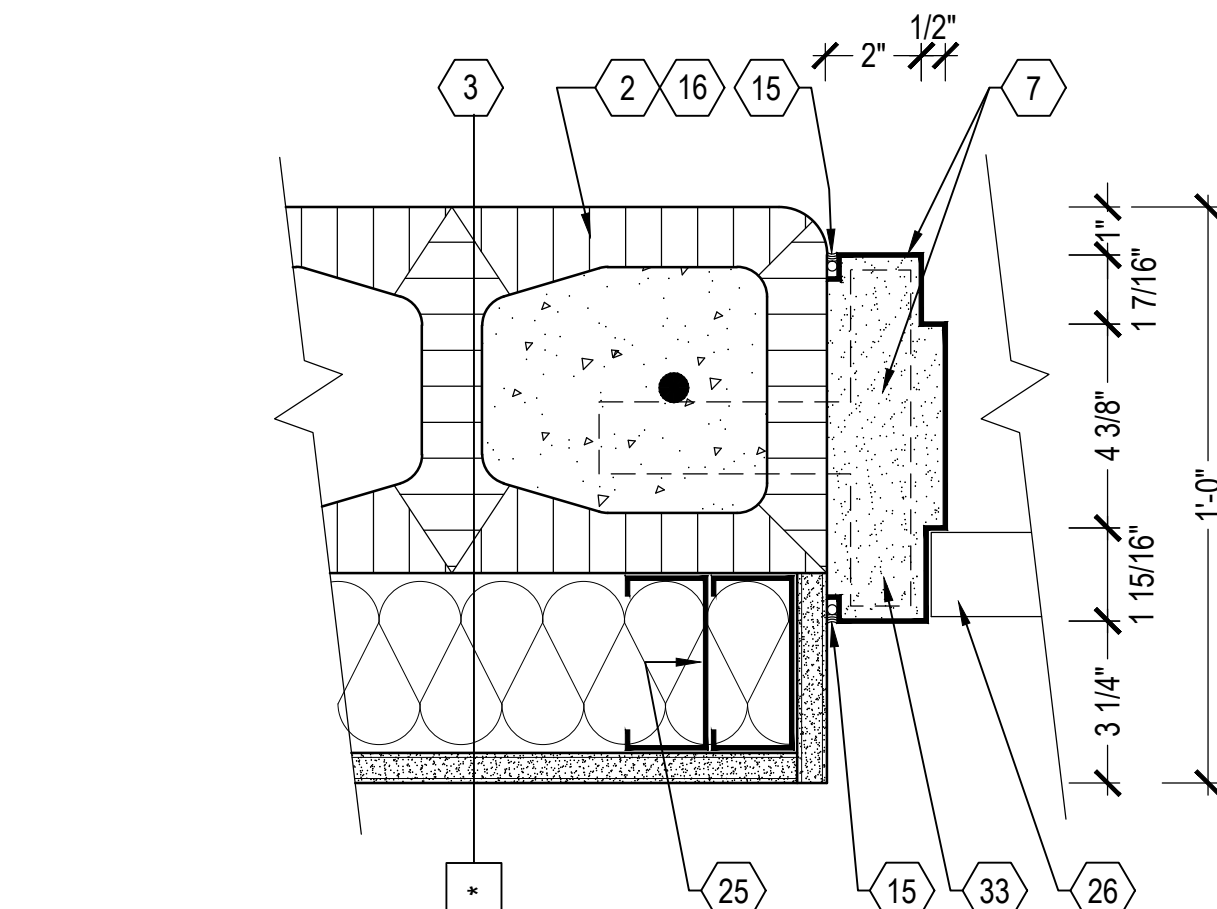


7 JAMB DETAIL
SCALE: 1-1/2"=1'-0"

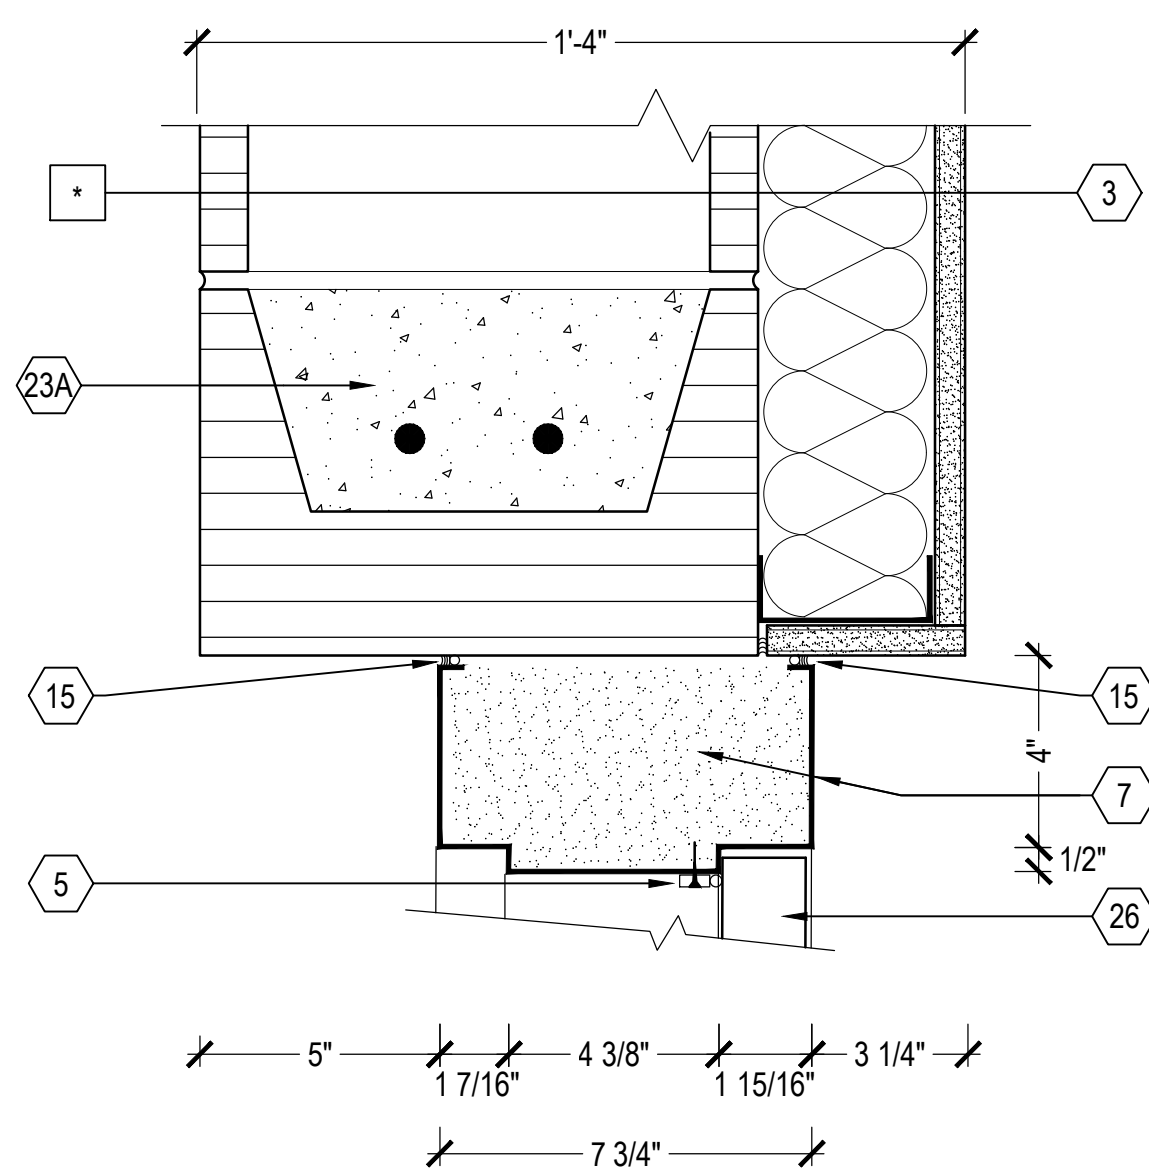


8 HEAD DETAIL
SCALE: 1-1/2"=1'-0"

NOTE: MIRROR DOOR FRAME AT 8A

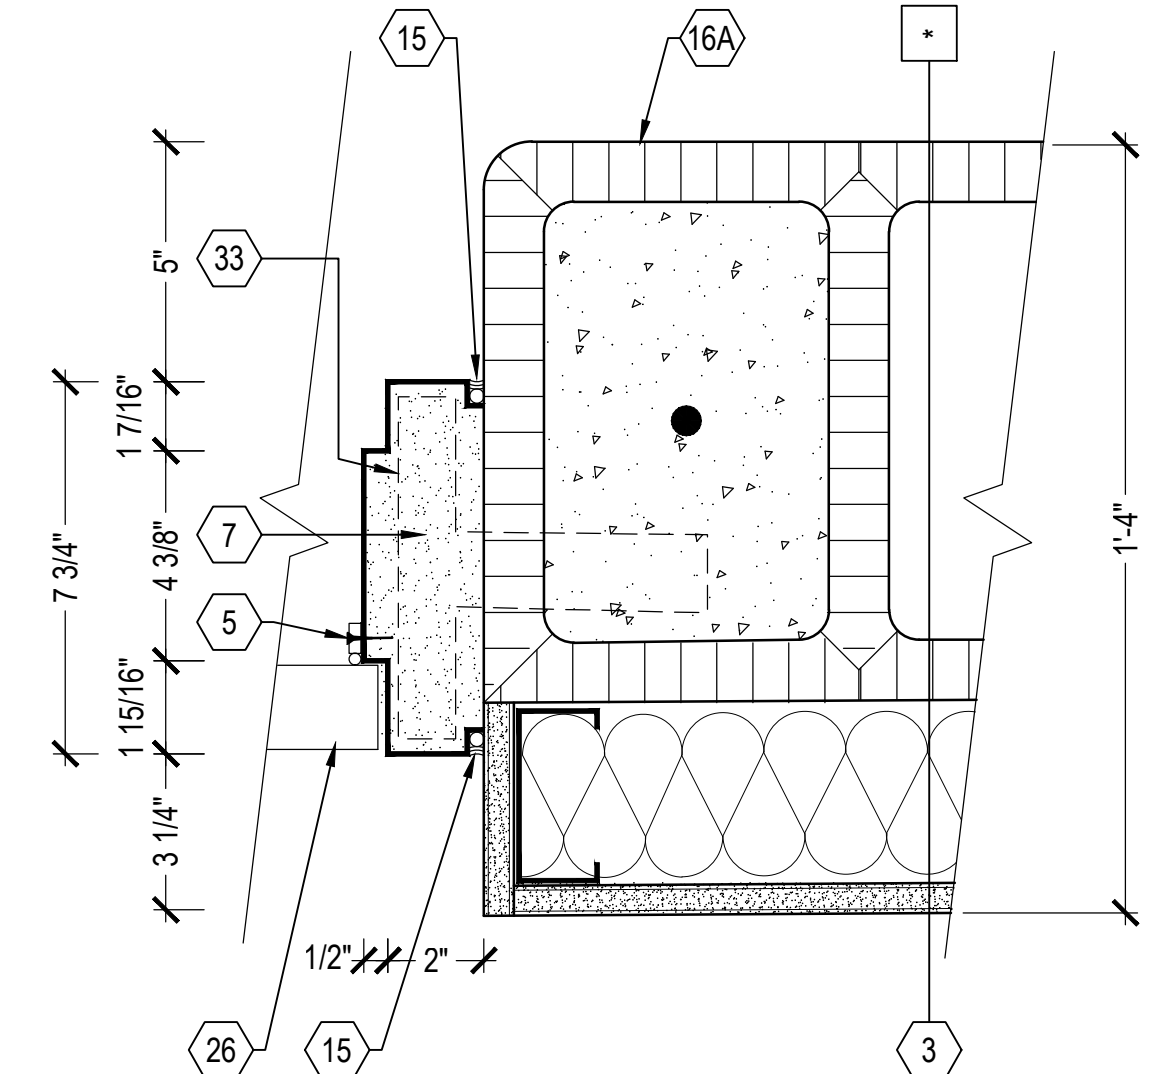


9 JAM DETAIL
SCALE: 1-1/2"=1'-0"

NOTE: MIRROR DOOR FRAME AT 9A

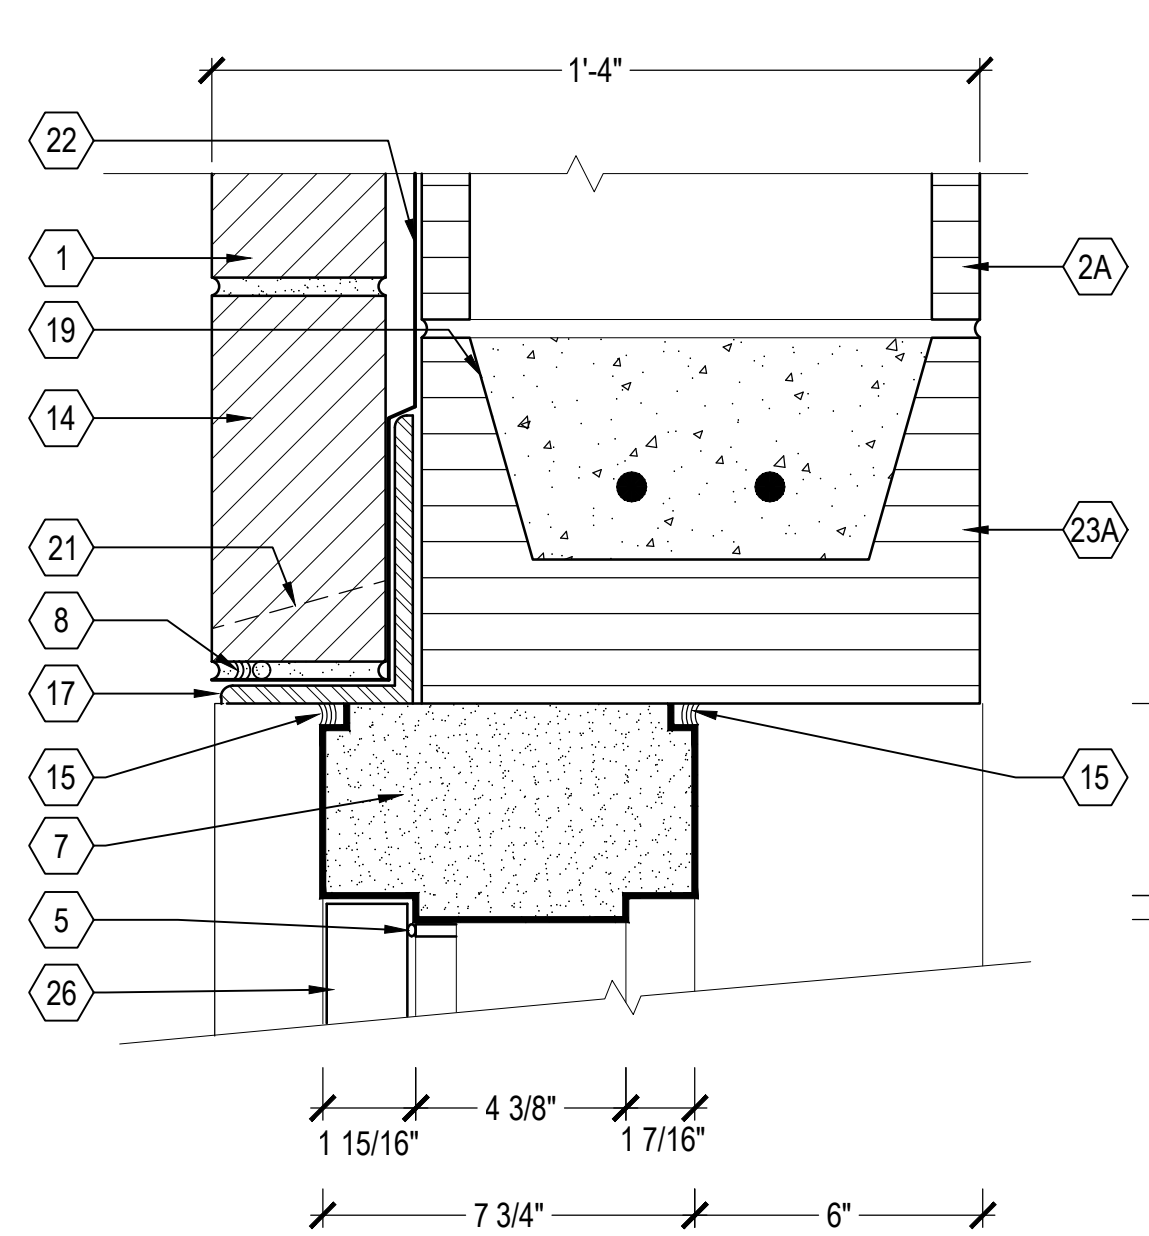

10 HEAD DETAIL
SCALE: 3"=1'-0"

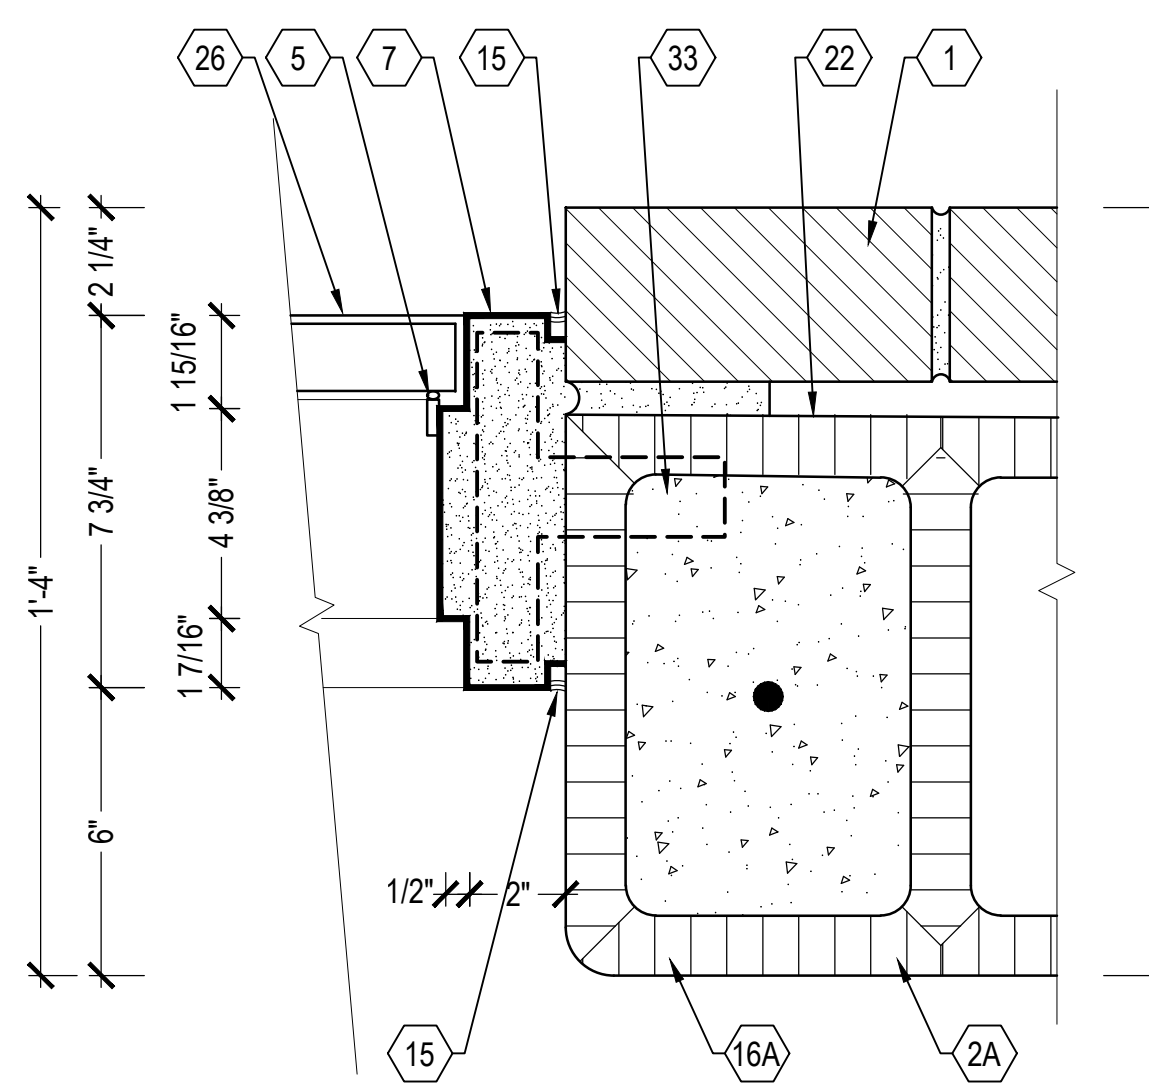

11 JAMB DETAIL
SCALE: 3"=1'-0"

KEYNOTES

- 1 4" FACE BRICK
- 2 8" CMU WITH HORIZ. JT. WIRE REINF. AT 16" O.C., SEE STRUCTURAL FOR VERTICAL REINFORCEMENT, PAINT.
- 2A 12" CMU AT 2A, PAINT.
- 3 SEE WALL TYPES FOR ADDITIONAL INFORMATION.
- 4 2" EXTRUDED POLYSTYRENE BOARD INSULATION, ADHERE TO CMU.
- 5 SURFACE-APPLIED WEATHER STRIPPING, CONTINUOUS
- 6 7" FLAT ALUMINUM THRESHOLD
- 7 GALVANIZED HOLLOW METAL FRAME, GROUT SOLID, PAINT
- 8 SEALANT & BACKER ROD - CONT.
- 9 CONCRETE SIDEWALK, SEE CIVIL
- 10 CONCRETE FLOOR SLAB
- 11 C.I.P. CONCRETE BEAM, SEE STRUCTURAL
- 12 SHIM
- 13 SEE FINISH SCHEDULE FOR FLOOR FINISH
- 14 FACE BRICK: SOLDIER COURSE
- 15 SEALANT, CONTINUOUS
- 16 8" CMU W/ BULLNOSE CORNER (NO FIELD GRINDING ALLOWED) - SEE STRUCTURAL FOR REINFORCING
- 16A 12" CMU W/ BULLNOSE CORNER (NO FIELD GRINDING ALLOWED) - SEE STRUCTURAL FOR REINFORCING
- 17 STEEL ANGLE / TUBE STEEL GALVANIZED LINTEL, SEE STRUCTURAL.
- 18 1/2" ASPHALTIC BOARD EXPANSION MATERIAL
- 19 FLEXIBLE THRU-WALL FLASHING
- 20 CONCRETE BEAM, RUB SMOOTH, FILL ALL VOIDS. PROVIDE MODIFIED COLORED ACRYLIC STUCCO, ONE COAT
- 21 PVC WEEP SCREED HOLE AT 4'-0"
- 22 FLUID APPLIED VAPOR BARRIER
- 23 8" CMU BOND BEAM LINTEL, SEE STRUCTURAL FOR REINFORCING, MINIMUM 8" BEARING ON EACH SIDE
- 23A 12" CMU BOND BEAM AT 23A, TYPICAL
- 24 JAMB ANCHOR AT 3 PER JAMB: TYPE
- 25 DOUBLE-STUD AT JAMB
- 26 DOOR: SEE SCHEDULE, PAINT
- 27 HOLLOW-METAL FRAME: PAINT
- 28 BUILT-UP HEADER WITH 20GA TRACK
- 29 ADJUSTABLE CONCEALED AUTOMATIC DOOR BOTTOM
- 30 ROLLING DOOR HOUSING
- 31 ROLLING DOOR TRACK AND FRAME
- 32 C.I.P. CONCRETE WALL, SEE STRUCTURAL
- 33 T-SHAPE DOOR ANCHORS: MINIMUM 3, PER FLORIDA PRODUCT APPROVAL
- 34 SURFACE APPLIED DRIP
- 35 COLORED MODIFIED ACRYLIC STUCCO, ONE COAT

* SEE INTERIOR WALL SECTIONS FOR ADDITIONAL INFORMATION


DETAILS

MIDWAY FIRE DISTRICT FIRE STATION # 36 4252 GULF BREEZE PARKWAY, GULF BREEZE, FL



Revision		

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:


A602
SHEET #

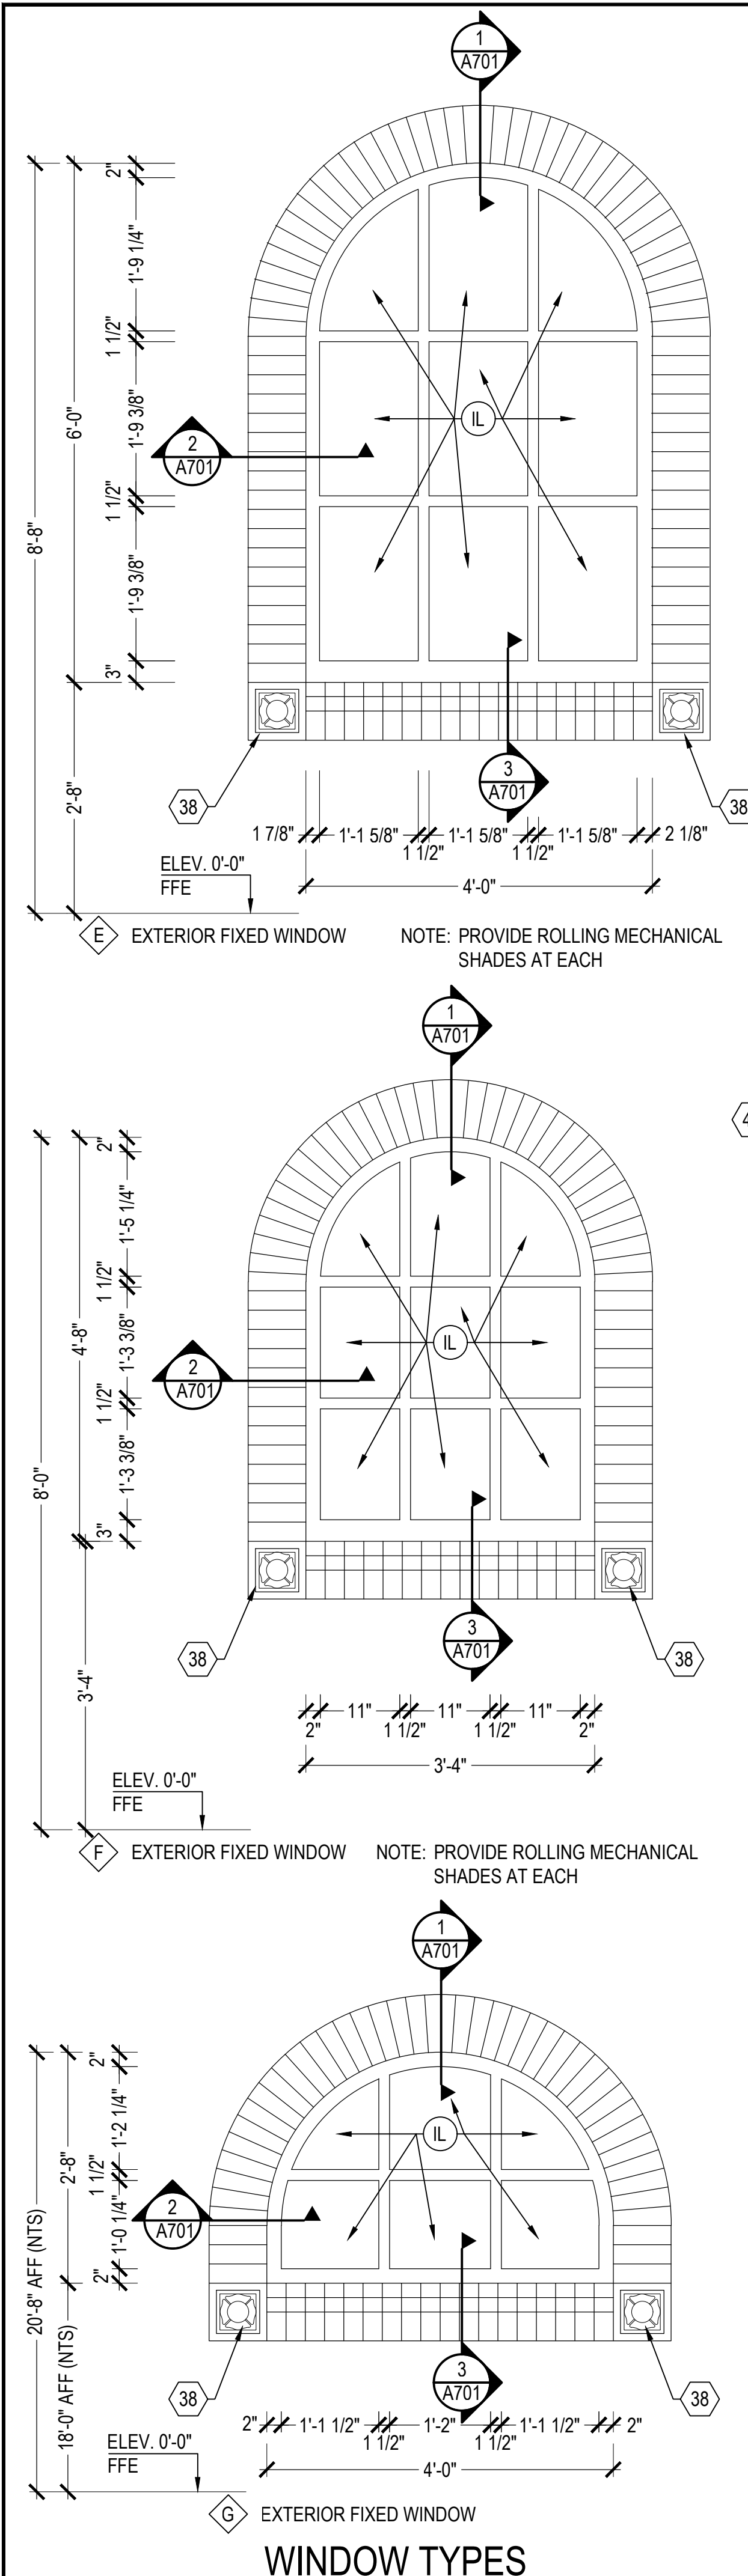

WINDOW TYPES

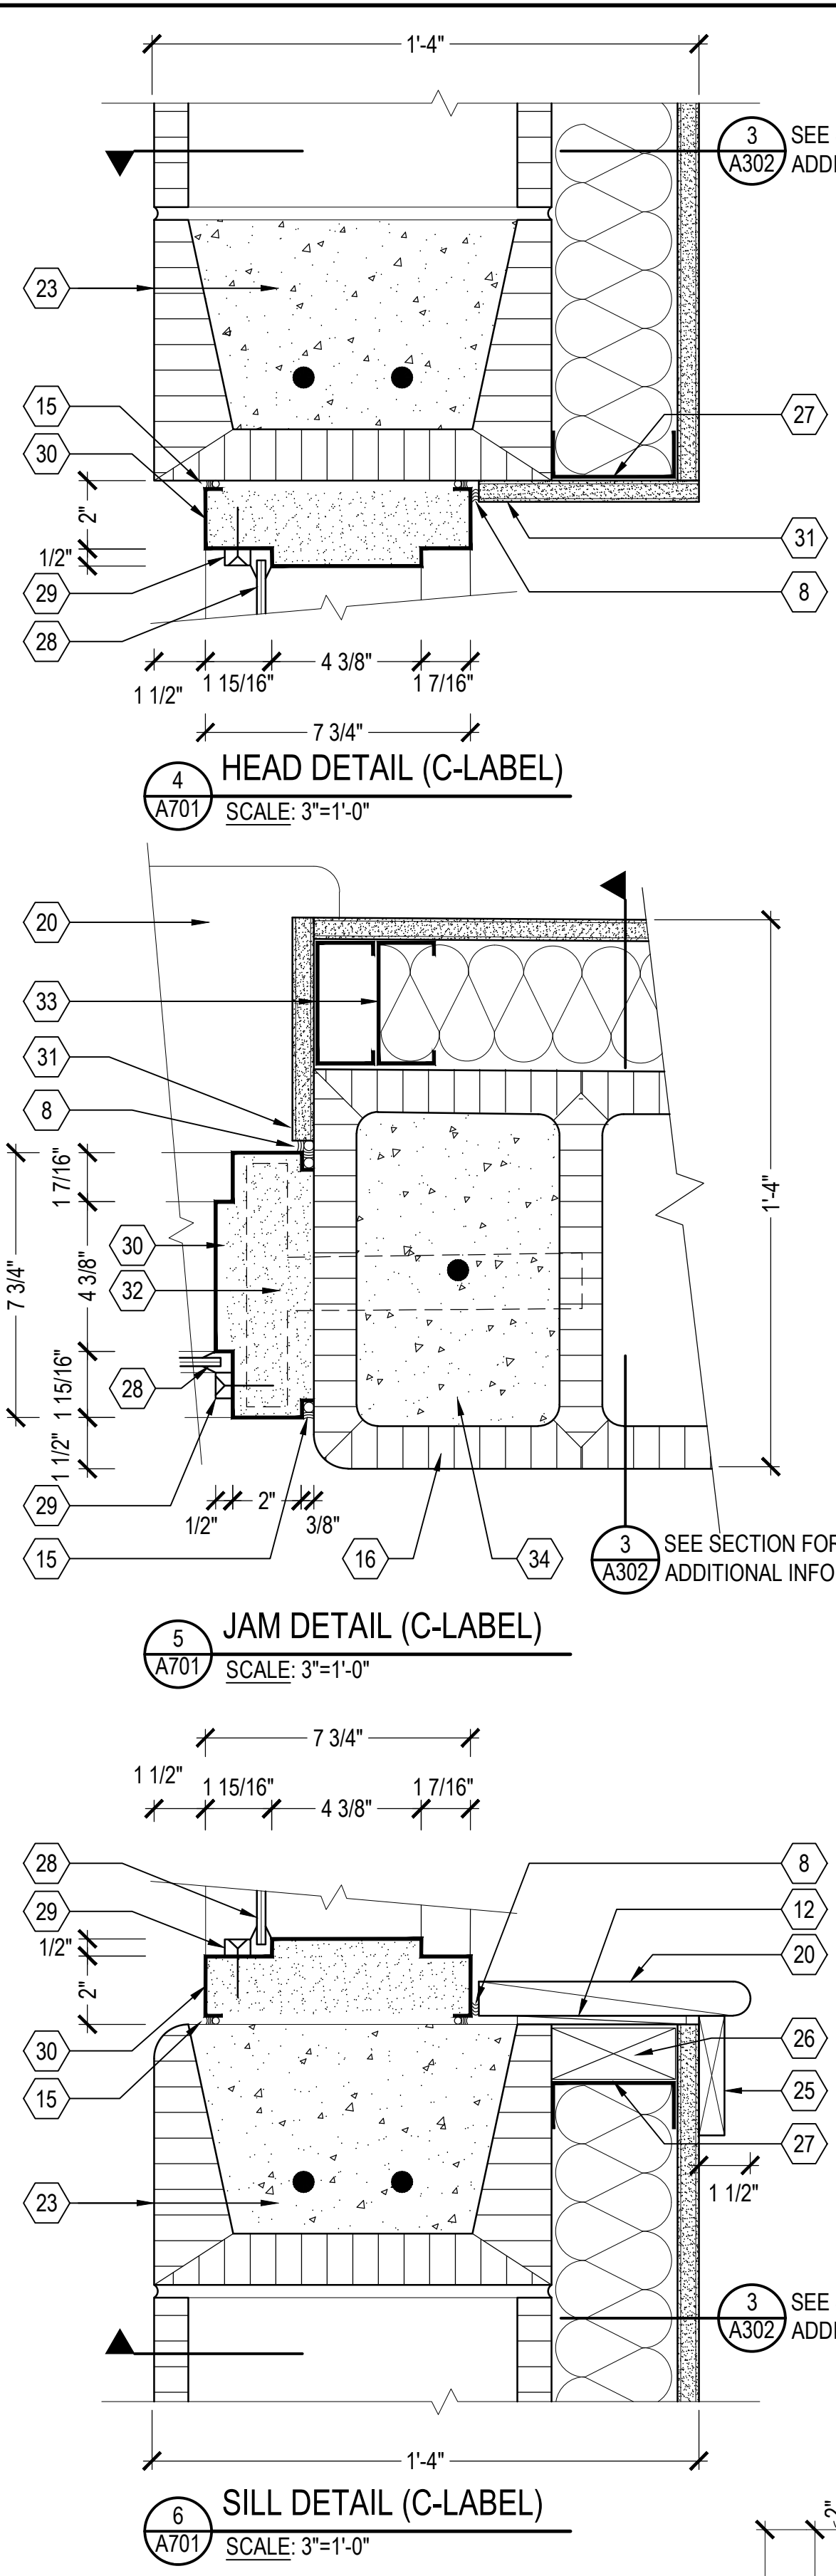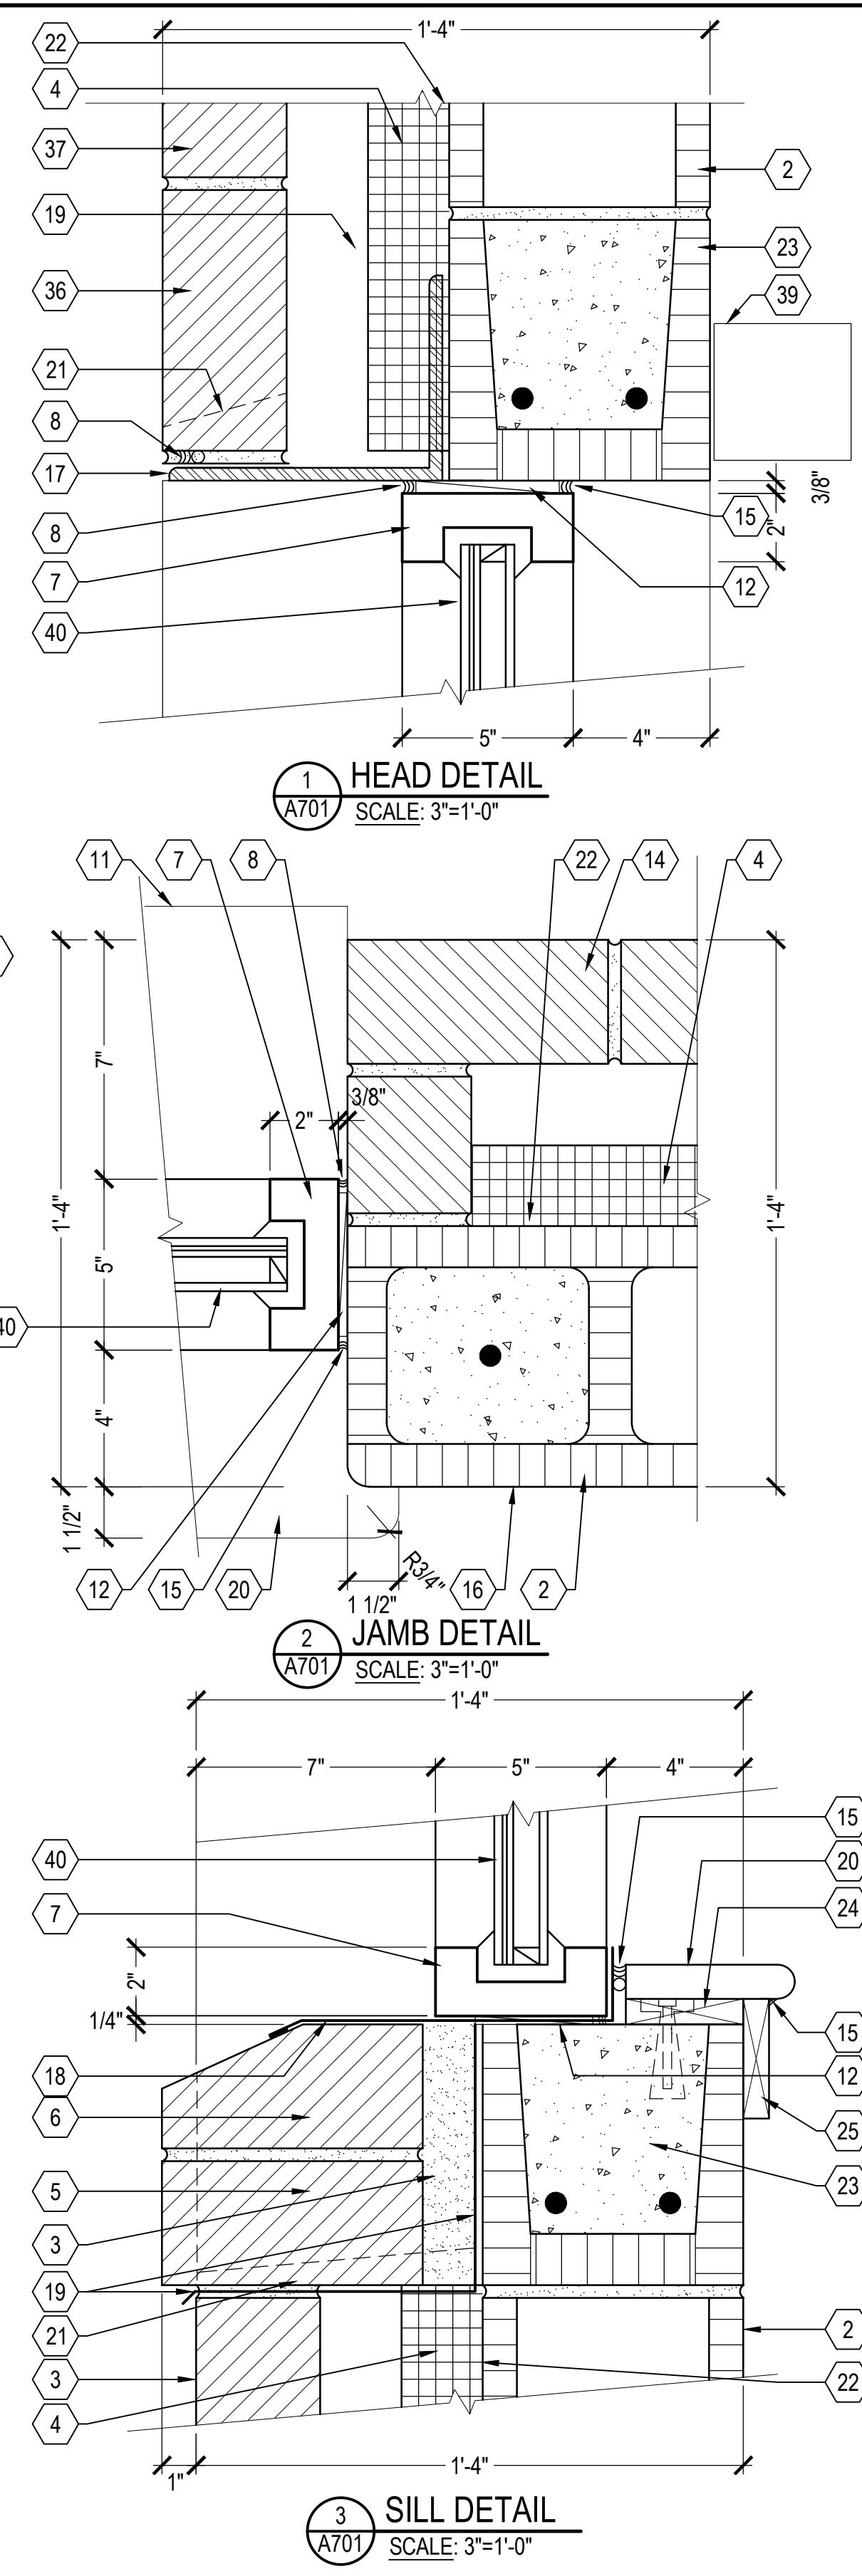

- LEGEND--GLAZING TYPES**
- (S) ~ 1/4" TEMPERED, CLEAR SAFETY GLASS
 - (F) ~ 1/4" CERAMIC, FILMED, FIRE-RATED CLEAR GLASS
 - (IL) ~ 5/16" IMPACT-RATED, INSULATED, TINTED GLAZING UNIT

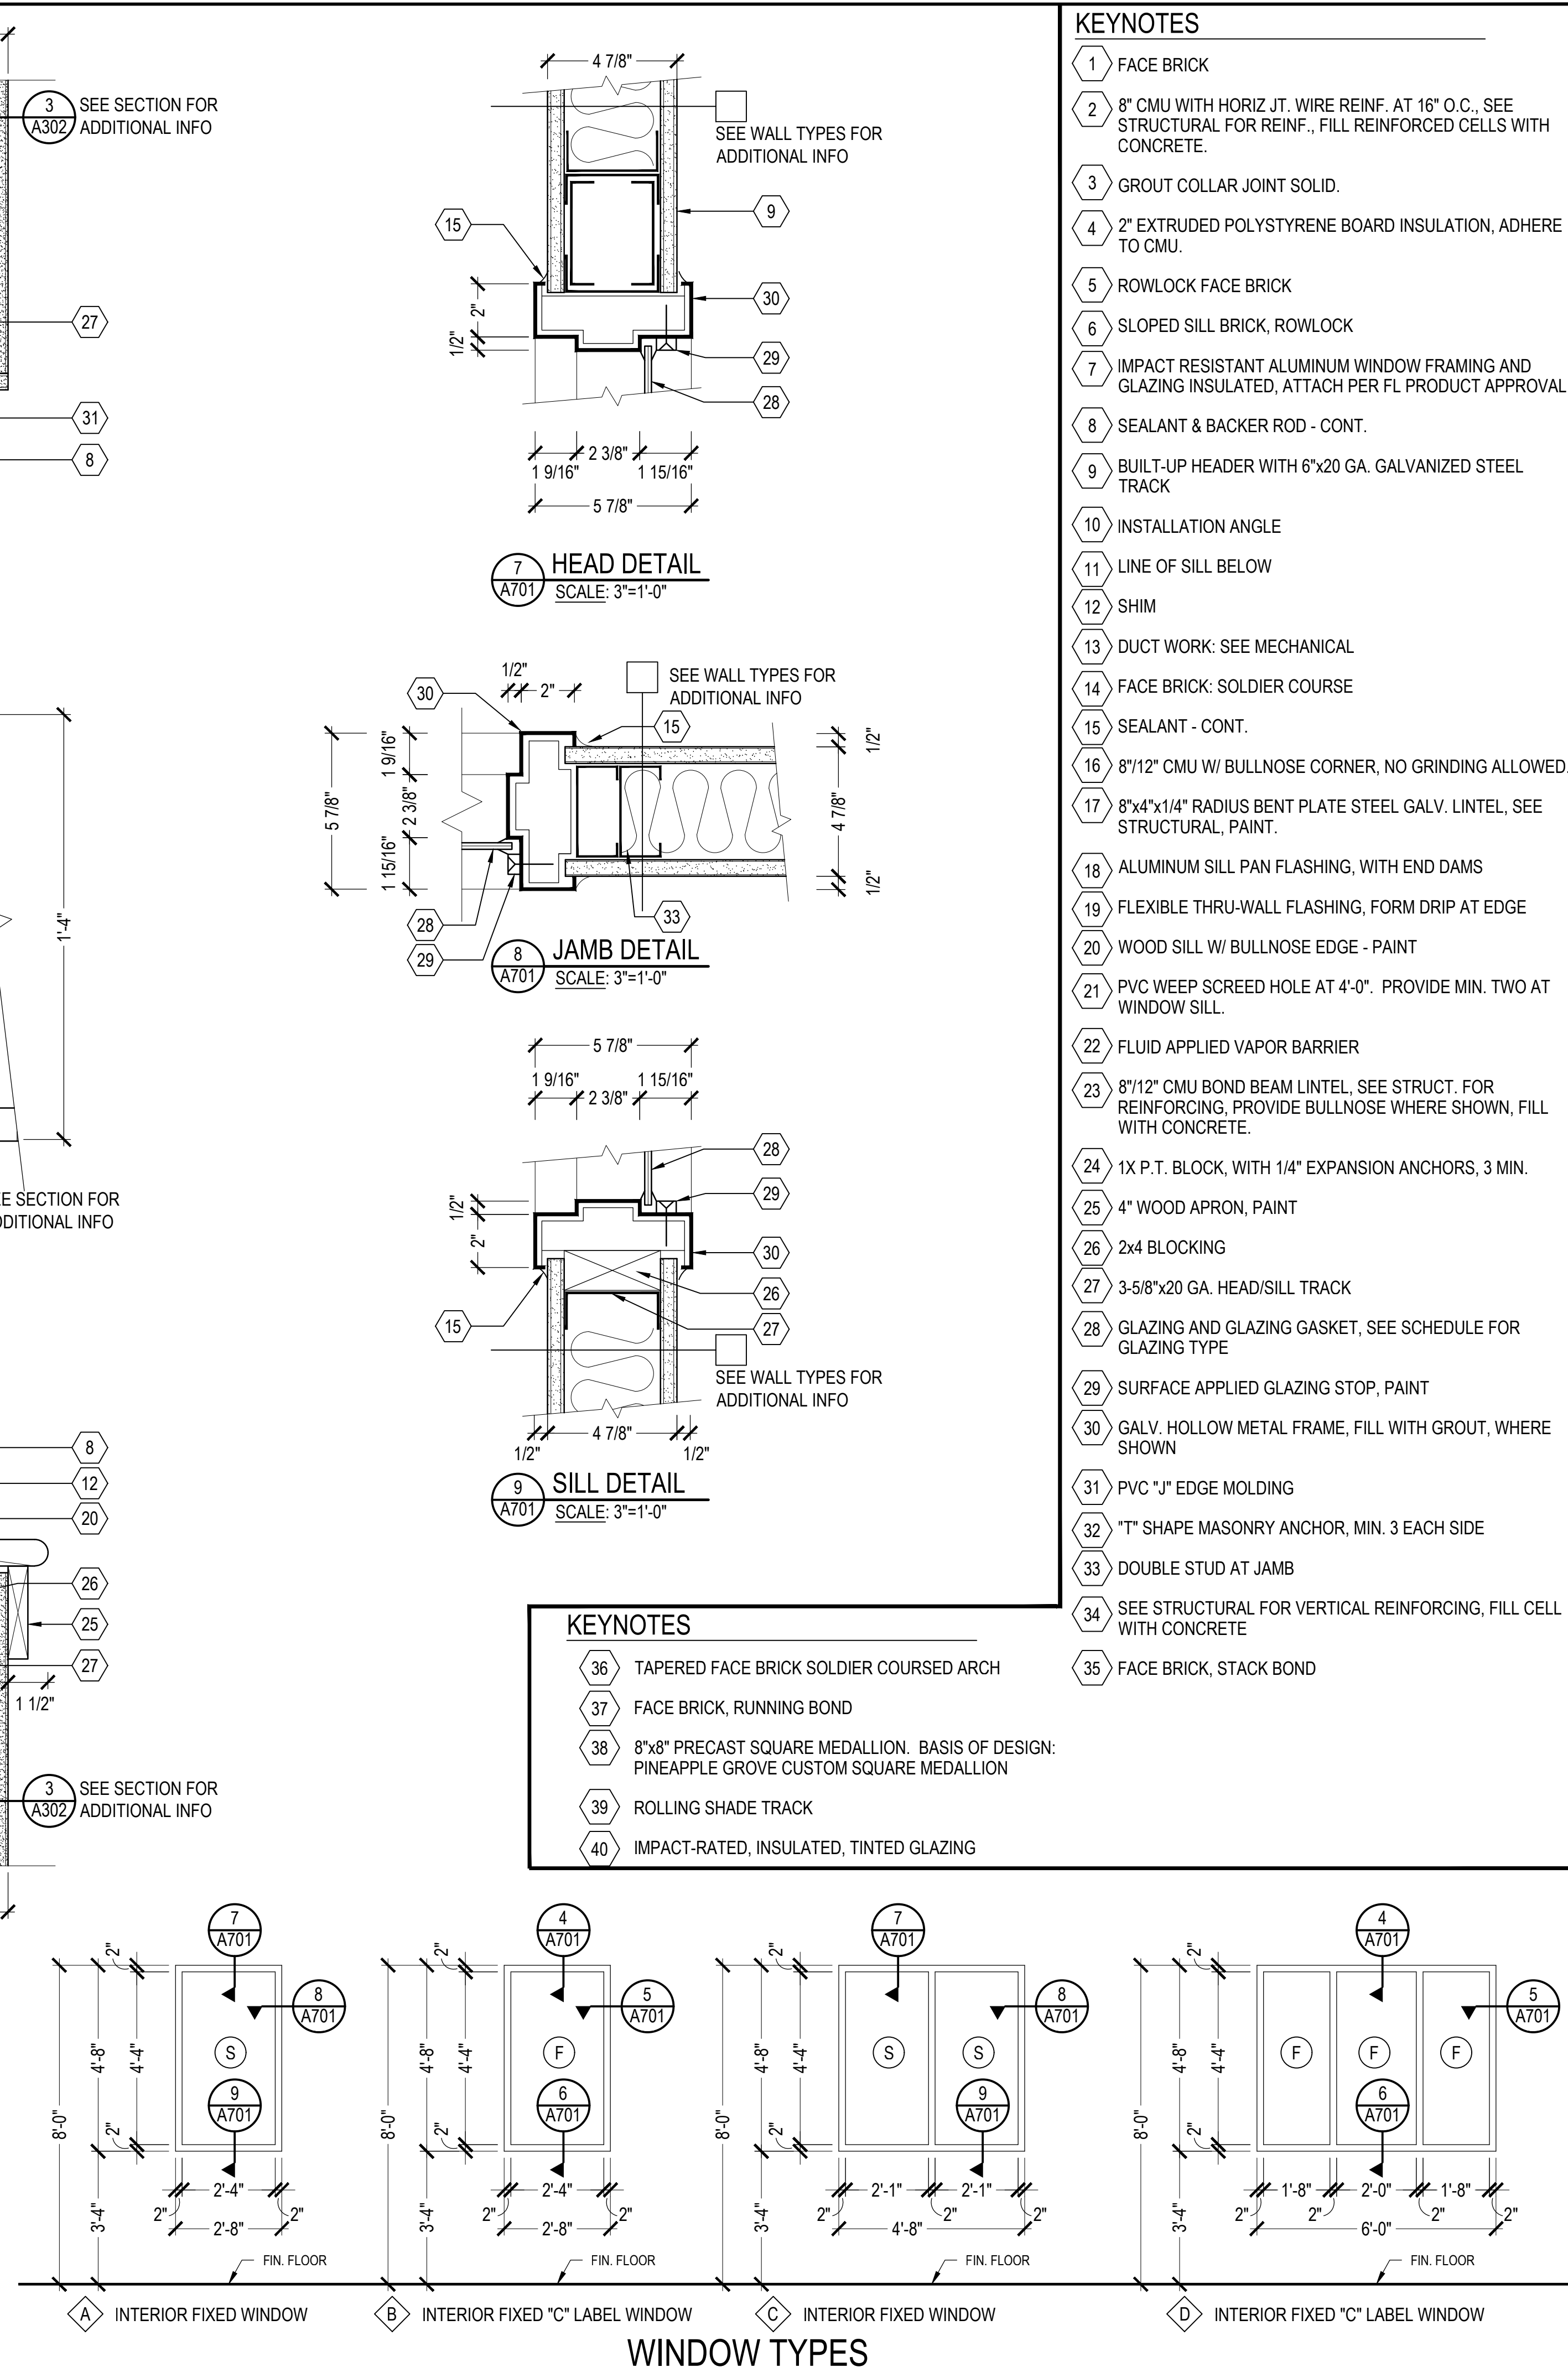

WINDOW TYPES

- KEYNOTES**
- 1 FACE BRICK
 - 2 8" CMU WITH HORIZ. JT. WIRE REINF. AT 16" O.C., SEE STRUCTURAL FOR REINF., FILL REINFORCED CELLS WITH CONCRETE.
 - 3 GROUT COLLAR JOINT SOLID.
 - 4 2" EXTRUDED POLYSTYRENE BOARD INSULATION, ADHERE TO CMU.
 - 5 ROWLOCK FACE BRICK
 - 6 SLOPED SILL BRICK, ROWLOCK
 - 7 IMPACT RESISTANT ALUMINUM WINDOW FRAMING AND GLAZING INSULATED, ATTACH PER FL PRODUCT APPROVAL
 - 8 SEALANT & BACKER ROD - CONT.
 - 9 BUILT-UP HEADER WITH 6"x20 GA. GALVANIZED STEEL TRACK
 - 10 INSTALLATION ANGLE
 - 11 LINE OF SILL BELOW
 - 12 SHIM
 - 13 DUCT WORK: SEE MECHANICAL
 - 14 FACE BRICK: SOLDIER COURSE
 - 15 SEALANT - CONT.
 - 16 8"x12" CMU W/ BULLNOSE CORNER, NO GRINDING ALLOWED.
 - 17 8"x4"x1/4" RADIUS BENT PLATE STEEL GALV. LINTEL, SEE STRUCTURAL, PAINT.
 - 18 ALUMINUM SILL PAN FLASHING, WITH END DAMS
 - 19 FLEXIBLE THRU-WALL FLASHING, FORM DRIP AT EDGE
 - 20 WOOD SILL W/ BULLNOSE EDGE - PAINT
 - 21 PVC WEEP SCREED HOLE AT 4'-0". PROVIDE MIN. TWO AT WINDOW SILL.
 - 22 FLUID APPLIED VAPOR BARRIER
 - 23 8"x12" CMU BOND BEAM LINTEL, SEE STRUCT. FOR REINFORCING, PROVIDE BULLNOSE WHERE SHOWN, FILL WITH CONCRETE.
 - 24 1X P.T. BLOCK, WITH 1/4" EXPANSION ANCHORS, 3 MIN.
 - 25 4" WOOD APRON, PAINT
 - 26 2x4 BLOCKING
 - 27 3-5/8"x20 GA. HEAD/SILL TRACK
 - 28 GLAZING AND GLAZING GASKET, SEE SCHEDULE FOR GLAZING TYPE
 - 29 SURFACE APPLIED GLAZING STOP, PAINT
 - 30 GALV. HOLLOW METAL FRAME, FILL WITH GROUT, WHERE SHOWN
 - 31 PVC "J" EDGE MOLDING
 - 32 "T" SHAPE MASONRY ANCHOR, MIN. 3 EACH SIDE
 - 33 DOUBLE STUD AT JAMB
 - 34 SEE STRUCTURAL FOR VERTICAL REINFORCING, FILL CELL WITH CONCRETE
 - 35 FACE BRICK, STACK BOND

- KEYNOTES**
- 36 TAPERED FACE BRICK SOLDIER COURSED ARCH
 - 37 FACE BRICK, RUNNING BOND
 - 38 8"x8" PRECAST SQUARE MEDALLION. BASIS OF DESIGN: PINEAPPLE GROVE CUSTOM SQUARE MEDALLION
 - 39 ROLLING SHADE TRACK
 - 40 IMPACT-RATED, INSULATED, TINTED GLAZING


WINDOW ELEVATIONS
& DETAILS

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL


Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:


A701
SHEET #

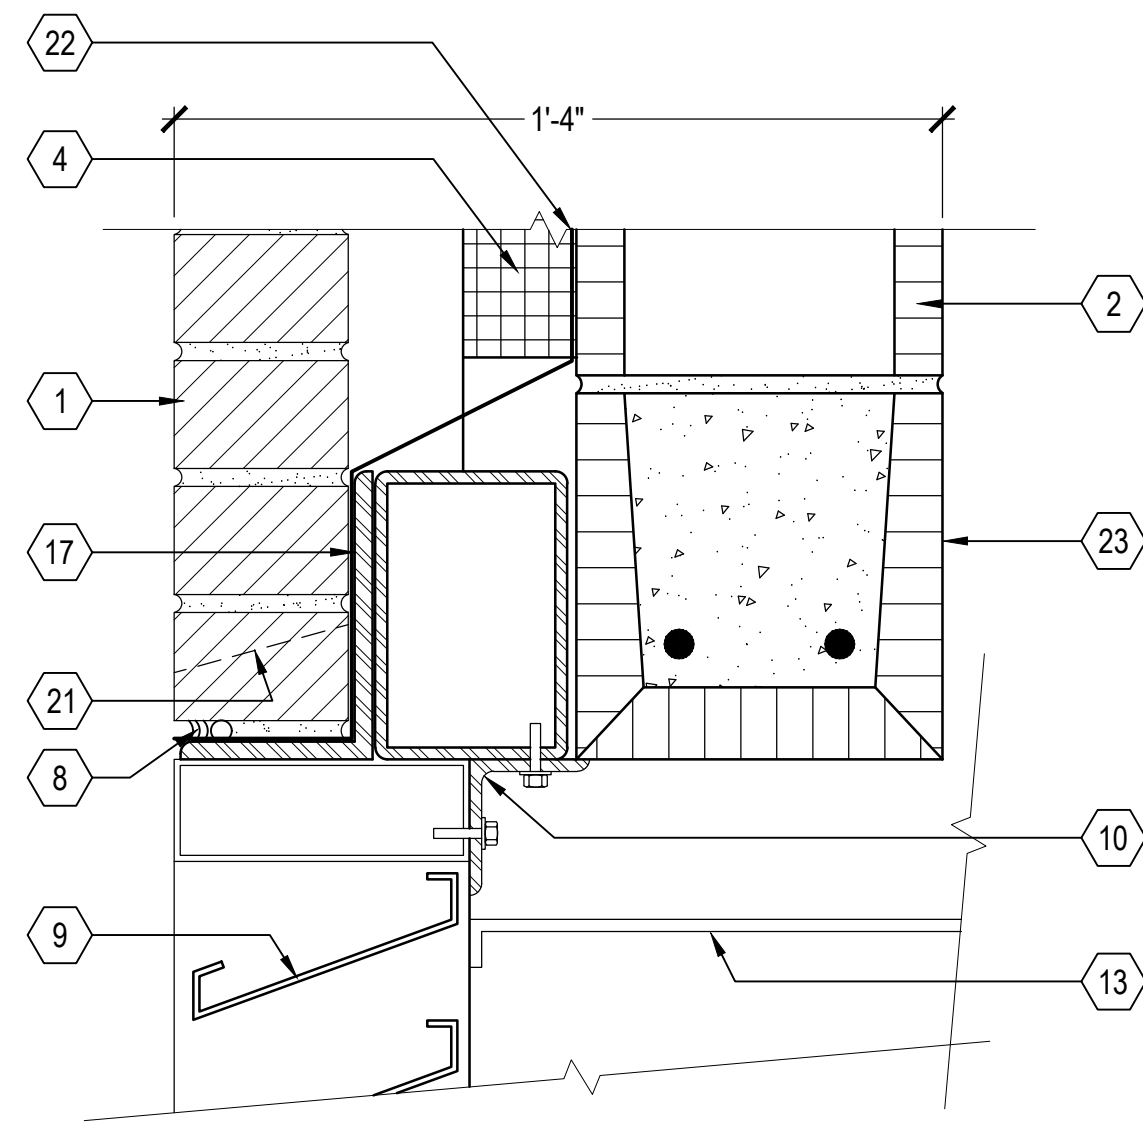


1 LOUVER HEAD DETAIL
A711 SCALE: 3"=1'-0"

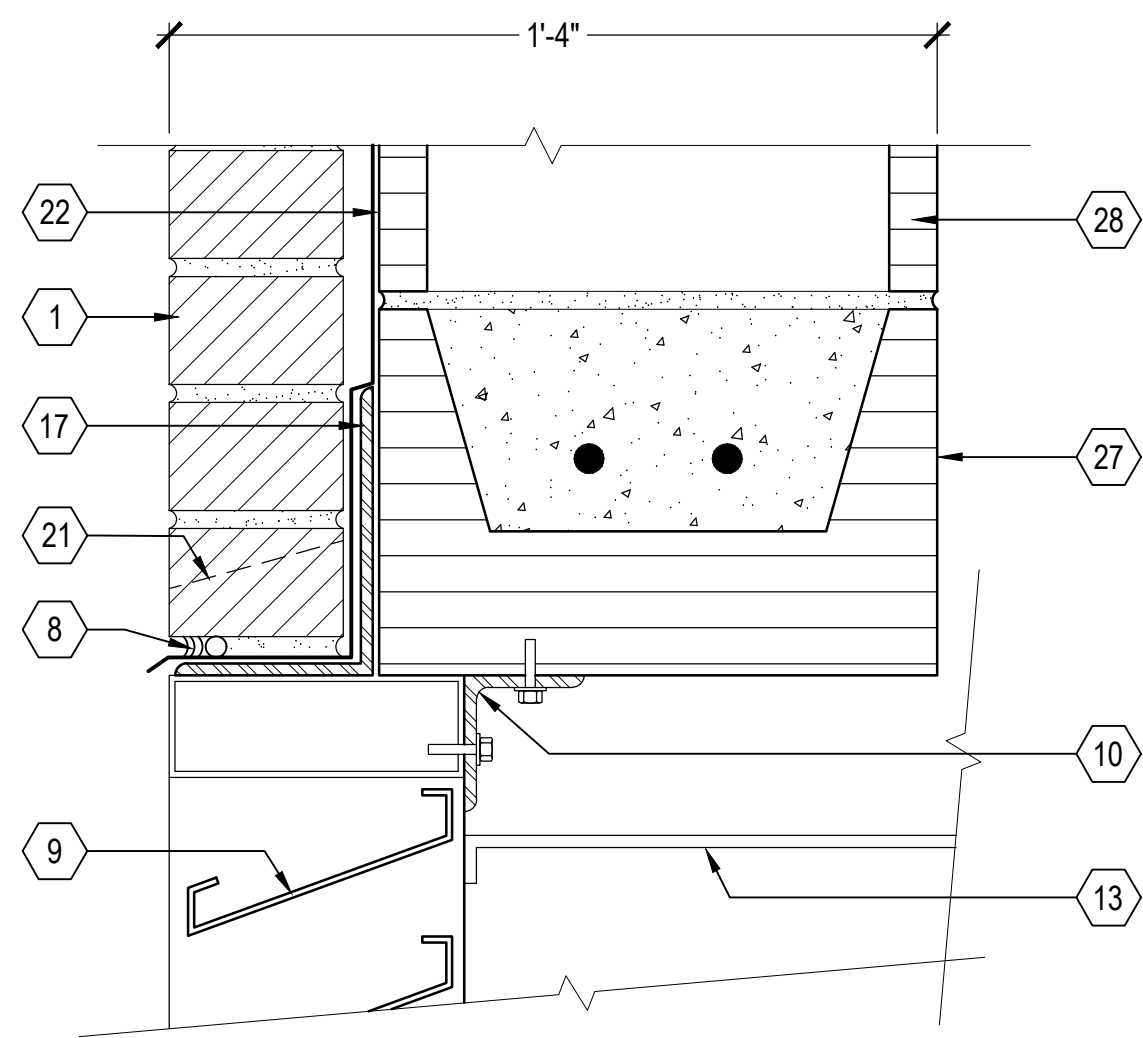


4 LOUVER HEAD DETAIL
A711 SCALE: 3"=1'-0"

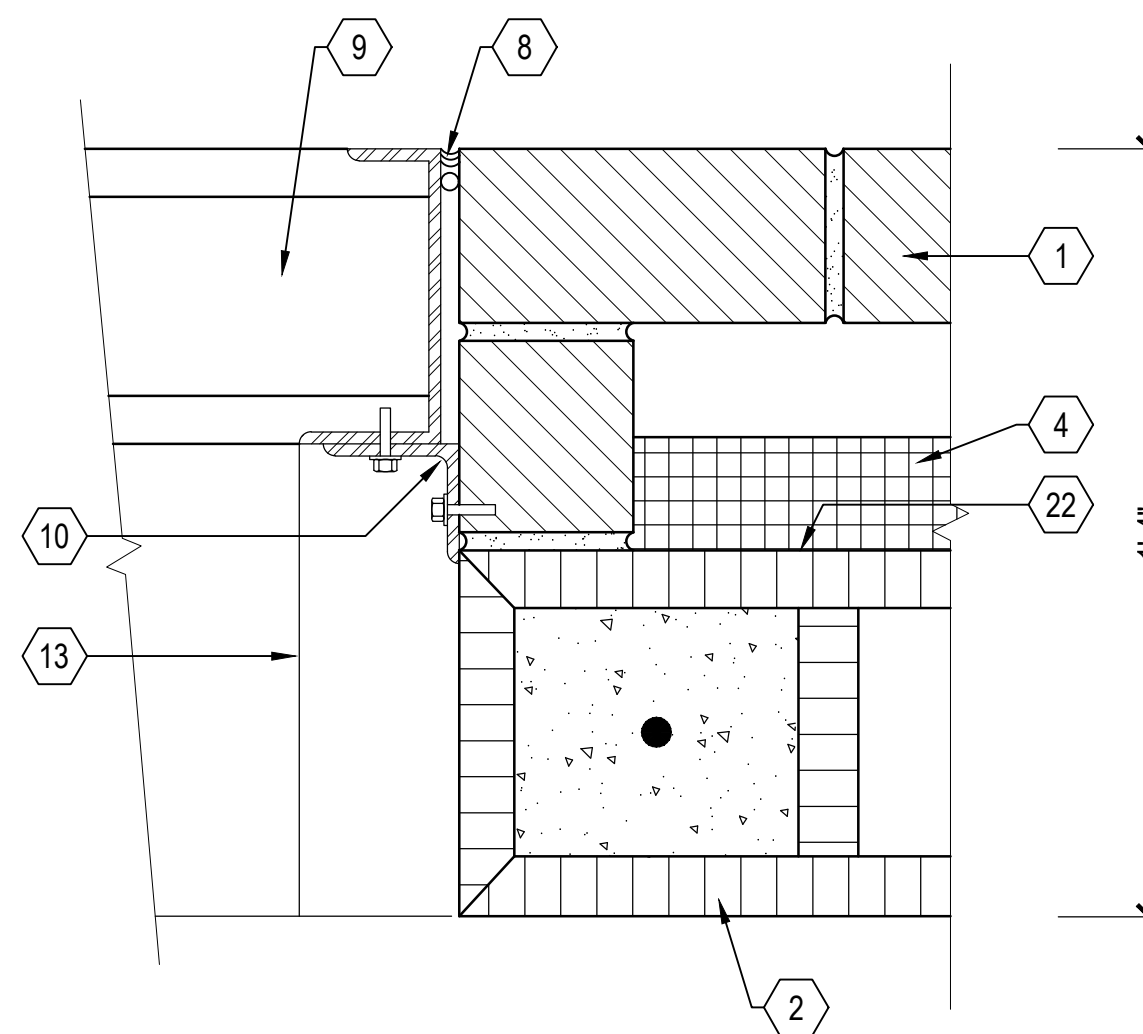


2 LOUVER JAMB DETAIL
A711 SCALE: 3"=1'-0"

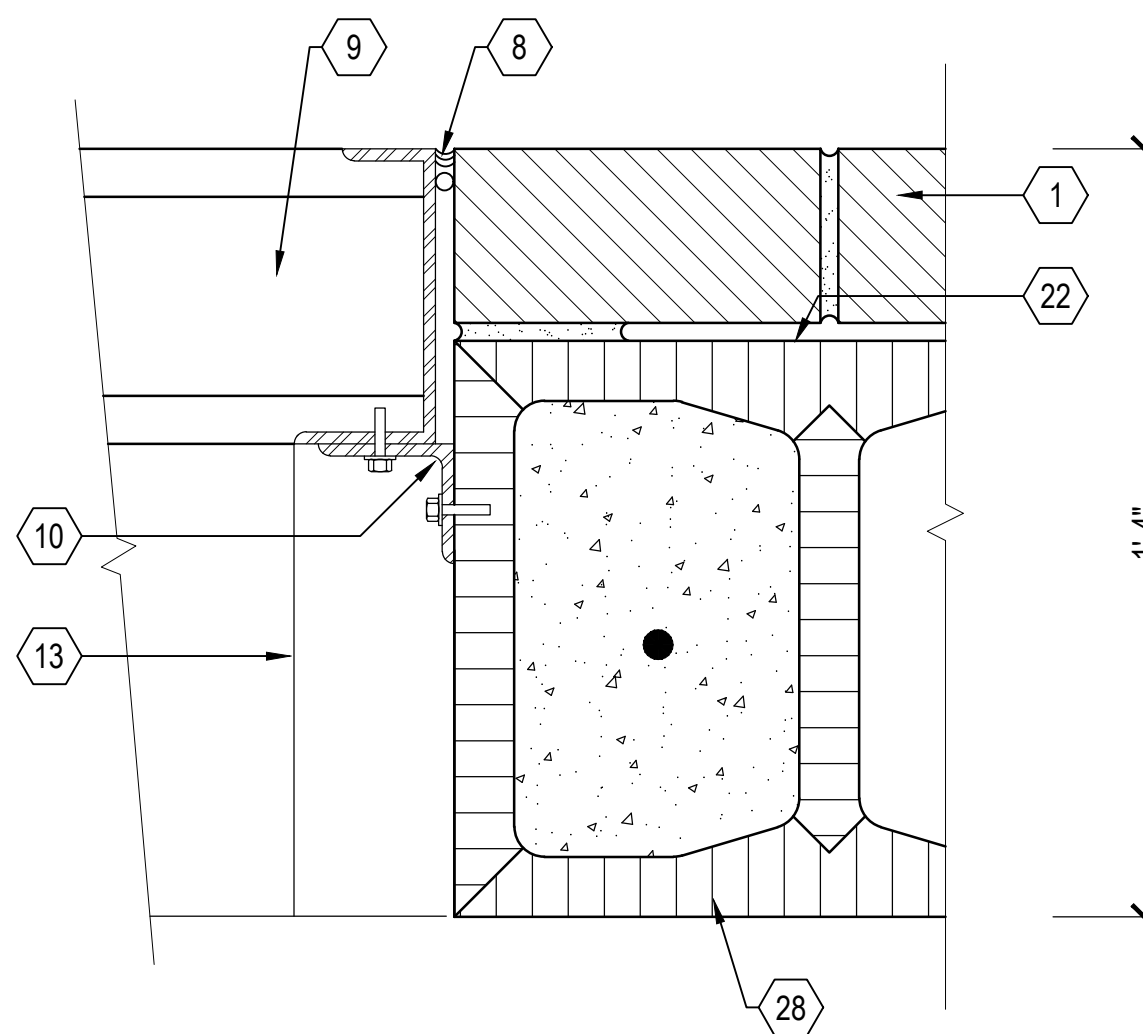


2 LOUVER JAMB DETAIL
A711 SCALE: 3"=1'-0"

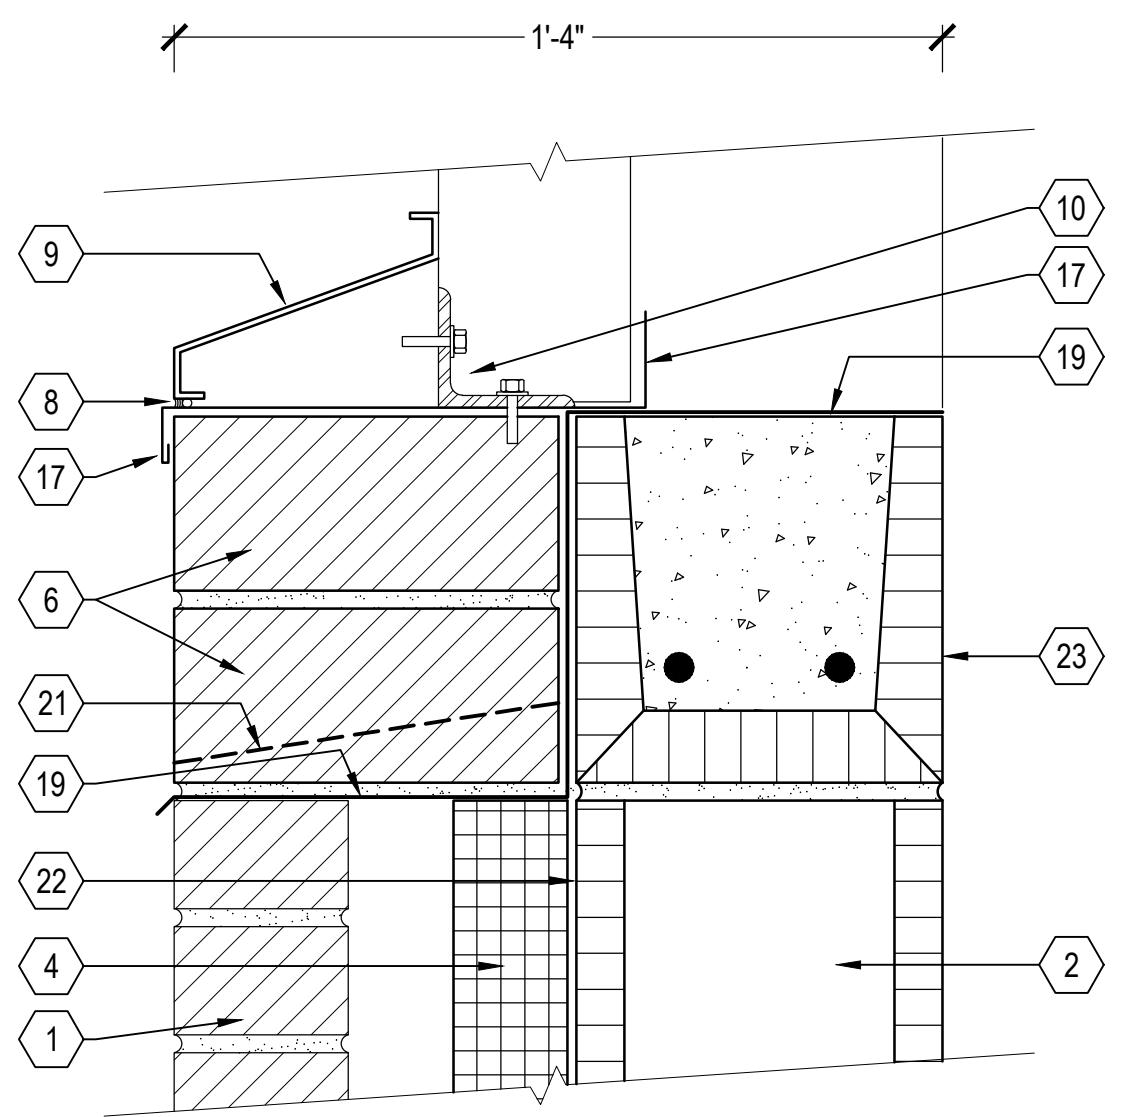

3 LOUVER SILL DETAIL
A711 SCALE: 3"=1'-0"

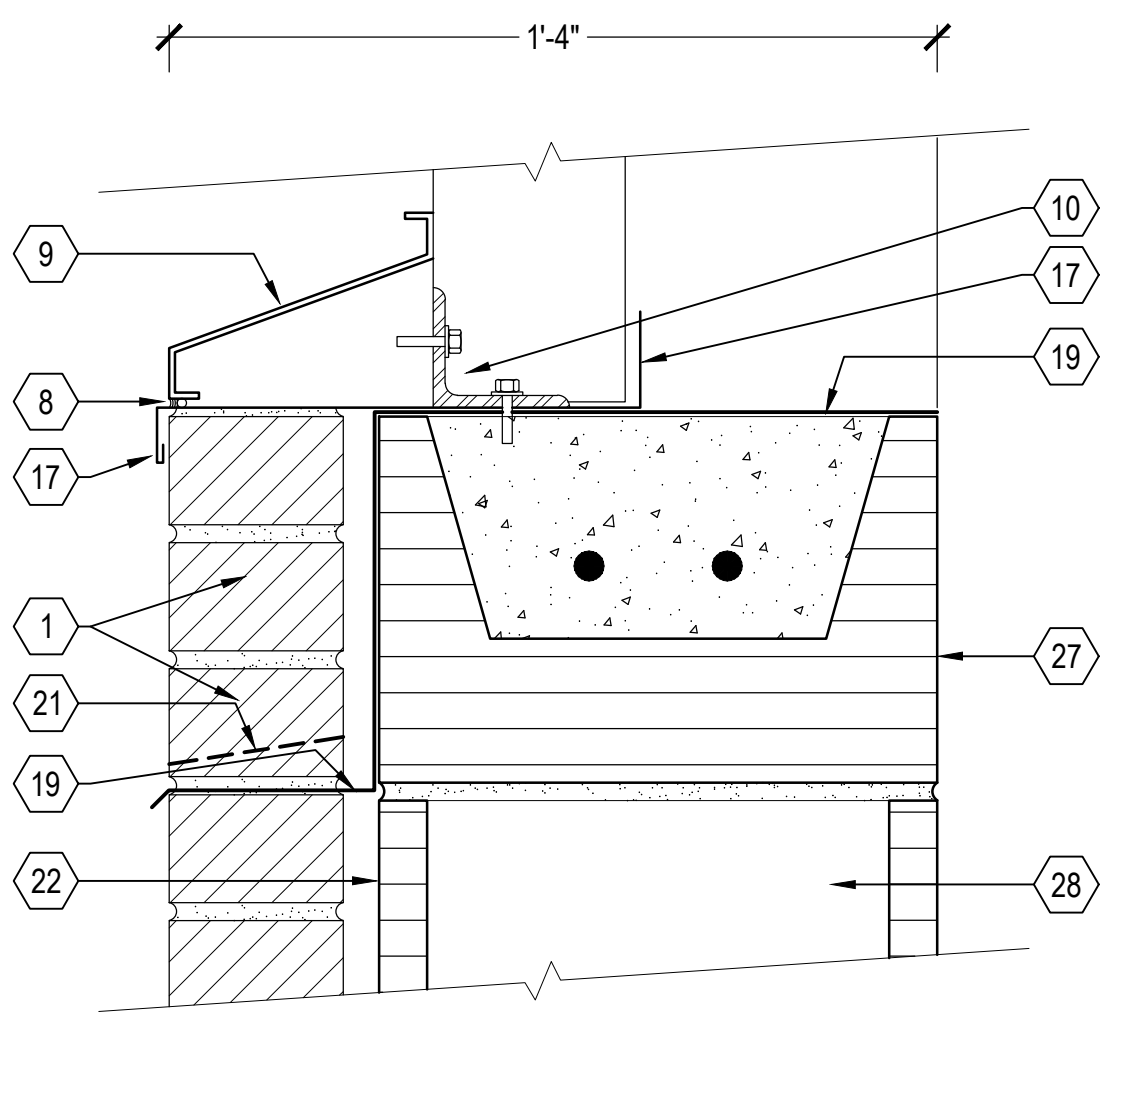

6 LOUVER SILL DETAIL
A711 SCALE: 3"=1'-0"

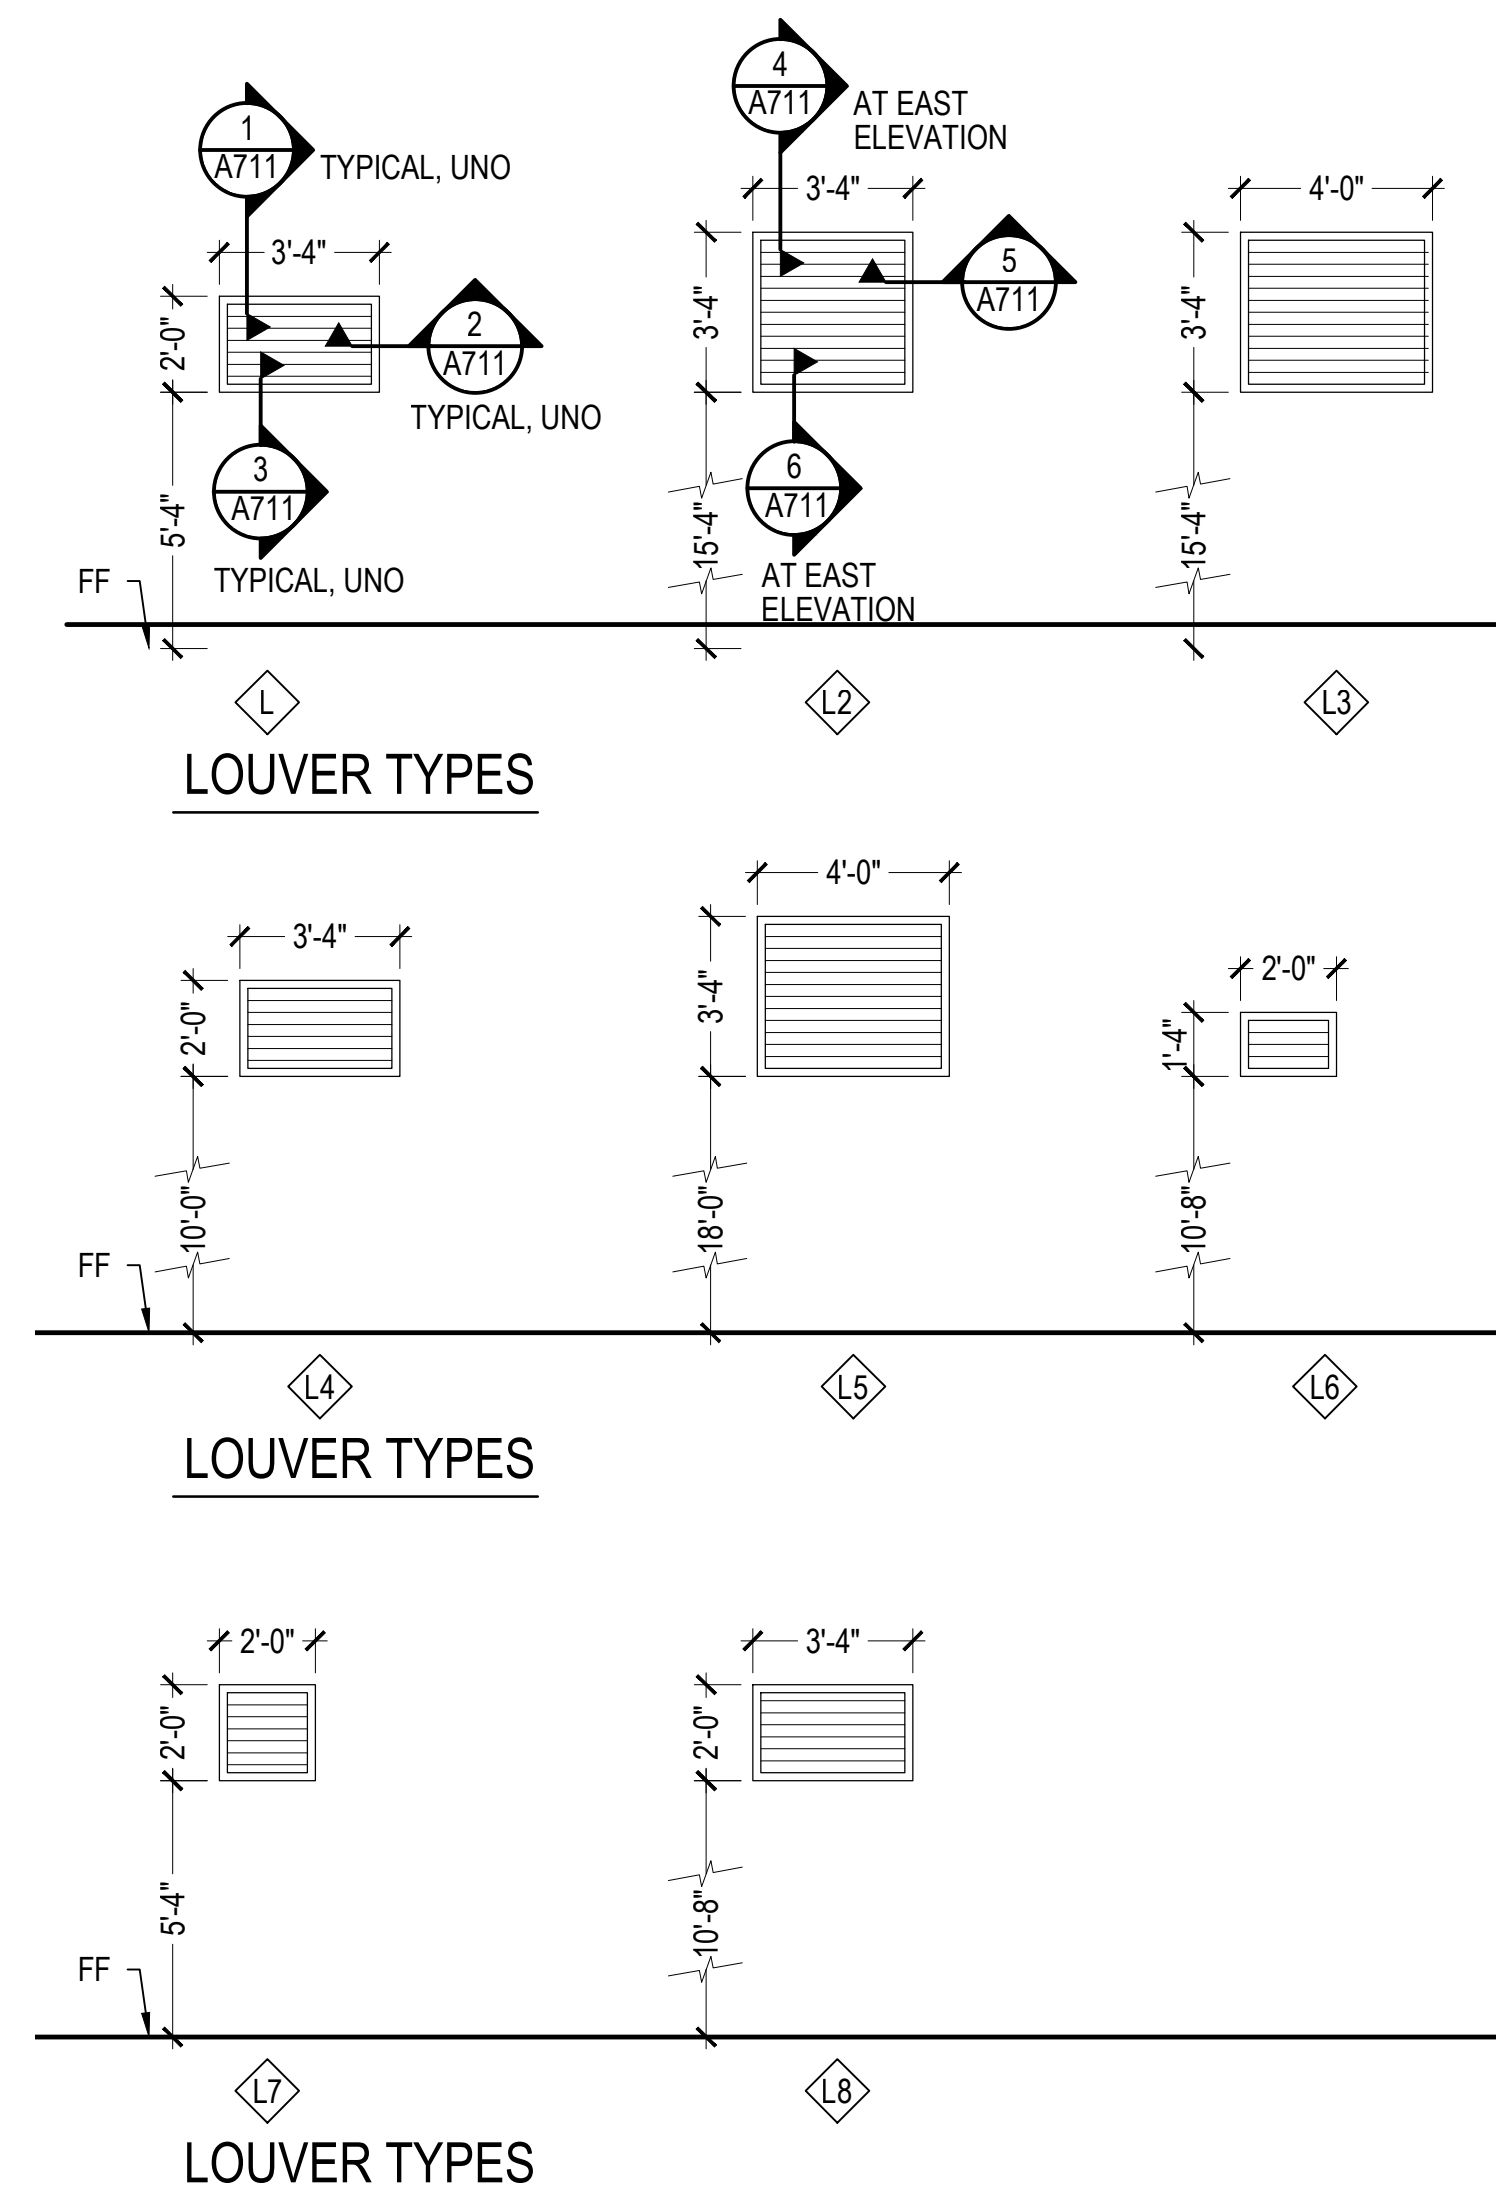

- KEYNOTES**
- 1 4" FACE BRICK
 - 2 8" CMU WITH HORIZ. WIRE REINF. AT 16" O.C., SEE STRUCTURAL FOR REINF.
 - 3 GROUT COLLAR JOINT SOLID.
 - 4 2" EXTRUDED POLYSTYRENE BOARD INSULATION, ADHERE TO CMU.
 - 5 ROWLOCK FACE BRICK
 - 6 SILL BRICK, ROWLOCK
 - 7 IMPACT RESISTANT ALUMINUM WINDOW FRAMING AND GLAZING INSULATED, ATTACH PER FL PRODUCT APPROVAL
 - 8 SEALANT & BACKER ROD - CONT.
 - 9 6" RAIN / WIND / IMPACT-RESISTANT LOUVER. SEE MECHANICAL FOR FIXED / OPERABLE OPERATION
 - 10 INSTALLATION ANGLE
 - 11 LINE OF SILL BELOW
 - 12 SHIM
 - 13 DUCT WORK: SEE MECHANICAL
 - 14 FACE BRICK: SOLDIER COURSE
 - 15 CAULK - CONT
 - 16 8" CMU W/ RADIUS CORNER
 - 17 STEEL ANGLE / TUBE STEEL GALVANIZED LINTEL, SEE STRUCTURAL.
 - 18 ALUMINUM SILL PAN FLASHING, WITH END DAMS
 - 19 THRU-WALL FLASHING
 - 20 WOOD SILL W/ DOUBLE BULLNOSE EDGE - PAINT
 - 21 PVC WEEP SCREED HOLE AT 4'-0"
 - 22 FLUID APPLIED VAPOR BARRIER
 - 23 8" CMU BOND BEAM LINTEL, SEE STRUCTURAL FOR REINFORCING
 - 24 1X P.T. BLOCK, WITH 1/4" EXPANSION ANCHORS, 3 MIN.
 - 25 4" WOOD APRON, PAINT
 - 26 NOT USED
 - 27 12" CMU BOND BEAM: SEE STRUCTURAL FOR REINFORCEMENT
 - 28 12" CMU WITH HORIZONTAL WIRE REINFORCINGS AT 16" OC, SEE STRUCTURAL FOR REINFORCEMENT.












LOUVER ELEVATIONS
& DETAILS


MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

A711
SHEET #

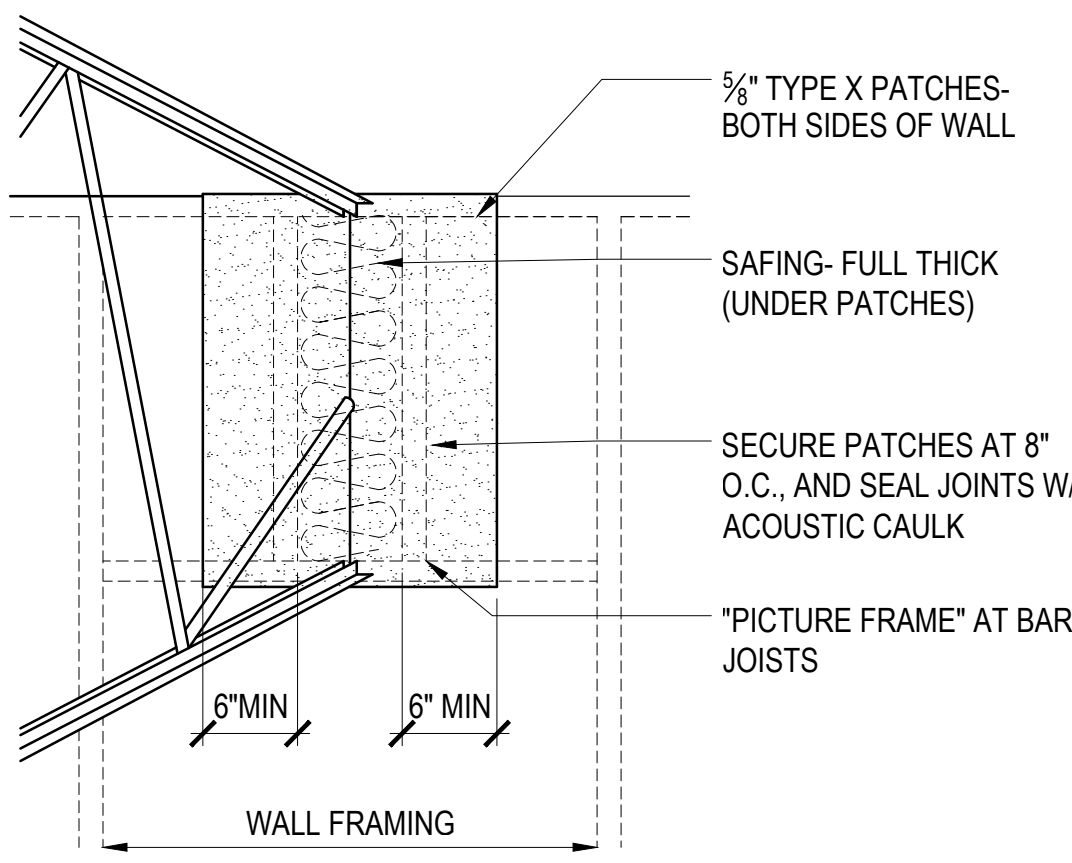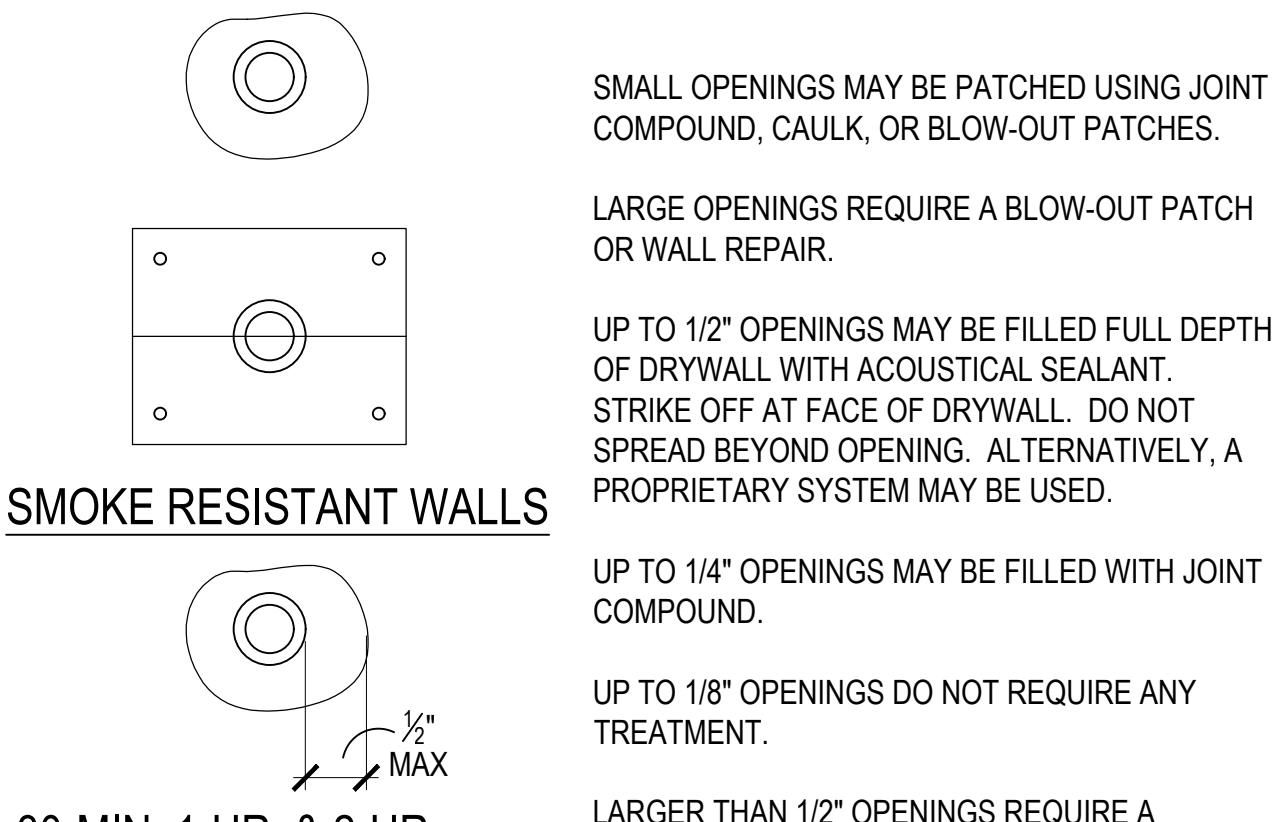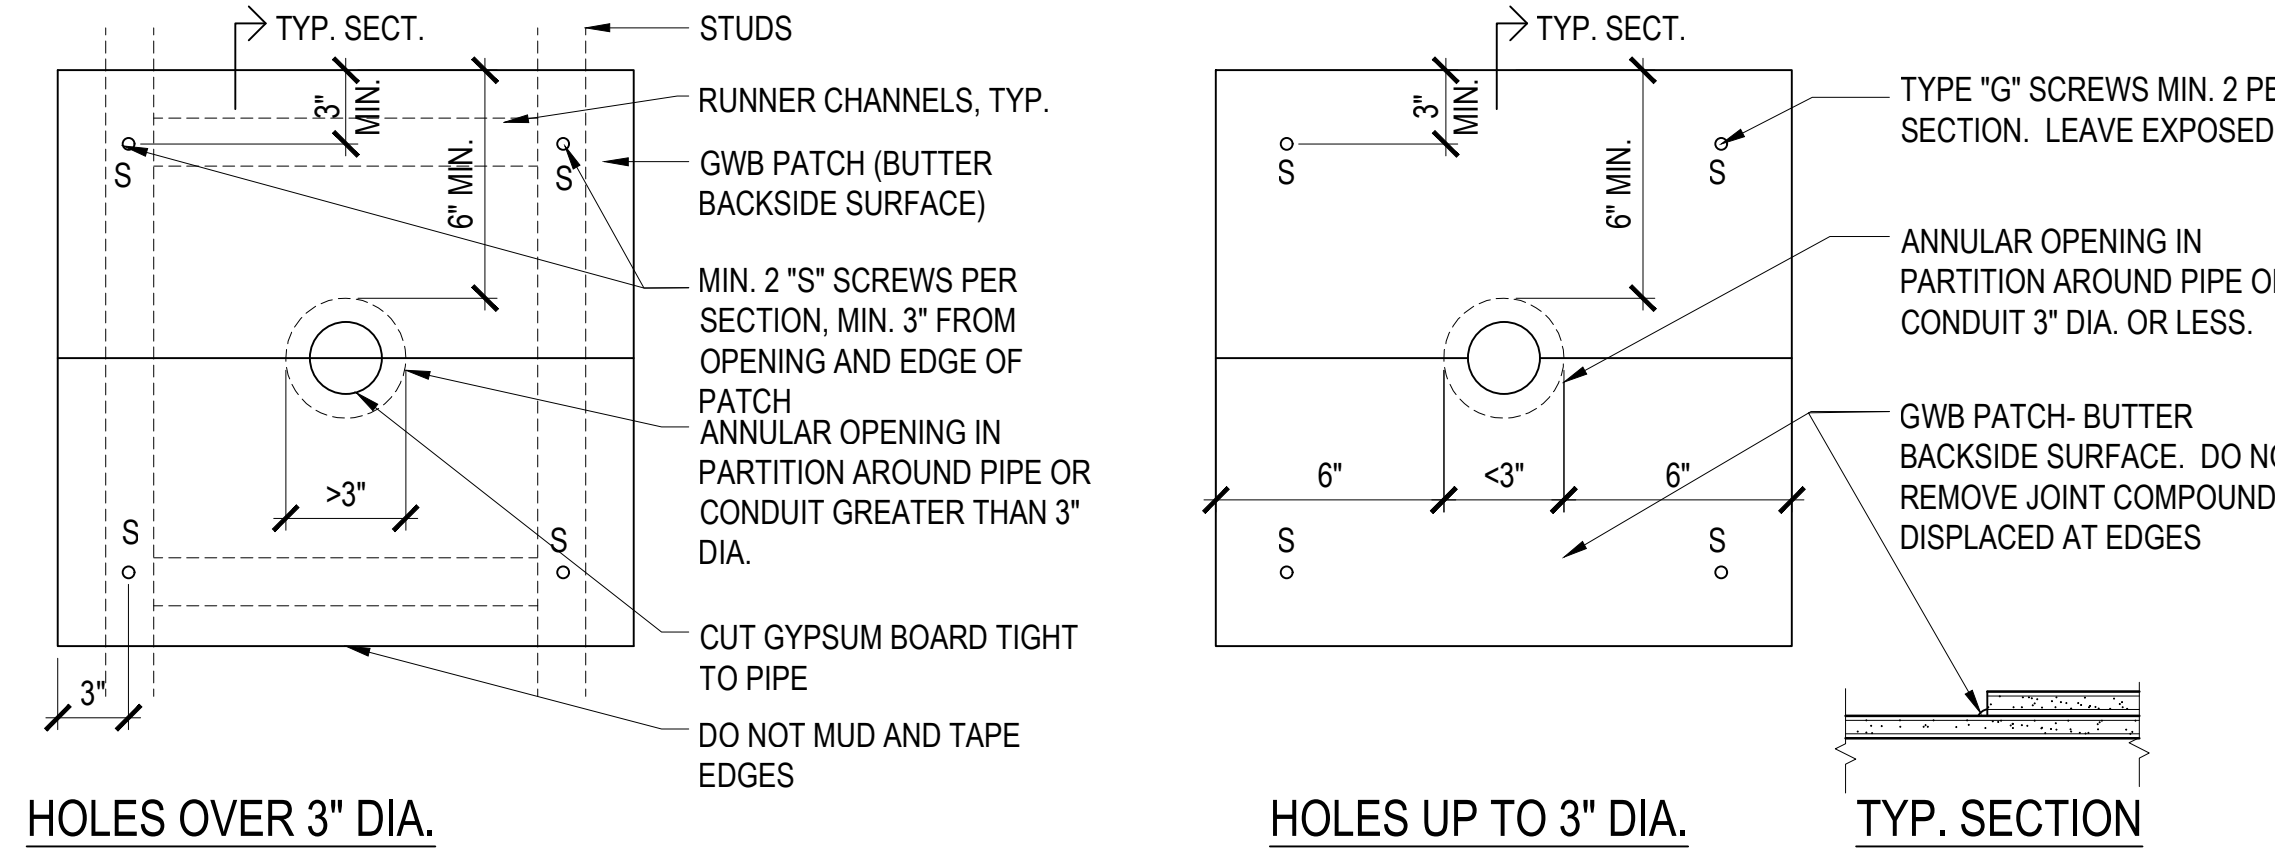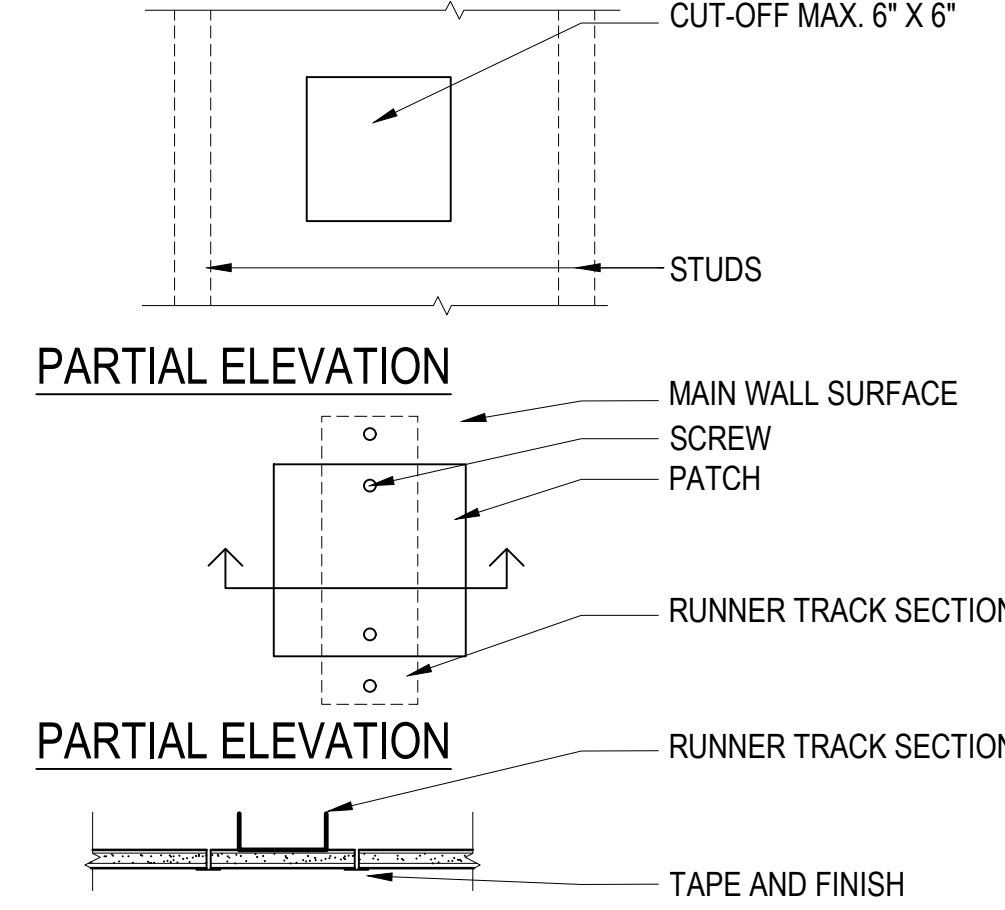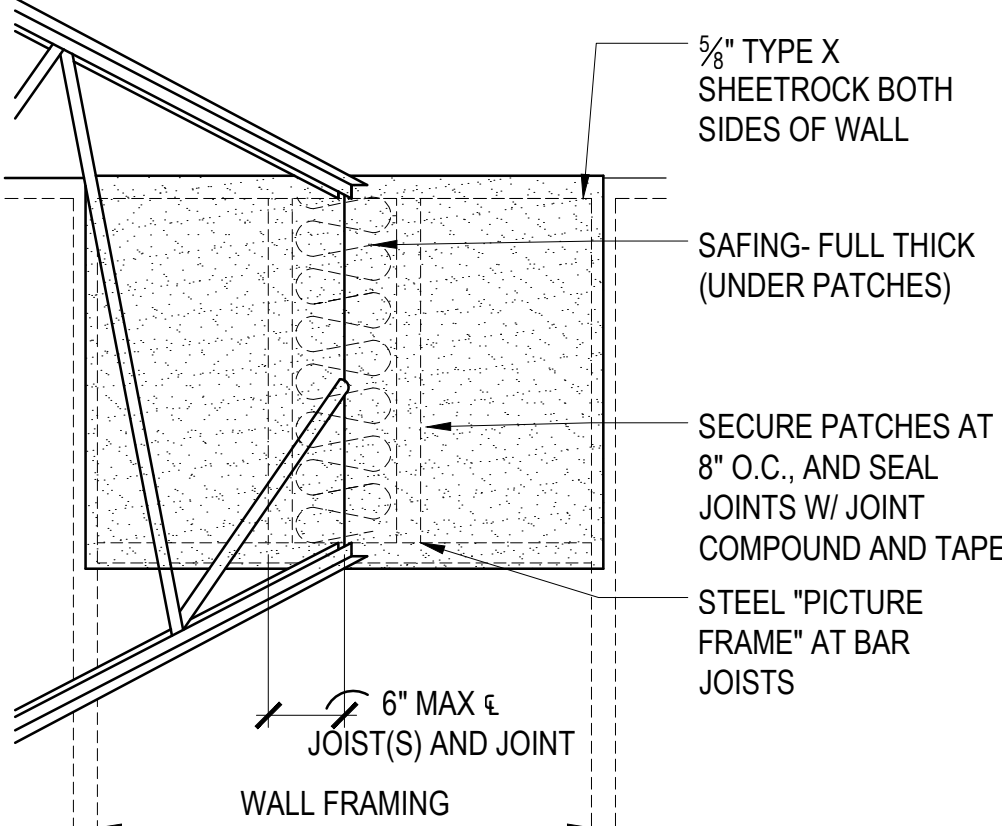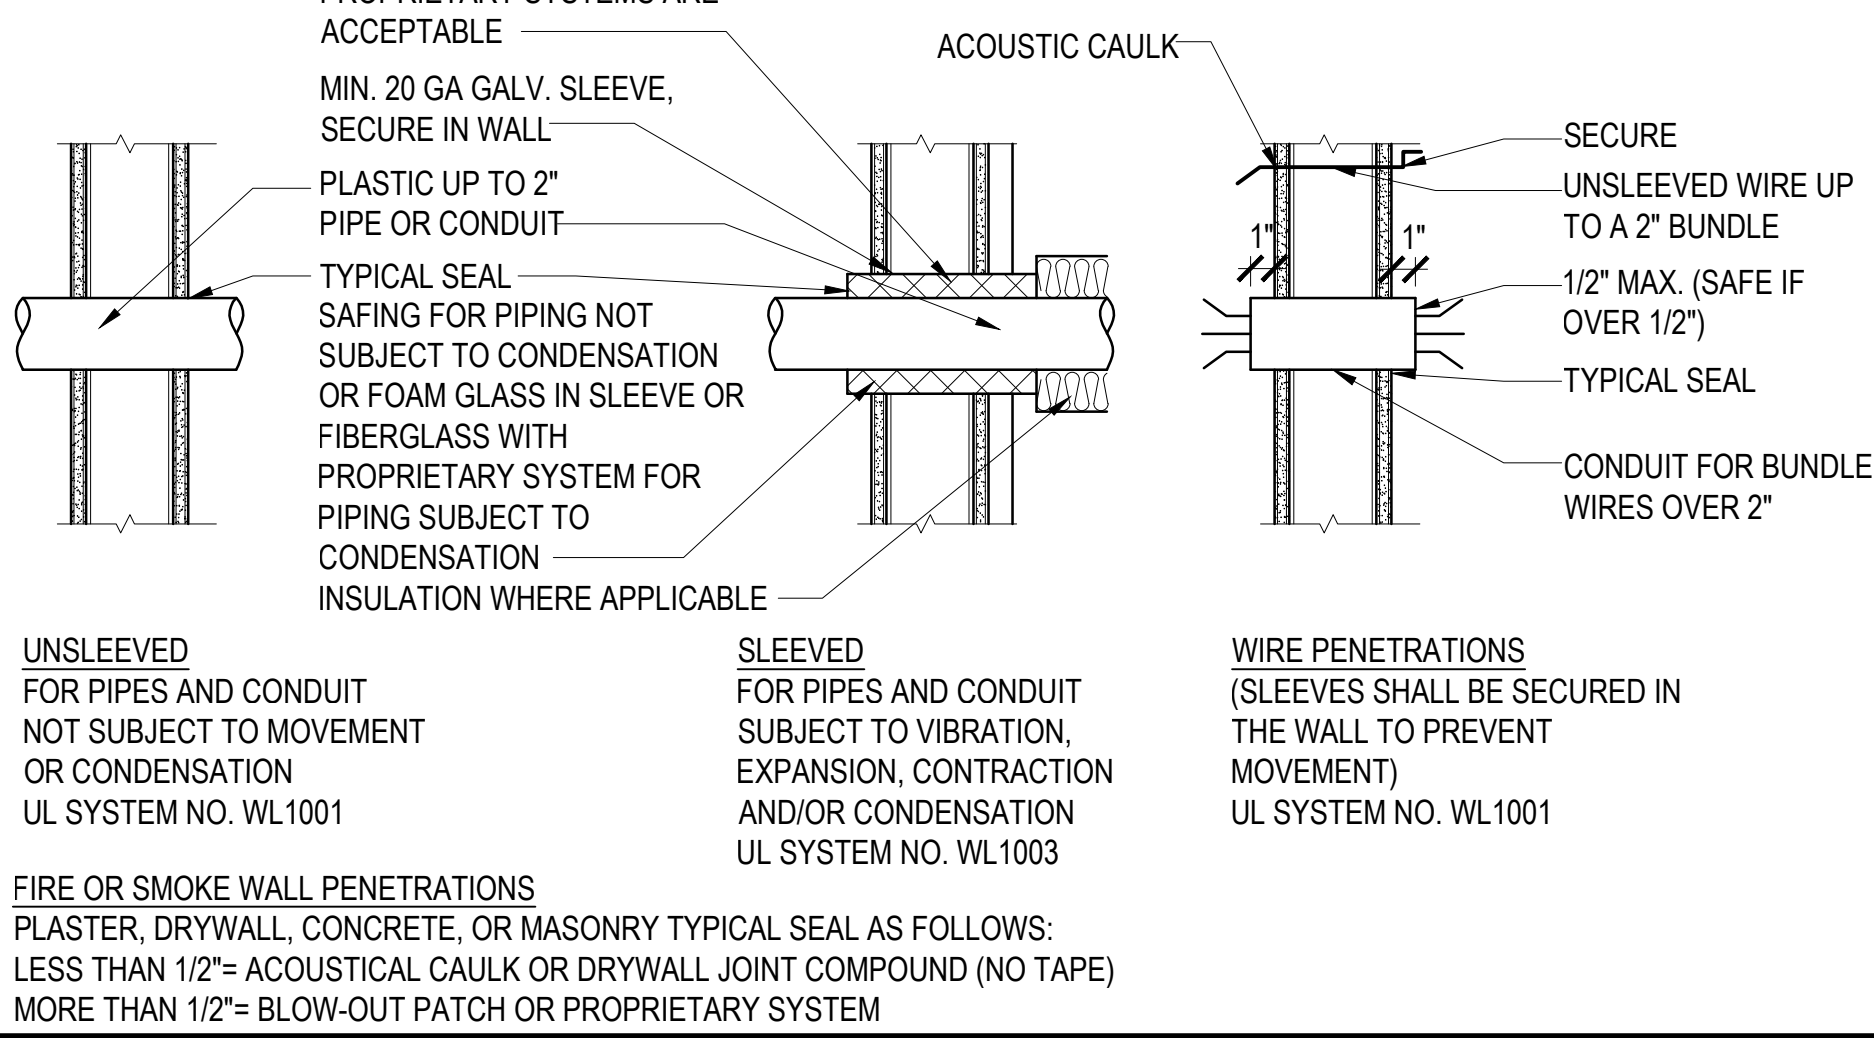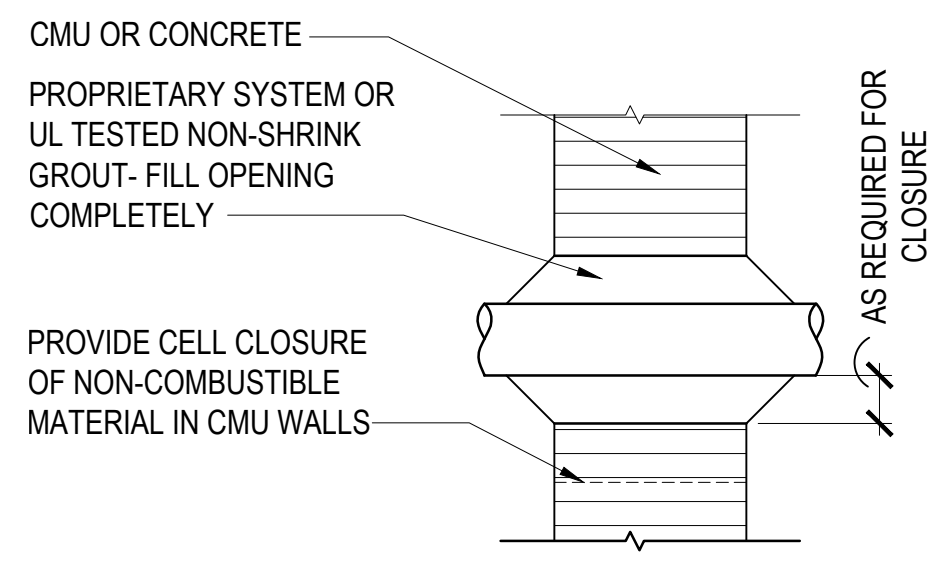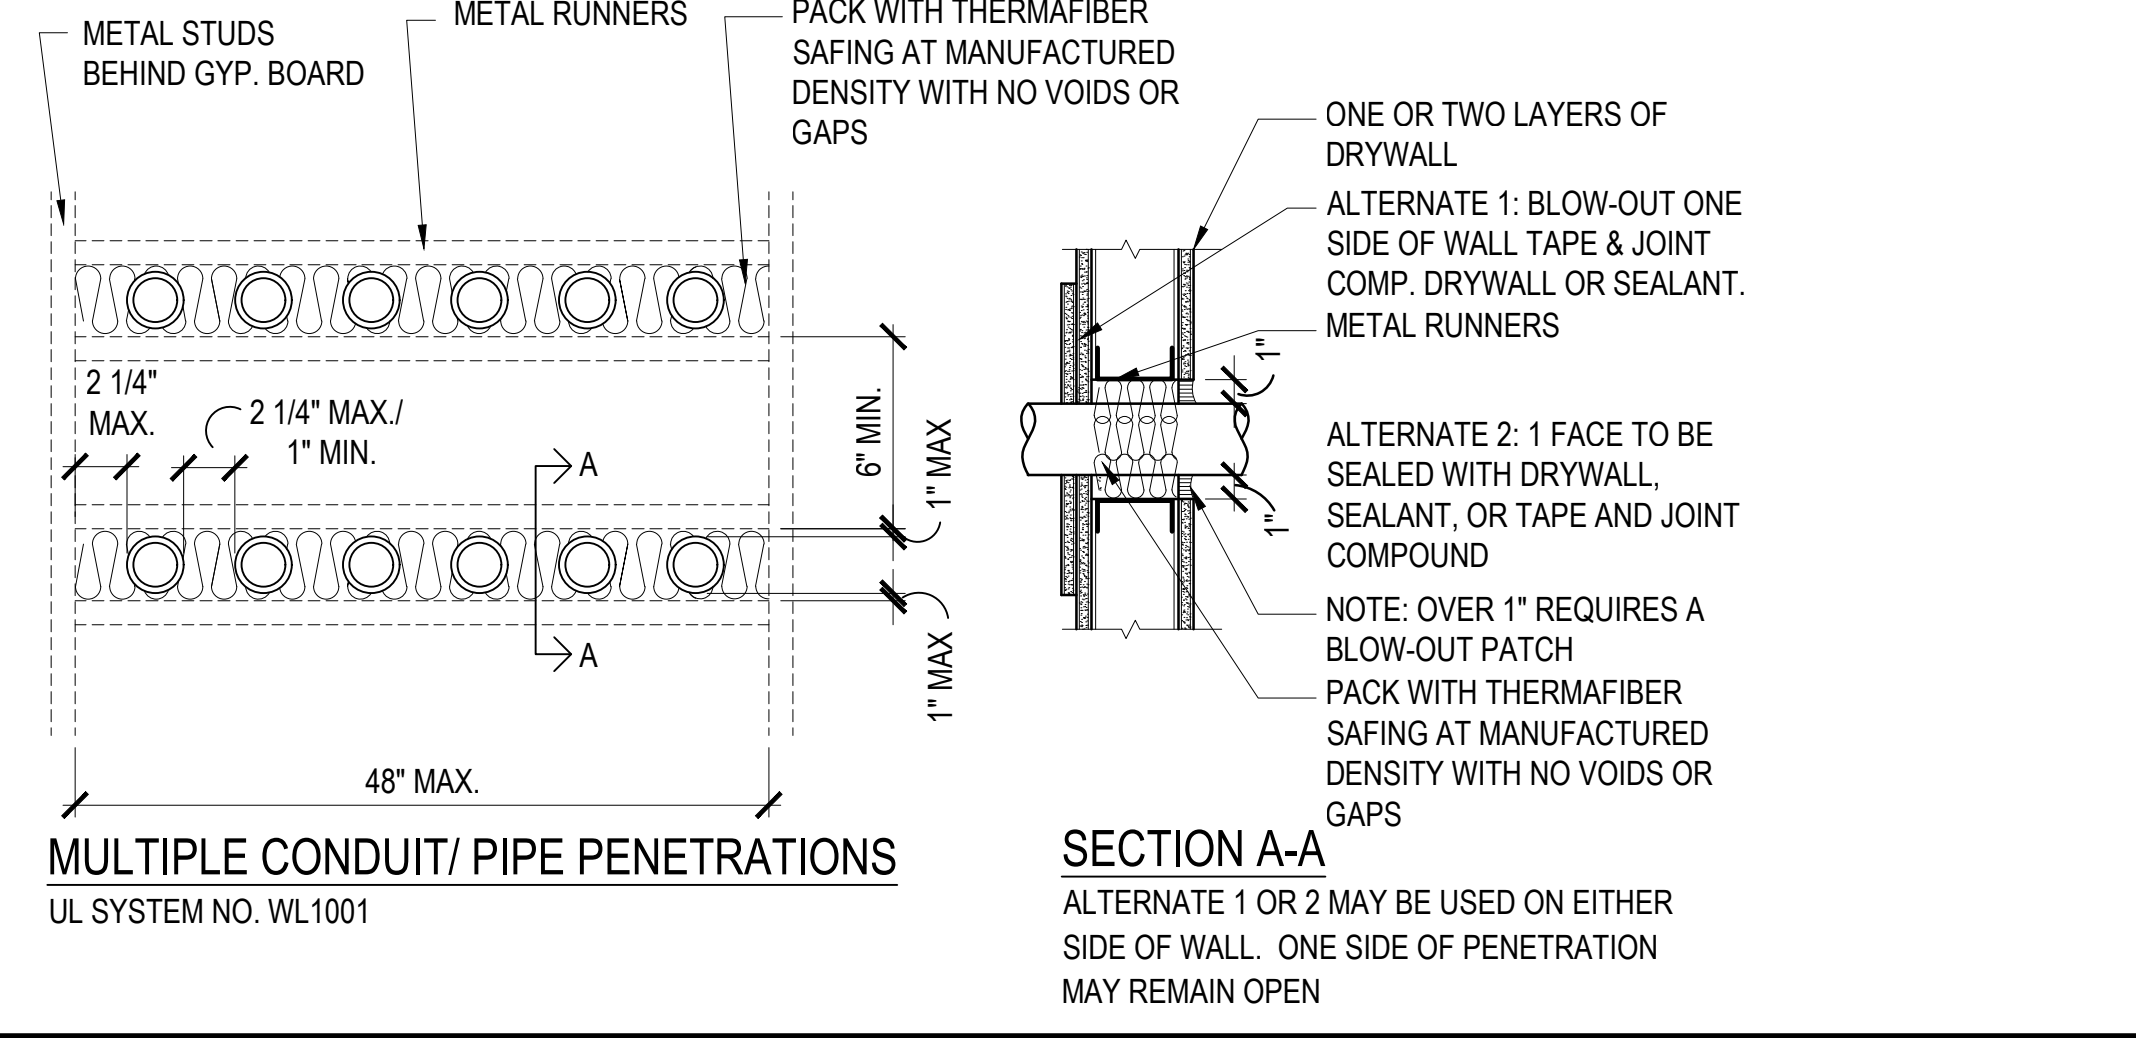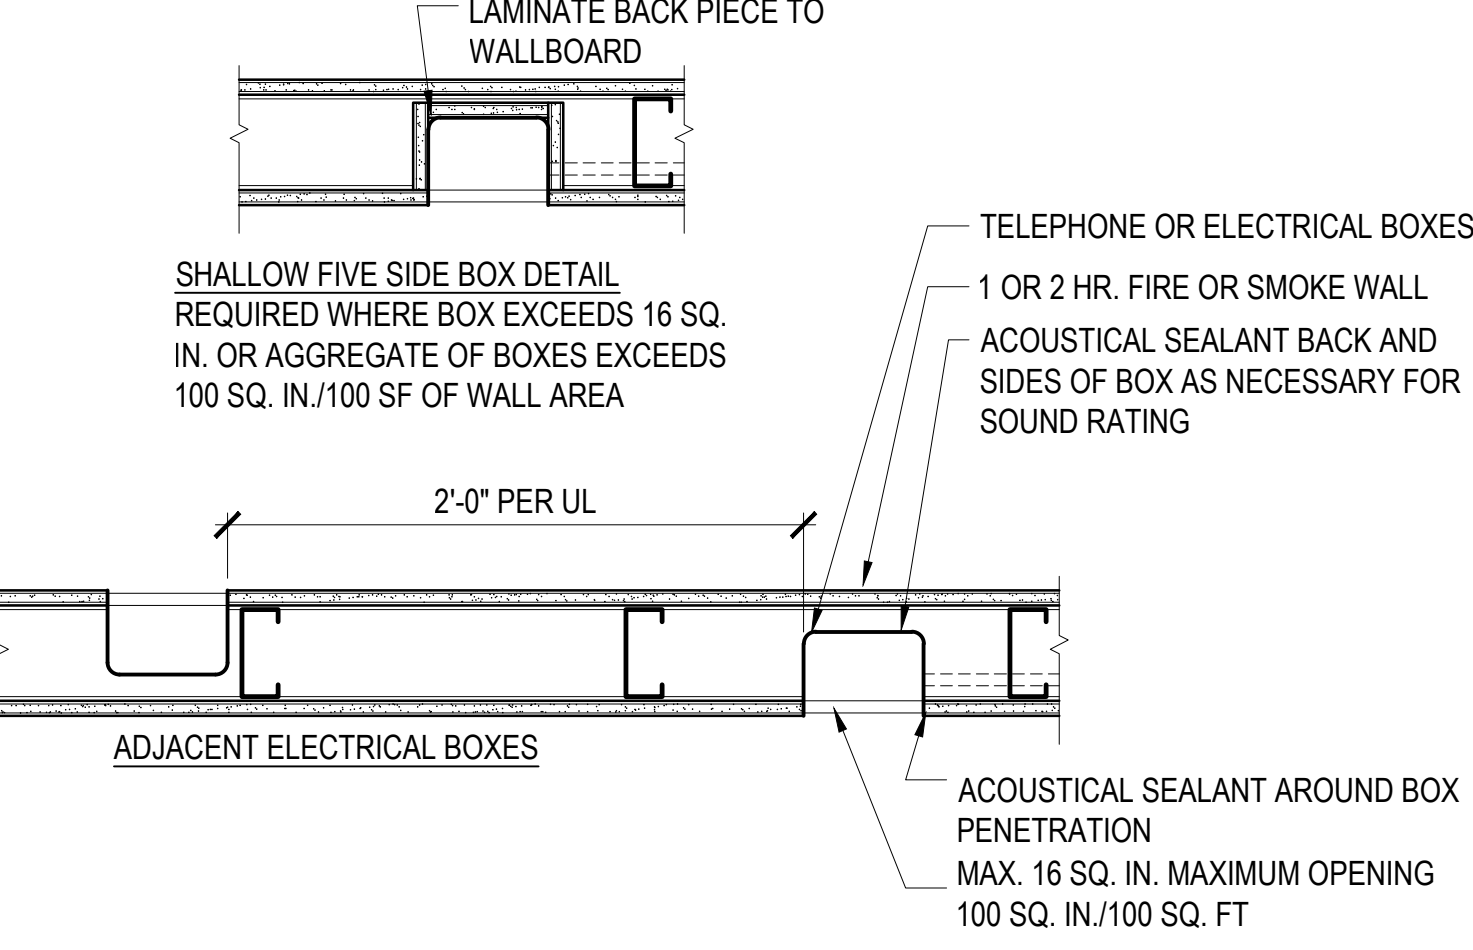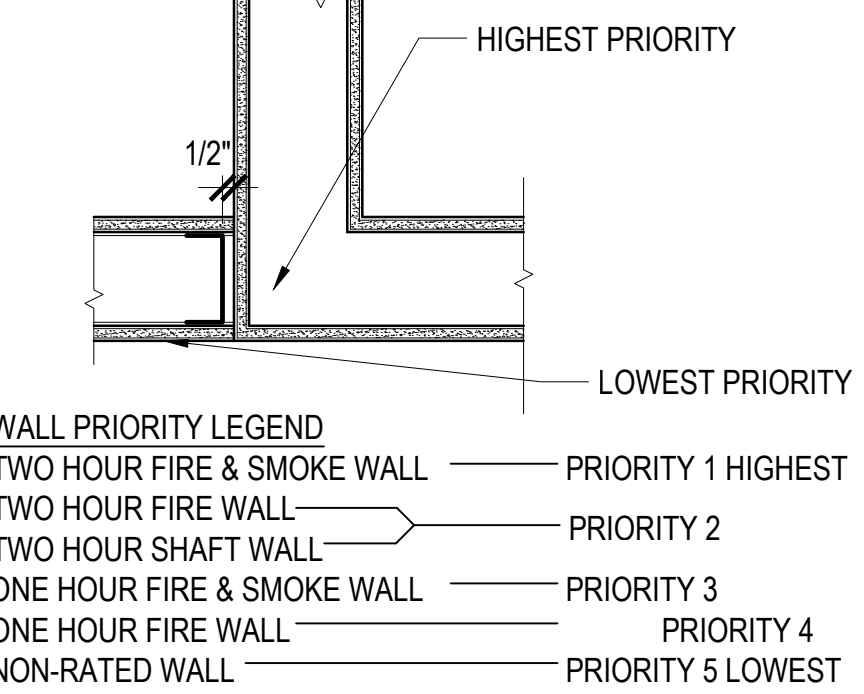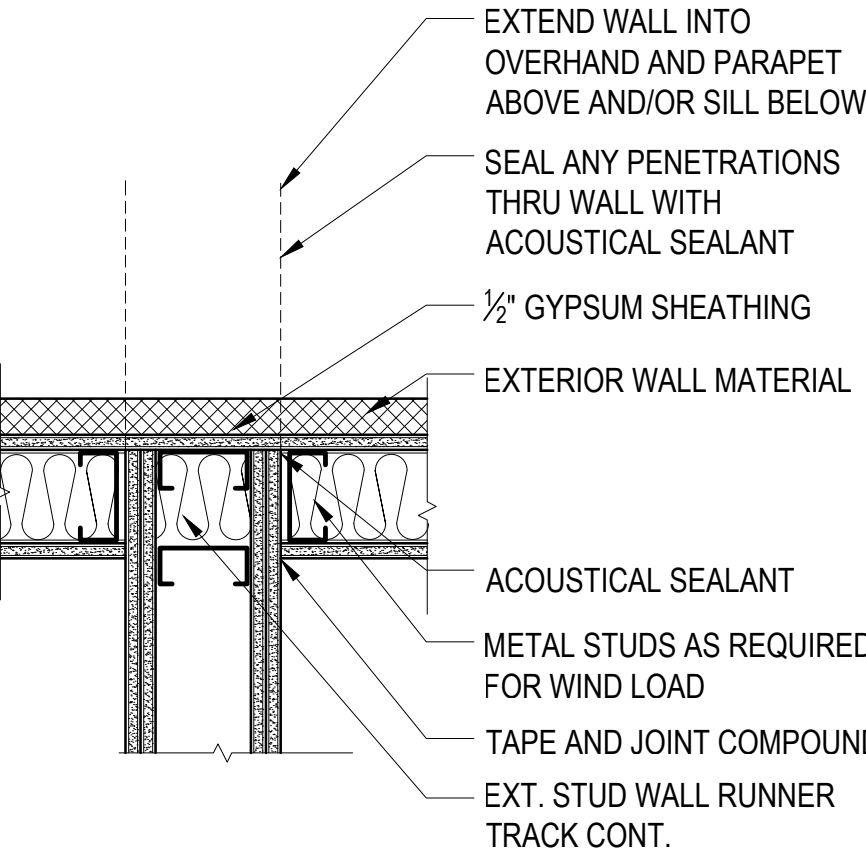
 BLOW-OUT PATCH BAR JOIST PENETRATION OF A RATED WALL		 SMOKE RESISTANT WALLS 30-MIN, 1-HR. & 2-HR. RATED WALLS (FIRE, FIRE & SMOKE) 3- AND 4-HR. WALLS REQUIRE THE USE OF A PROPRIETARY SYSTEM		 HOLES OVER 3" DIA. HOLES UP TO 3" DIA. NOTES: 1. BUTTER ENTIRE BACK SIDE OF PATCH WITH JOINT COMPOUND. 2. LEAVE ALL SCREWS EXPOSED.		 TYPICAL PENETRATION DETAILS	
1 TYPICAL PENETRATION DETAIL		2 TYPICAL PENETRATION DETAIL		3 TYPICAL PENETRATION DETAIL		4 TYPICAL PENETRATION DETAIL	
801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE	
 FLUSH WALL CONSTRUCTION BAR JOIST PENETRATION OF A RATED WALL		 TYPICAL PENETRATION DETAIL		 CONCRETE MASONRY UNITS OR SOLID CONCRETE WALLS		 MULTIPLE CONDUIT/ PIPE PENETRATIONS SECTION A-A	
5 TYPICAL PENETRATION DETAIL		6 TYPICAL PENETRATION DETAIL		7 TYPICAL PENETRATION DETAIL		8 TYPICAL PENETRATION DETAIL	
801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE	
ELECTRICAL JUNCTION BOXES WHEN A METALLIC JUNCTION BOX FOR ELECTRICAL RECEPTACLES OR SWITCHES IS CONTAINED WITHIN A RATED WALL OF GYPSUM DRYWALL CONSTRUCTION AND AN OPENING IS PROVIDED FOR THE BOX IN THE SURFACE OF THAT WALL, THE AREA OF THE OPENING MAY NOT EXCEED 16 SQUARE INCHES, UNLESS THE JUNCTION BOX IS ENCLOSED BY A "5-SIDED BOX" (SEE APPROVED DETAILS). THE AGGREGATE AREA OF ALL SUCH JUNCTION BOXES IN A RATED WALL NOT ENCLOSED BY "5-SIDED BOXES" DESCRIBED ABOVE SHALL NOT EXCEED 100 SQUARE INCHES IN 100 SQUARE FEET OF WALL AREA AS MEASURED FROM FLOOR TO STRUCTURAL DECK OR RATED MEMBRANE. JUNCTION BOXES WITH OPENINGS ON OPPOSITE FACES OF RATED WALLS SHALL HAVE A HORIZONTAL SEPARATION OF 24 INCHES AS A MINIMUM, REGARDLESS OF BOX SIZE, UNLESS ENCLOSED BY "5-SIDED BOXES". LOCATIONS OF STUDS DO NOT HAVE ANY BEARING ON THE ABOVE REQUIREMENTS. NOR DOES THE USE OF MINERAL WOOL FIRE SAFING ALTER THESE REQUIREMENTS.		 DAMPER SLEEVE INSTALLATION NOTE: SPECIFIC FRAMING REQUIREMENTS OF OPENINGS SHOULD BE PROVIDED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS THAT ARE SUBMITTED FOR BUILDING PERMITS.		 TYPICAL PENETRATION DETAIL		 PLAN VIEW- FIRE AND/OR SMOKE WALL AT EXTERIOR WALL	
9 TYPICAL PENETRATION DETAIL		10 TYPICAL PENETRATION DETAIL		11 TYPICAL PENETRATION DETAIL		12 TYPICAL PENETRATION DETAIL	
801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE		801 NOT TO SCALE	

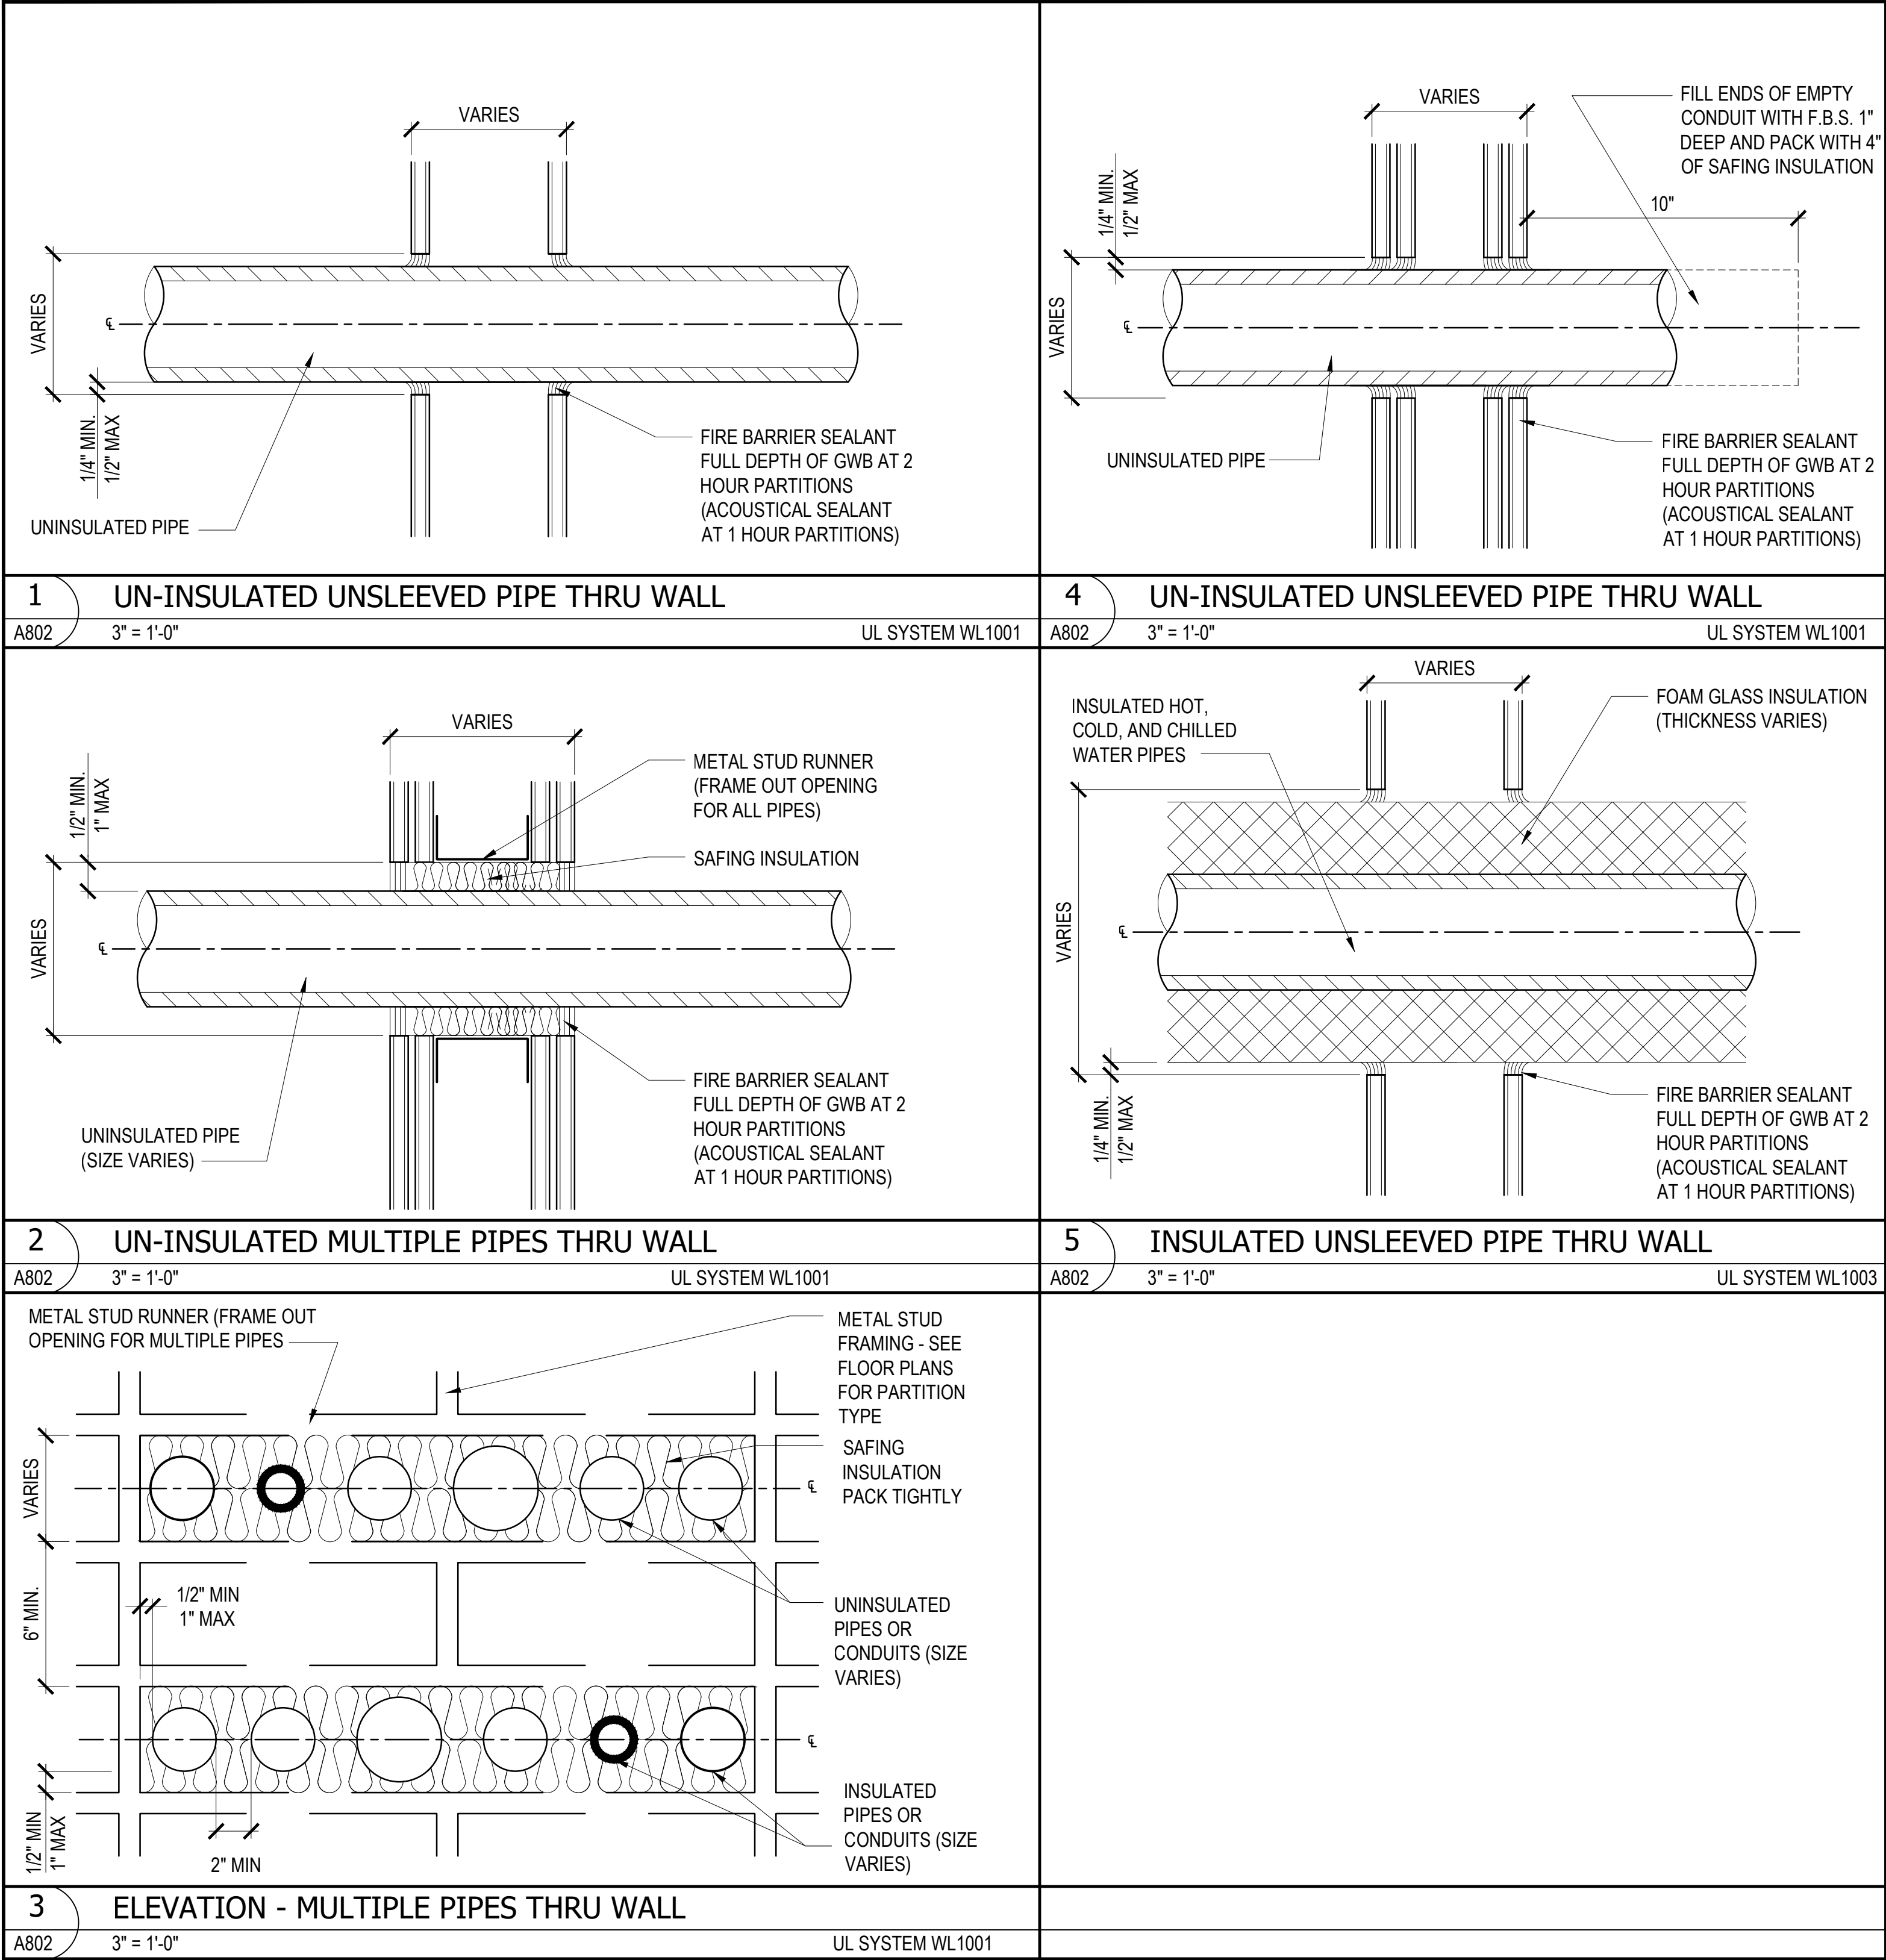

TYPICAL
PENETRATION DETAILS



MIDWAY FIRE DISTRICT
FIRE STATION # 3 6
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

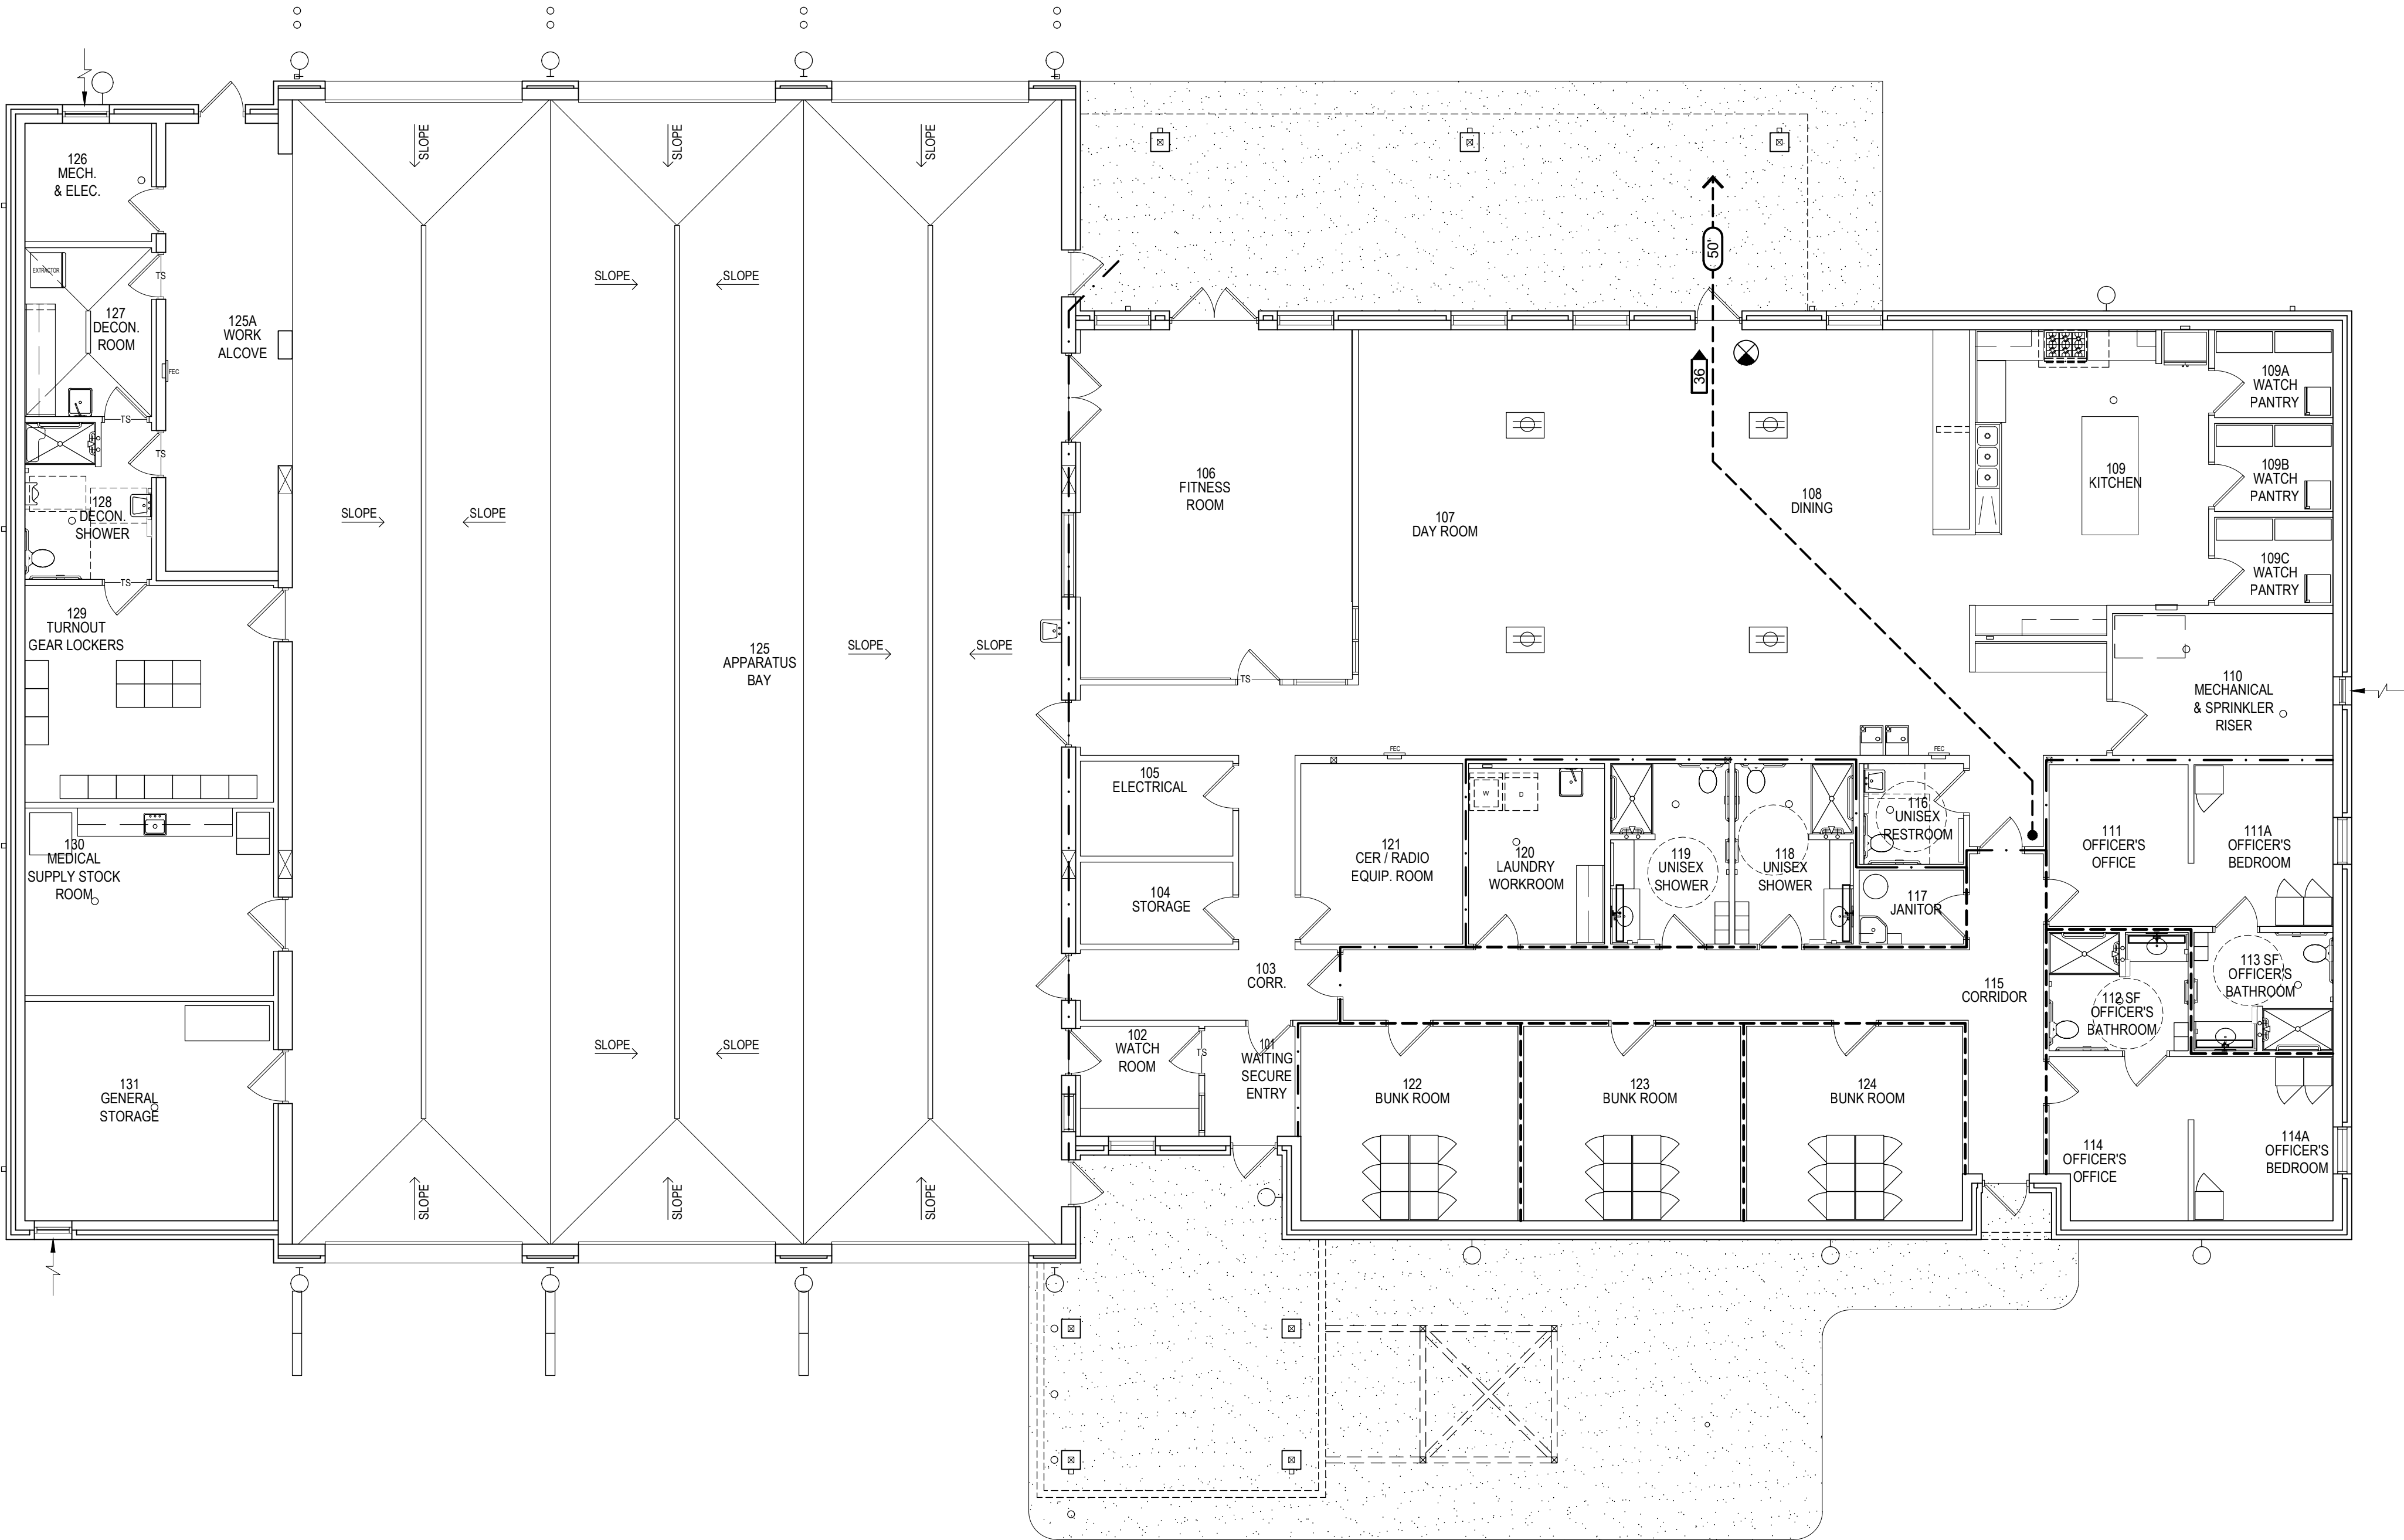

 **LIFE SAFETY PLAN**
SCALE: 1/8"=1'-0"

LEGEND

- FE FIRE EXTINGUISHER W/ WALL BRACKET
-  EXIT SIGN FACE & DIRECTION
-  EXIT CAPACITY (CLEAR INCHES)
-  HEAT DETECTOR
-  SMOKE DETECTOR
-  AUDIBLE SIGNAL , CHIME
-  VISUAL SIGNAL, STROBE
-  AUDIBLE/VISUAL SIGNAL, CHIME/STROBE
-  PULL STATION, ADDRESSABLE TYPE
-  FIRE ALARM CONTROL PANEL
-  TRAVEL DISTANCE AND ROUTE TO EXIT FROM MOST REMOTE POINT

GENERAL NOTES

APPLICABLE CODES:
FLORIDA BUILDING CODE: BUILDING EIGHTH EDITION -- 2023
FBC: PLUMBING EIGHTH EDITION -- 2023
FBC: MECHANICAL EIGHTH EDITION -- 2023
NATIONAL ELECTRIC CODE NFPA 70, 2017 EDITION
FL FIRE PREVENTION CODE EIGHTH EDITION -- 2023

FLORIDA BUILDING CODE: BUILDING:

USE AND OCCUPANCY CLASSIFICATIONS:

304.1 BUSINESS GROUP B
310.4 RESIDENTIAL GROUP R-2
311.3 LOW-HAZARD STORAGE, GROUP S-2

CONSTRUCTION TYPE IIB, EQUIPPED THROUGHOUT WITH AUTOMATIC SPRINKLER SYSTEM

TABLE 506.2: ALLOWABLE AREA FACTOR FOR CONSTRUCTION TYPE IIB S (EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM):

ALLOWABLE AREA FOR GROUP B: 92,000 SF.
ALLOWABLE AREA FOR GROUP R-2: 64,000 SF.
ALLOWABLE AREA FOR GROUP S-2: 104,000 SF.

ACTUAL BUILDING AREAS:

GROUP B OCCUPANCY AREA: 3,405 GSF
GROUP R-2 OCCUPANCY AREA: 2,113 GSF
GROUP S-2 OCCUPANCY AREA: 5,928 GSF
TOTAL BUILDING AREA: 11,446 GSF

508.3 OCCUPANCY AREA SIZES ALLOW FOR NON-SEPARATED OCCUPANCIES.
508.3.2 ALLOWABLE BUILDING AREA AND HEIGHT SHALL BE BASED ON MOST RESTRICTIVE OCCUPANCY GROUP WHICH IS R-2:

ALLOWABLE BUILDING AREA FOR GROUP R-2 OCCUPANCY, TYPE IIB CONSTRUCTION. SPRINKLERED, ONE STORY IS 64,000 SF
ACTUAL BUILDING AREA (TOTAL) IS 11,446 GSF.
BUILDING IS WITHIN THE AREA LIMITATIONS PRESCRIBED FOR NON-SEPARATED OCCUPANCIES.

508.3.3 NO SEPARATION IS REQUIRED BETWEEN NON-SEPARATED OCCUPANCIES
EXCEPTION 2: R-2 SLEEPING UNITS SHALL BE SEPARATED PER SECTION 420.
420.2 WALLS SEPARATING SLEEPING UNITS SHALL BE CONSTRUCTED AS FIRE PARTITIONS IN ACCORDANCE WITH SECTION 708.
708.3 FIRE-RESISTANCE RATING FOR FIRE PARTITIONS SEPARATING SLEEPING UNITS SHALL BE 1/2 HOUR.

601: CONSTRUCTION TYPE IS TYPE IIB: NONCOMBUSTIBLE BUILDING ELEMENTS (602.2) WITH FIRE RESISTANCE RATING OF ZERO FOR BUILDING ELEMENTS LISTED IN TABLE 601.

OCCUPANT LOADS

TABLE 1004.5: OCCUPANT LOAD FOR SPACES THAT FUNCTION AS BUSINESS AREAS IS ONE OCCUPANT PER 150 GSF.
ACTUAL AREA FOR OFFICE FUNCTION IS 3,405 GSF -- THEREFORE OCCUPANT LOAD IN AREAS FUNCTIONING AS BUSINESS IS 23 PERSONS.

TABLE 1004.5: OCCUPANT LOAD FOR SPACES THAT FUNCTION AS DORMITORY ROOMS IS ONE OCCUPANT PER 50 GSF.
ACTUAL AREA FOR DORMITORY FUNCTION IS 2,113 GSF -- THEREFORE OCCUPANT LOAD IN AREAS FUNCTIONING AS DORMITORY IS 43 PERSONS.

TABLE 1004.5: OCCUPANT LOAD FOR SPACES THAT FUNCTION AS STORAGE IS ONE OCCUPANT PER 500 GSF.
ACTUAL AREA FOR APPARATUS BAY AND TURNOUT GEAR LOCKERS IS 5,928 GSF -- THEREFORE OCCUPANT LOAD THIS AREA IS 12 PERSONS.

TABLE 1020.1 CORRIDORS IN OCCUPANCY CLASSIFICATION R SERVING OCCUPANT LOAD OF GREATER THAN 10 SHALL HAVE FIRE RESISTANCE RATING OF 0.5 HOURS.

1020.4 EXCEPTION 2: DEAD ENDS IN CORRIDORS RESTRICTED TO NO MORE THAN 50 FEET.

MIDWAY FIRE DISTRICT
FIRE STATION # 36
4252 GULF BREEZE PARKWAY, GULF BREEZE, FL

Revision	

Scale:	AS NOTED
Date:	04-03-2024
Drawn:	Checked:

LS101
SHEET #

